

KNX I/O Module

Reference Manual



KNX I/O Module IO200-S	WRKT4200J
------------------------	-----------

V 1.0

1 Contents

1	Contents.....	2
2	List of figures.....	6
3	List of tables.....	7
4	Document overview.....	10
4.1	Document updates.....	10
4.2	List of abbreviations.....	11
5	Product description	11
5.1	General information	11
5.2	Main features	12
5.3	KNX Data Secure	12
5.4	Factory Default	12
5.5	ETS Programming.....	12
5.6	Factory Reset	13
5.7	Manual Control.....	13
6	Connection	14
6.1	Dry Contact Connection	14
6.2	10-230V AC-DC Connection	15
6.3	Technical information	15
6.4	Dimensional drawings.....	17
7	Product database	18
8	ETS Database	19
8.1	General Settings	19
8.1.1	General Settings Parameters	19
8.1.2	General Group Objects.....	20
8.1.3	Manual Control	21
8.2	Enable Outputs Page.....	22
8.3	Switching (Lighting) Parameters and Group Objects	22
8.3.1	Lighting Settings Parameters	22
8.3.2	Time Delay Parameters	23
8.3.3	Flashing Parameters.....	25
8.3.4	Staircase Parameters	26
8.3.5	Feedback Page.....	27
8.3.6	Behaviour Parameters.....	28
8.3.7	Scenes Parameters.....	28

8.3.8	Logic Input Parameters	29
8.3.9	Working Hours Counter Parameters.....	29
8.3.10	Joining Central Functions Parameters	30
8.3.11	Switching (Lighting) Group Objects.....	31
8.4	Switching (Heating) Parameters and Group Objects.....	33
8.4.1	Priorities for Actuating Values in Switching (Heating) Outputs.....	33
8.4.2	Heating Settings Parameters.....	33
8.4.3	Continuous PWM Control Settings Parameters.....	35
8.4.4	Feedback Parameters.....	36
8.4.5	Winter / Summer Modes Parameters.....	36
8.4.6	Forced Mode Parameters	36
8.4.7	Valve Protection Parameters	37
8.4.8	Monitoring Parameters.....	38
8.4.9	Working Hours Counter Parameters.....	38
8.4.10	Behaviour Parameters.....	39
8.4.11	Switching (Heating) Group Objects.....	40
8.5	Shutter/Blind Parameters and Group Objects.....	42
8.5.1	Shutter / Blind Settings Parameters	44
8.5.2	Driving Shuttter / Blind Parameters.....	45
8.5.3	Driving Slats Parameters	46
8.5.4	Feedback Parameters.....	46
8.5.5	Behaviour Parameters.....	47
8.5.6	Weather Alarms Parameters.....	48
8.5.7	Scenes Parameters	49
8.5.8	Joining Central Functions Parameters	50
8.5.9	Shutter / Blind Group Objects.....	50
8.6	Fan Coil Parameters and Group Objects	52
8.6.1	Priorities for Actuating Values in Fan Coil Outputs.....	54
8.6.2	Priorities for Fan Level in Fan Coil Outputs.....	54
8.6.3	Fan Coil Settings Parameters	54
8.6.4	Valve Settings Parameters	55
8.6.5	Fan Settings Parameters	56
8.6.6	Fan Behavior Parameters.....	57
8.6.7	Manual Fan Control Page.....	58
8.6.8	Feedback Page.....	58
8.6.9	Forced Mode	59
8.6.10	Protection Parameters	60
8.6.11	Monitoring Parameters.....	61
8.6.12	Behaviour Parameters.....	62
8.6.13	Fan Coil Group Objects.....	63
9	Inputs.....	67
9.1	Input Types.....	67
9.2	Block Diagrams	67
9.2.1	Block Diagram of Physical Input Signal	67
9.3	Status LEDs Behavior.....	68

9.4	Input General Parameters and Objects	68
9.4.1	Input General Parameters.....	68
9.4.2	Input General Group Objects	72
9.5	Input Function Parameters and Objects.....	73
9.5.1	Function Parameters of Switches Sensors and Card Holders	73
9.5.2	Function Parameters of Push Buttons	75
9.5.3	Function Group Objects	80
10	Auxiliary Functions.....	81
10.1	Converter	81
10.1.1	Converter Parameters.....	82
10.1.2	Converter Group Objects	84
10.2	Filter.....	87
10.2.1	Filter Parameters.....	87
10.2.2	Filter Group Objects	89
10.3	General Counter	90
10.3.1	General Counter Parameters	91
10.3.2	General Counter Group Objects	93
10.4	Logic Gate.....	96
10.4.1	Logic Gate Parameters	96
10.4.2	Logic Gate Group Objects	97
10.5	Min/Max/Average Value Calculator	99
10.5.1	Min/Max/Average Value Calculator Parameters.....	99
10.5.2	Min/Max/Average Value Calculator Group Objects	100
10.6	Monitor	101
10.6.1	Monitor Parameters.....	101
10.6.2	Monitor Group Objects	102
10.7	Presence Detector Controller	104
10.7.1	Presence Detector Controller Parameters.....	104
10.7.2	Presence Detector Controller Group Objects	105
10.8	Scene Actuator	105
10.8.1	Scene Actuator Parameters	106
10.8.2	Scene Actuator Group Objects.....	107
10.9	Send After Delay.....	108
10.9.1	Send After Delay Parameters	108
10.9.2	Presence Detector Controller Group Objects	109
10.10	Send After Reset	110
10.10.1	Send After Reset Parameters	110
10.10.2	Send After Reset Group Objects	112
10.11	Send Cyclically.....	112
10.11.1	Send Cyclically Parameters	113
10.11.2	Send Cyclically Group Objects.....	114
10.12	Sequencer.....	116

10.12.1	Sequencer Parameters	116
10.12.2	Sequencer Group Objects	118
10.13	Staircase Controller	119
10.13.1	Staircase Controller Parameters	119
10.13.2	Staircase Controller Group Objects	121
10.14	Working Time Counter	121
10.14.1	Working Time Counter Parameters	122
10.14.2	Working Time Counter Group Objects.....	124
11	<i>Some examples of typical applications.....</i>	125
11.1	Lighting control with KNX I/O Module	125
11.2	Blind control with KNX I/O Module	126
11.3	Heating control with KNX I/O Module	127
11.4	2 pipes fan coil system control with KNX I/O Module	128
11.5	Scene control with KNX I/O Module	129

2 List of figures

Figure 1 KNX Secure Device Certificate Label	12
Figure 2 Dry Contact Connection for IO200-S	14
Figure 3 10-230V AC-DC Connection for IO200-S	15
Figure 4 Front Dimension for IO200-S	17
Figure 5 Side Dimension for IO200-S	17
Figure 6 On Delay	24
Figure 7 Off Delay	24
Figure 8 On&Off Delay	25
Figure 9 Flashing Function	26
Figure 10 Staircase Function	27
Figure 11 Working Principle of Monitoring Failure	38
Figure 12 Shutter / Blind - Shutter Movement Duration and Position	43
Figure 13 Shutter / Blind - Blind Movement Duration and Position	43
Figure 14 Shutter / Blind – Default Slant Positions	43
Figure 15 2 Pipes Fan Coil System	53
Figure 16 4 Pipes Fan Coil System	53
Figure 17 Block Diagram of Physical Input Signal	67

3 List of tables

Table 1	10
Table 2	11
Table 3	16
Table 4	18
Table 5	20
Table 6	20
Table 7	21
Table 8	21
Table 9	21
Table 10.....	23
Table 11.....	24
Table 12.....	25
Table 13.....	26
Table 14.....	27
Table 15.....	28
Table 16.....	29
Table 17.....	29
Table 18.....	29
Table 19.....	30
Table 20.....	31
Table 21.....	31
Table 22.....	31
Table 23.....	32
Table 24.....	32
Table 25.....	32
Table 26.....	32
Table 27.....	32
Table 28.....	32
Table 29.....	33
Table 30.....	35
Table 31.....	35
Table 32.....	36
Table 33.....	36
Table 34.....	37
Table 35.....	37
Table 36.....	38
Table 37.....	39
Table 38.....	40
Table 39.....	40
Table 40.....	41
Table 41.....	41
Table 42.....	41
Table 43.....	41
Table 44.....	41

Table 45.....	42
Table 46.....	42
Table 47.....	45
Table 48.....	46
Table 49.....	46
Table 50.....	47
Table 51.....	48
Table 52.....	49
Table 53.....	50
Table 54.....	50
Table 55.....	50
Table 56.....	50
Table 57.....	51
Table 58.....	51
Table 59.....	51
Table 60.....	51
Table 61.....	52
Table 62.....	52
Table 63.....	52
Table 64.....	52
Table 65.....	55
Table 66.....	56
Table 67.....	57
Table 68.....	57
Table 69.....	57
Table 70.....	58
Table 71.....	58
Table 72.....	59
Table 73.....	60
Table 74.....	60
Table 75.....	61
Table 76.....	63
Table 77.....	63
Table 78.....	63
Table 79.....	63
Table 80.....	64
Table 81.....	64
Table 82.....	64
Table 83.....	64
Table 84.....	65
Table 85.....	65
Table 86.....	65
Table 87.....	65
Table 88.....	66
Table 89.....	66
Table 90.....	72
Table 91.....	72
Table 92.....	72

Table 93.....	72
Table 94.....	73
Table 95.....	73
Table 96.....	73
Table 97.....	73
Table 98.....	75
Table 99.....	80
Table 100.....	80
Table 101.....	84
Table 102.....	84
Table 103.....	84
Table 104.....	85
Table 105.....	85
Table 106.....	85
Table 107.....	86
Table 108.....	86
Table 109.....	86
Table 110.....	86
Table 111.....	87
Table 112.....	87
Table 113.....	89
Table 114.....	89
Table 115.....	90
Table 116.....	90
Table 117.....	90
Table 118.....	93
Table 119.....	93
Table 120.....	94
Table 121.....	94
Table 122.....	94
Table 123.....	94
Table 124.....	95
Table 125.....	97
Table 126.....	98
Table 127.....	98
Table 128.....	98
Table 129.....	100
Table 130.....	100
Table 131.....	101
Table 132.....	101
Table 133.....	102
Table 134.....	103
Table 135.....	103
Table 136.....	103
Table 137.....	103
Table 138.....	104
Table 139.....	105
Table 140.....	105

Table 141.....105

Table 142.....105

Table 143.....107

Table 144.....107

Table 145.....107

Table 146.....108

Table 147.....109

Table 148.....109

Table 149.....110

Table 150.....110

Table 151.....110

Table 152.....112

Table 153.....112

Table 154.....112

Table 155.....114

Table 156.....114

Table 157.....114

Table 158.....115

Table 159.....115

Table 160.....118

Table 161.....118

Table 162.....118

Table 163.....119

Table 164.....119

Table 165.....120

Table 166.....121

Table 167.....121

Table 168.....121

Table 169.....121

Table 170.....123

Table 171.....124

Table 172.....124

Table 173.....124

Table 174.....124

Table 175.....125

4 Document overview

4.1 Document updates

Version	Date	Modifications
1.0	January 2024	Preparation of the final version

Table 1

4.2 List of abbreviations

Abbreviation	Description
KNX Communication Flags	
C	Communication
R	Read
W	Write
T	Transmit
U	Update
Other	
Par.	Parameter
Obj.	Object
LC	Last command
TC	Transmitted command

Table 2

5 Product description

5.1 General information

Panasonic KNX I/O Module is an input and output device designed to fulfill the automation requirements of residential and commercial KNX projects. It comes with KNX Data Secure feature which assures secure data communication on twisted pair bus line for the compatible devices. Panasonic KNX I/O Module can be used to connect conventional switches and binary sensors (e.g. presence detector, card holder etc.) to the KNX bus. Feedback LEDs in conventional switches can also be connected, thanks to its configurable inputs which can be used to drive feedback LEDs as well. Panasonic KNX I/O Module has competent control features such as Lighting, Heating, Shutter and Fan Coil. The current status of the input and output signals can be visualized on the device with its status LEDs. Signals can be manually overridden using the device's manual control button. Many complex configurations and various scenarios can be realized, thanks to the powerful auxiliary functions (i.e. logic, converter and sequence functions, etc.).

5.2 Main features

- KNX Data Security
- Manual Control
- Switching (Lighting / Heating)
- Shutter / Blind Control (AC / DC)
- Fan Coil (2 pipe / 4 pipe)
- Dry Contact Inputs (Switch-Sensor, Push Button, Card Holder, Feedback LED)
- Wide Range Voltage Inputs (10-230V)
- Auxiliary Functions (Sequencer, Counter, Scene Actuator, Filter, Converter, Logic Gate, Presence Detector Controller, Staircase Controller)

5.3 KNX Data Secure

KNX Secure, protects KNX devices against unwanted access and manipulation. A device with the KNX Secure feature transmits telegrams sent to the KNX bus line in a secure and encrypted manner.



Figure 1 KNX Secure Device Certificate Label

Two removable labels with a device certificate come with the product. One of the labels is on the product and the other is inside the box. Installation of the product can be done via ETS using the device certificate.



Keep the removable labels with the device certificate in a safe place.

5.4 Factory Default

In the delivery state, manual control (see below) is enabled with some restrictions to test the wiring. Only one channel can be set at a certain time to protect the connected equipment (e.g., Shutter/Blind). KNX socket must be connected to power up the device. Non restricted manual control is available after ETS programming.

5.5 ETS Programming

User can define the device behavior and connect it to another KNX devices after programming it by ETS. The behavior of the device after programming with the ETS depends on the configuration. The description of the features, parameters and objects is in the device reference manual.

5.6 Factory Reset

The factory reset restores the device to its basic settings, including the physical address (15.15.255), and disables the KNX Data Security. During secure operation, a commissioned KNX secure device can be recommissioned with the device certificate after a factory reset.

Performing a factory reset;

- Disconnect the KNX bus connector from the device.
- Wait for 3 seconds.
- Connect the KNX bus to the device again.
- Press and hold the [] and [RST] button at the same time for nearly 5 seconds until see the programming LED blinks.
- Blinking programming LED visualizes the successful reset of the device to factory default settings. The device performs a master reset, and device is ready for operation again after approx. 5 second.

Note: Device allows factory reset only for 12 seconds after power up.

5.7 Manual Control

To enter the manual control mode, press [] button. An output's LED will start to indicate that the manual control is operated on that input. Press [INs] button to change manual control from Relay Outputs to Dry Contact Inputs. Press [SET] or [RST] buttons to simulate setting or resetting an input/output signal. Press [] button to exit the manual control mode.

Note: The KNX telegrams that comes from KNX bus do not accept while manual control is activated.

6 Connection

6.1 Dry Contact Connection

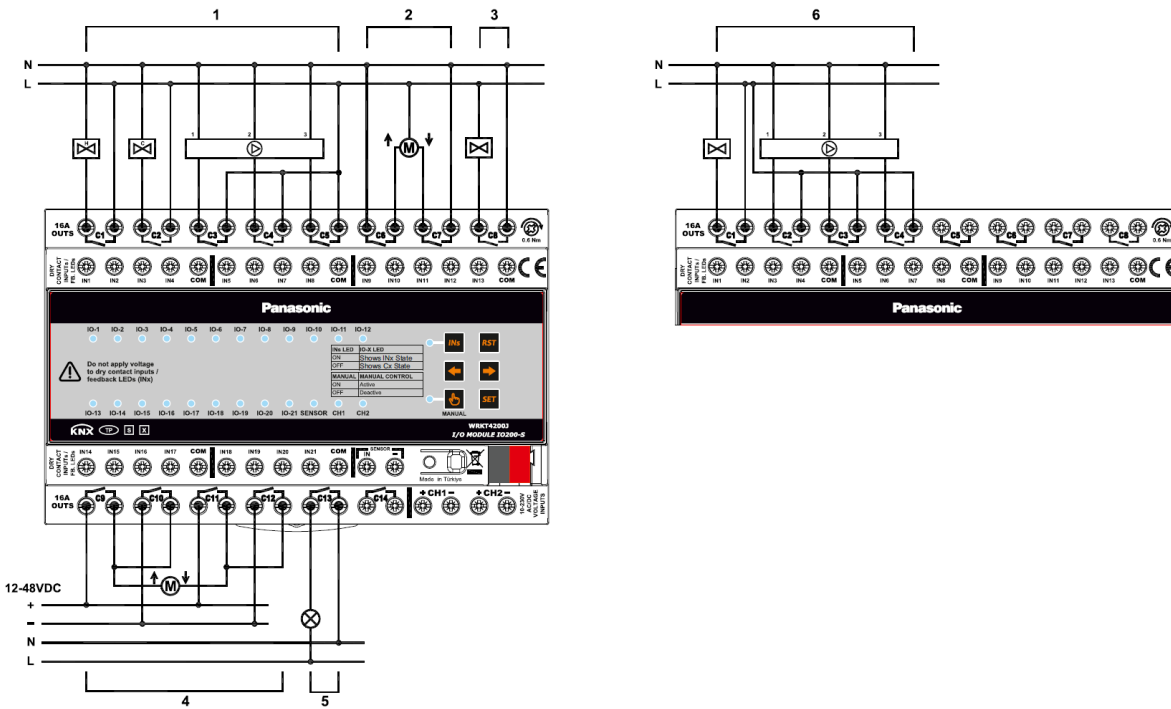


Figure 2 Dry Contact Connection for IO200-S

1. Fan Coil (Heating and Cooling)
4 Pipe uses 5 output channels. Channel 1 to channel 5 are used for fan coil. Channel 1 uses for heating, Channel 2 uses for cooling, Channel 3, Channel 4 and channel 5 uses for fan steps.
2. Shutter/Blind
Channel 6 and channel 7 are used for shutter/blind connection.
3. Heating
Channel 8 is used for heating function.
NOTE: For the outputs use circuit breakers for the respective rated current.
4. Shutter/Blind DC
4 output channels are used.
Channel 9 to channel 12 are used for shutter/blind DC connection.
*To avoid short circuit, make sure that the ETS configuration of the channels which connected to the DC motor are done correctly
*Fuse or short circuit protection should be used with DC power supply.
5. Switching
Channel 13 is used for switching – lighting function.
6. Fan Coil (Heating and Cooling)
2 Pipe uses 4 output channels. Channel 1 to channel 4 are used for fan coil. Channel 1 uses for heating or cooling, Channel 2, channel 3 and channel 3 uses for fan step.

6.2 10-230V AC-DC Connection

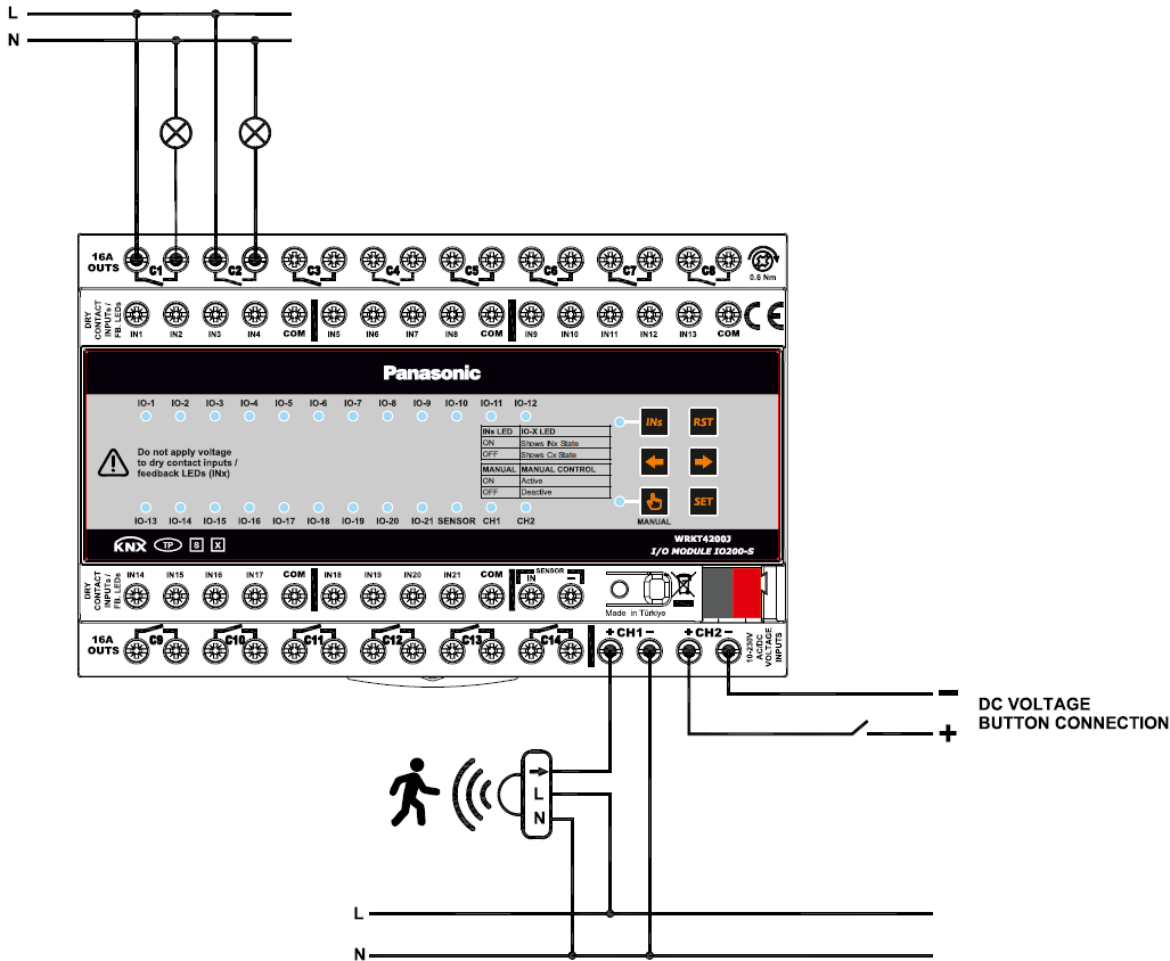


Figure 3 10-230V AC-DC Connection for IO200-S

6.3 Technical information



Power	
Operating voltage	DC 21-32 V (from KNX bus)
Current consumption	Max. 40mA
Environmental conditions	
Ambient temperature	-5 C ...+45 C
Storage temperature	-10 C ... +55 C
Ambient humidity	5...93% (non-condensing)
Housing	
Dimensions (HxWxD)	90mmx143,8mmx65,8mm
Mounting (IEC60715)	35 mm top-hat rail (TH35)

Mounting width	DIN rail 144mm (8 modules)
KNX bus connection	KNX connector (243-211 Wago)
Input/Output connector	60x Screw Terminals
Weight	533,35 g
Input / Output	
Outputs	14ch 16A latching type relay
Inputs	21ch dry contact input (Configurable as feedback LED) 2ch voltage input (10-230V AC/DC) 1ch sensor input
Electrical safety	
Protection type (IEC60529)	IP 20
Pollution degree (IEC60664)	2
Protection class (IEC61140)	II
Overtoltage category (IEC60664)	III
Standards	
EMC	EN 60669-2-1
LVD	EN 60669-2-1
KNX	EN 50090

Table 3

Note: Protect the switch contacts with a series-connected miniature circuit-breaker of characteristic B for a max. rated current of 16A.

6.4 Dimensional drawings

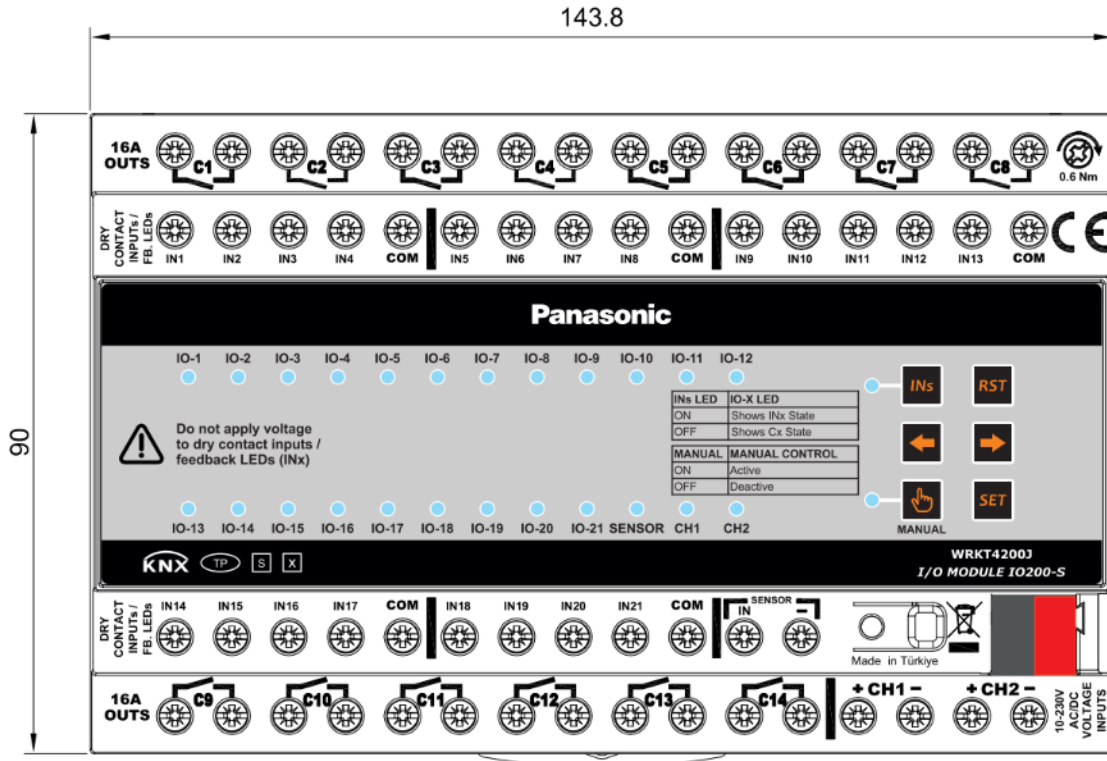


Figure 4 Front Dimension for IO200-S

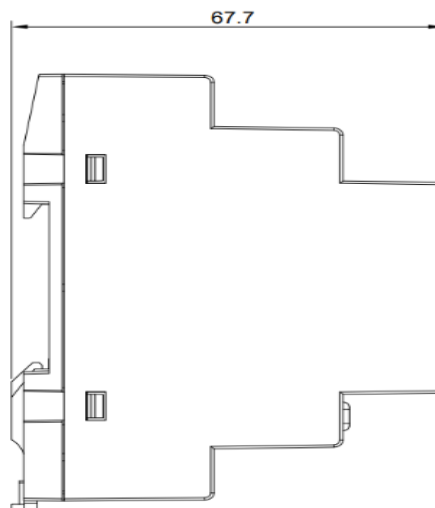


Figure 5 Side Dimension for IO200-S

7 Product database

Manufacturer	Panasonic
Product family	Interfaces
Product type	Input Output Module
Product name	I/O Module IO200-S

Table 4

8 ETS Database

8.1 General Settings

8.1.1 General Settings Parameters

Name	Values	Description
<i>Startup delay</i>	0...1...250 s	This parameter defines the delay time for startup in seconds. After bus voltage recovery, the device always waits the delay time to expire before sending telegrams to the bus and start operation.
<i>Send device in operation telegram</i>	No Yes	Selecting Yes enables "Device In Operation" object.
<i>Device in operation telegram value</i>	Off On	This parameter specifies the value of the telegram that will be sent from "Device In Operation" object.
<i>Telegram cycle time unit</i>	Second Minute Hour Day	This parameter sets the unit of the time interval at which the "Device In Operation" group object sends a telegram cyclically.
<i>Telegram cycle time value</i>	1...255	This parameter sets the value of the time interval at which the "Device In Operation" group object sends a telegram cyclically.
<i>Enable telegram limitation</i>	No Yes	This parameter is used to enable telegram limitation. Telegram limitation is used to limit the telegrams that are sent by the device to the bus in order to decrease the load on KNX bus.
<i>Telegram limit time</i>	1 second 5 seconds 10 seconds 30 seconds 1 minute 5 minutes 10 minutes 30 minutes 60 minutes	This parameter determines the period of the telegram limitation. Only a specified number of telegrams will be sent in this period. Other telegrams will be postponed to the next period.
<i>Telegram limit number</i>	1... 10 ...255	This parameter determines the maximum number of telegrams that can be sent by the device in telegram limit period.
<i>Enable request status values</i>	No Yes	This parameter enables "Request Status Values" object that is used to send "Manual Control Status" and "Input – Status" objects values to the bus.
<i>Send request status values when request object value is</i>	Off On Off or on	This parameter determines the value of "Request Status Values" object that will trigger sending status objects values.
<i>Manual control</i>	Enabled Disabled Enable/Disable via communication object	This parameter enables or disables the manual control on the device. If "Enabled" is selected, the user can enter manual control mode via manual operation buttons.

Name	Values	Description
		<p>If “Disabled” is selected, the user cannot enter manual control mode via manual operation buttons.</p> <p>If “Enable/Disable via communication object” is selected, the operator can use “Manual Control – Enable/Disable” object to allow or prevent entering manual control mode.</p>
<i>Manual control after bus return</i>	Disabled Enabled Read from bus As before bus failure.	<p>This parameter determines the status of the manual control after bus voltage return.</p> <p>If “Read from bus” is selected, the device will send a read request for “Manual Control – Enable/Disable” object, if no response is received the manual control will be disabled.</p>
<i>Enable “Manual Control Status – Started / Stopped” object</i>	No Yes	This parameter enables “Manual Control Status” object that is used to indicate when the manual control mode is started or stopped.
<i>Send manual control status</i>	Do not send, update only On change	<p>“Don’t send, update only”: “Manual Control Status” object value is updated when the manual control mode is started or stopped but not sent to the bus. The user can read the object value or send a telegram to “Request Status Values” object to get manual control status.</p> <p>On change: Manual control status is sent to the bus when the manual operation is started or stopped.</p>
<i>Stop manual control automatically</i>	Not active After 1 minute After 5 minutes After 10 minutes After 30 minutes After 60 minutes	This parameter is used to stop the manual control mode automatically after a specific time from the last pressing of manual operation buttons.
<i>Power saving mode for LEDs</i>	Not active After 1 minute After 5 minutes After 10 minutes After 30 minutes After 60 minutes	<p>This parameter is used to activate power saving mode for LEDs.</p> <p>After the specified time, the device enters power saving mode where it turns off all input status LEDs. The device exits power saving mode and displays inputs status with LEDs when a manual operation button is pressed.</p>

Table 5

8.1.2 General Group Objects

No	Object Name	Function	Size	Datapoint Type	Flags				
					C	R	W	T	U
1	<i>Device In Operation</i>	<i>Trigger</i>	1 Bit	1.001 Switch	C			T	

Table 6

This object is available if “Send device in operation telegram” parameter is set to “Yes”. It is used to monitor the presence of the device on KNX bus. After startup delay time the device sends telegrams cyclically to this object according to “Device in operation telegram value”, “Telegram cycle time unit” and “Telegram cycle time value” parameters values.

No	Object Name	Function	Size	Datapoint Type	Flags				
					C	R	W	T	U
2	<i>Request status values</i>	<i>Send values</i>	1 Bit	1.001 Switch	C		W		

Table 7

This object is available if “Enable request status values object” parameter is set to “Yes”.

When this object receives a proper telegram according to “Send status values when request status object value is” parameter, all enabled input status objects and manual control status object values are sent to the bus.

No	Object Name	Function	Size	Datapoint Type	Flags				
					C	R	W	T	U
3	<i>Manual Control</i>	<i>Enable / Disable</i>	1 Bit	1.003 Enable	C		W		

Table 8

This object is available if “Manual Control” parameter is set to “Enable/Disable via communication object”. If this object receives “Enable” telegram, the user will be able to start manual control mode via manual operation buttons.

If this object receives “Disable” telegram, the user will not be able to start manual control mode via manual operation buttons.

No	Object Name	Function	Size	Datapoint Type	Flags				
					C	R	W	T	U
4	<i>Manual Control Status</i>	<i>Started / Stopped</i>	1 Bit	1.010 Start/Stop	C	R		T	





Table 9

This object is available if “Enable “Manual Control Status – Started / Stopped” object” parameter is set to “Yes”.

This object indicates the status of the manual control mode.

8.1.3 Manual Control

The status of the inputs and outputs can be simulated and overridden in manual control mode with manual operation buttons. In manual control mode, the input and output which its status is overridden will preserve the new status until the device exits manual control mode. The new status is displayed with the status LED too.

Manual control is available only after enabling it in ETS. To enter the manual control mode, press [] button. An output’s LED will start to blink indicating that the manual control is operated on that output. Likewise, when the [INs] button is pressed, the input’s LED will start to blink. Press [ ] buttons to change the position of the controlled input or output to the right and left. Press [SET] and [RST] buttons to simulate setting and resetting an input or output signal. Press [] button to exit the manual control mode.

8.2 Enable Outputs Page

In this page the outputs of the device can be enabled and its functionalities can be selected from the next types:

1. Switching (Lighting)
2. Switching (Heating)
3. Shutter/Blind (AC)
4. Shutter/Blind (DC)
5. Fan Coil (2-Pipe)
6. Fan Coil (4-Pipe)

In case of enabling a fan coil function on an output, “Number of fan levels” parameter will be shown to specify the number of levels (steps) of the controlled fan in the fan coil system.

8.3 Switching (Lighting) Parameters and Group Objects

8.3.1 Lighting Settings Parameters

Name	Values	Description
<i>Output name</i>		The user can give an output an optional name that describes its functionality or the connected device. This parameter value has no effect on the channel work.
<i>Use template parameters</i>	No Yes	If yes is selected the parameter values in “Template -> Switching (Lighting)” page will be used for the configured output and the parameters of this output will be hidden.
<i>Contact type</i>	Normally open Normally close	The relay of a switching output can be configured as normally open or normally closed contacts. In this way, the inversion of switching states is possible. Normally open: <ul style="list-style-type: none"> • Switching state = off -> Relay contact is open • Switching state = on -> Relay contact is closed Normally closed: <ul style="list-style-type: none"> • Switching state = off -> Relay contact is closed • Switching state = on -> Relay contact is open
<i>Function type</i>	Switch on/off Time delay Flashing Staircase	Function selection for lighting. An additional parameter page will be shown depending on selected option.
<i>Feedback</i>	Disabled Enabled	This parameter can be used to disable or enable the feedback function. When the function is enabled the relevant parameter will be available.
<i>Behaviour</i>	Disabled Enabled	This parameter can be used to disable or enable the behavior function. When the function is enabled the relevant parameter will be available.

Name	Values	Description
<i>Scene</i>	Disabled Enabled	This parameter can be used to disable or enable the scene function. When the function is enabled the relevant parameter will be available.
<i>Logic input</i>	Disabled Enabled	This parameter can be used to disable or enable the logic input function. When the function is enabled the relevant parameter will be available.
<i>Working hours counter</i>	Disabled Enabled	This parameter can be used to disable or enable the working hours counter function. When the function is enabled the relevant parameter will be available.
<i>Joining Central functions</i>	Disabled Enabled	This parameter can be used to disable or enable the central functions. When the function is enabled the relevant parameter will be available.

Table 10

8.3.2 Time Delay Parameters

Name	Values	Description
<i>Enable / Disable function with object</i>	No Yes	If "Yes" is selected "Output x – Enable Function" object will be shown. This object can be used to disable the function of the output so it will work as normal switch on/off function. Note: By default, the function is enabled after ETS download operation and it restores its previous status after bus voltage return.
<i>Time delay is applied for</i>	Switching on Switching off Switching on & off	Switching on: A time delay will be applied after receiving on telegrams only. Its working principle is shown on Figure 5. Switching off: A time delay will be applied after receiving off telegrams only. Its working principle is shown on Figure 6. Switching on & off: A time delay will be applied after receiving on and off telegrams. Its working principle is shown on Figure 7.
<i>Switching on delay time</i>	00:00:01... 00:00:10 ...09:06:07 (hh:mm:ss)	This parameter is used for setting the duration of the switch on delay.
<i>Retriggerable</i>	No Yes	Yes: A switch on delay still in progress can be retriggered by another "ON" telegram. No: the retriggering time is suppressed.
<i>Switching off delay time</i>	00:00:01... 00:01:00 ...09:06:07 (hh:mm:ss)	This parameter is used for setting the duration of the switch off delay.

Name	Values	Description
<i>Retriggerable</i>	No Yes	Yes: A switch off delay still in progress can be retriggered by another "OFF" telegram. No: the retriggering time is suppressed.

Table 11

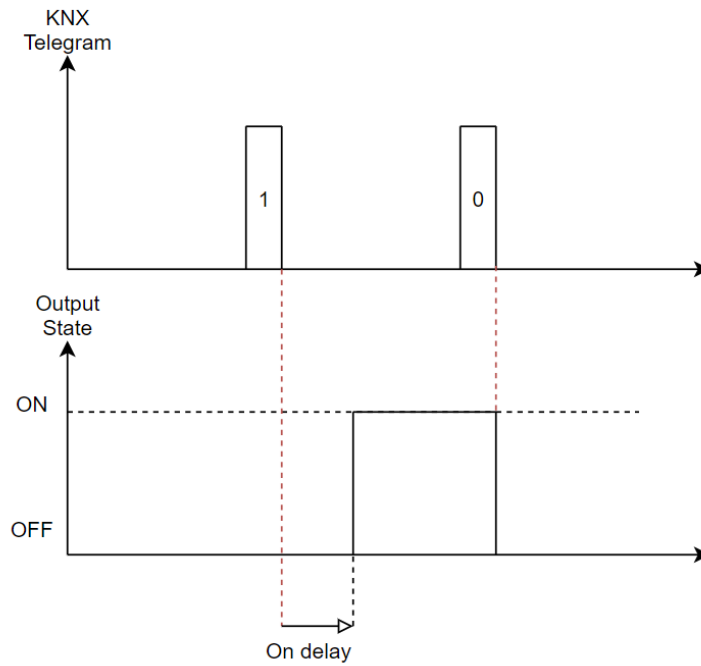


Figure 6 On Delay

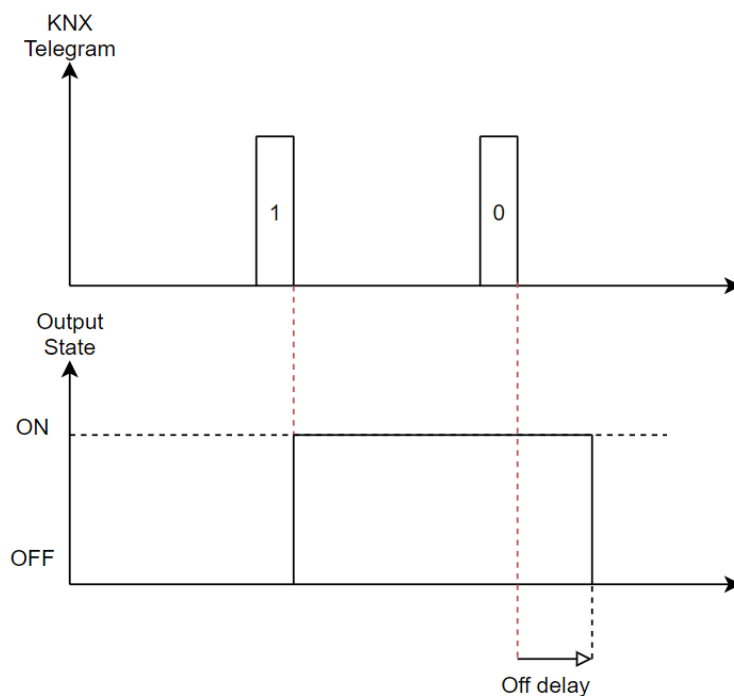


Figure 7 Off Delay

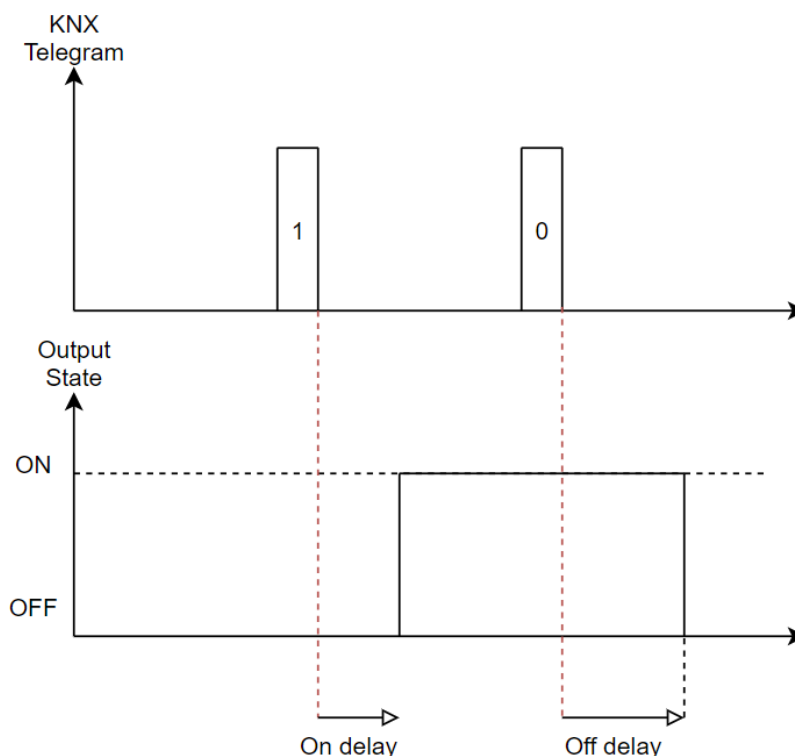


Figure 8 On&Off Delay

8.3.3 Flashing Parameters

Name	Values	Description
<i>Enable / Disable function with object</i>	No Yes	If "Yes" is selected "Output x – Enable Function" object will be shown. This object can be used to disable the function of the output so it will work as normal switch on/off function. Note: By default, the function is enabled after ETS download operation and it restores its previous status after bus voltage return.
<i>On time</i>	00:00:01...09:06:07 (hh:mm:ss)	This parameter specifies the amount of time the output stays on during flashing periode. Flashing function working principle is shown on Figure 8.
<i>Off time</i>	00:00:01...09:06:07 (hh:mm:ss)	This parameter specifies the amount of time the output stays off during flashing periode. Flashing function working principle is shown on Figure 8.

Table 12

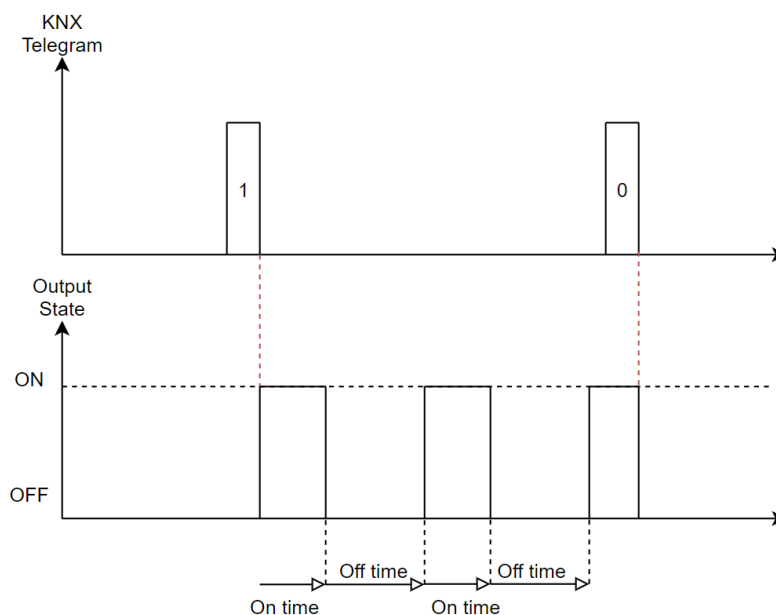


Figure 9 Flashing Function

8.3.4 Staircase Parameters

Name	Values	Description
<i>Enable / Disable function with object</i>	No Yes	If “Yes” is selected “Output x – Enable Function” object will be shown. This object can be used to disable the function of the output so it will work as normal switch on/off function. Note: By default, the function is enabled after ETS download operation and it restores its previous status after bus voltage return.
<i>Staircase time</i>	00:00:01... 00:00:10 ...09:06:07 (hh:mm:ss)	This parameter specifies the amount of time the output stays on after receiving ON telegrams. When staircase time elapses, the output is switched off automatically. Staircase function working principle is shown on Figure 9.
<i>Retirggerable</i>	No Yes	Yes: Receiving new ON telegrams during an active staircase time retriggeres it (reset the timer). No: Receiving new ON telegrams during an active staircase time has no effect.

Table 13

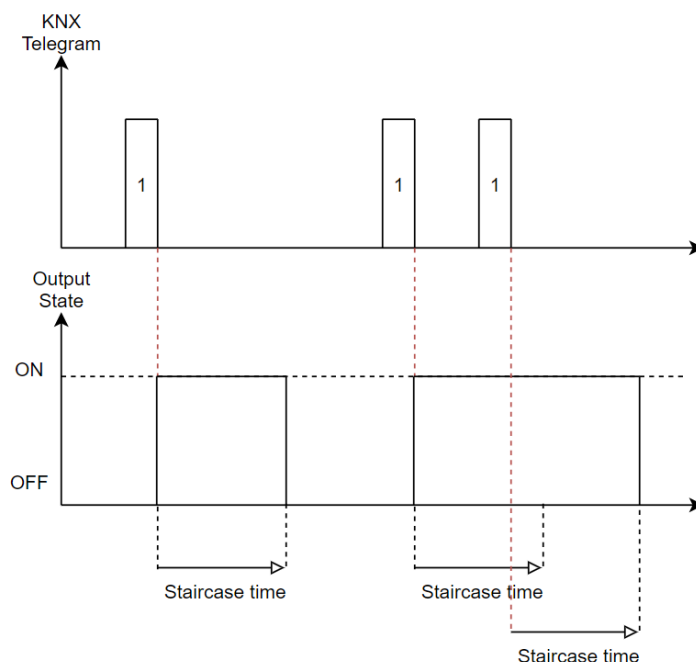


Figure 10 Staircase Function

8.3.5 Feedback Page

Name	Values	Description
<i>Feedback type</i>	Normal Inverted	Normal: Sends the state of the output Inverted: Sends the inverted state of the output
<i>Send feedback telegrams</i>	Do not send, update only Send on change	“Don’t send, update only”: “Feedback” object value is updated when the output status is changed but not sent to the bus. The user can read the object value to get the output status. On change: The new output status is sent to the bus when it changes.
<i>Send feedback cyclically</i>	No Yes	This parameter enables sending the output status cyclically to the bus.
<i>Feedback cycle time</i>	00:00:01 ... 00:01:00 ... 09:06:07	This parameter determines the cycle time between the repeated feedback telegrams.
<i>Limit cyclically sending count</i>	No Yes	“No”: the feedback telegrams will be sent to the bus cyclically forever. “Yes”: the feedback telegrams will be sent to the bus cyclically a certain number of times.
<i>Feedback Cycle count</i>	1... 10 ...65535	This parameter determines how many times a feedback telegram will be sent cyclically.

Table 14

8.3.6 Behaviour Parameters

The preferred relay contact positions after bus voltage return or after ETS programming can be preset separately for each output. Since the device is equipped with bus-independent bitstable relays, the relay switching state at bus voltage failure can be defined as well.

Name	Values	Description
<i>Behaviour after ETS programming</i>	Off On Do not change	Off: After ETS programming operation, the related output will be OFF. On: After ETS programming operation, the related output will be ON. Do not change: After ETS programming operation, the related output state will be as before starting the programming operation.
<i>Response to bus voltage failure</i>	Off On Do not change	Off: After bus voltage failures, the related output will be OFF. On: After bus voltage failures, the related output will be ON. Do not change: The related output state doesn't change after bus voltage failures.
<i>Behaviour after bus voltage return</i>	Off On As before bus failure	Off: After bus voltage returns, the related output will be OFF. On: After bus voltage returns, the related output will be ON. As before bus failure: The related output state will be as same as the latest state before bus voltage failure.

Table 15

8.3.7 Scenes Parameters

Up to 12 scenes can be programmed and scene values stored separately in the device for each switching output. The scene values are recalled or stored via a separate scene extension object by means of extension telegrams. The datapoint type of the extension object permits addressing a maximum of 64 scenes. This means that, in the configuration of a scene, it is possible to specify which scene number (1...64) contacts the internal scene (1...12).

Name	Values	Description
<i>Scene x is assigned to</i>	Not assigned Scene number 1..64	This parameter defines the scene number that will trigger the scene function to change the output state
<i>State</i>	Off On	This parameter is used for configuring the switching state which will be set when the scene is recalled.
<i>Storage function</i>	Disabled Enabled	Disabled: The storage (learn) telegrams are ignored. Enabled: the current switching state can be stored internally via "Scene Input" object when a storage (learn) telegram is received.

Name	Values	Description
<i>Delay</i>	0...255 (s)	This parameter is used for setting the duration of the scene delay time. If its value is between 1...255, the received recall scene commands will be delayed before execution.

Table 16

8.3.8 Logic Input Parameters

With the logic function a new communication object "Logic Input" is added and logically linked with the object "Switching On/Off". The values of these two objects are evaluated and then the output will be switched on or off depending on the result of the logic. Logic Input function truth table is shown on Table 17.

Function	Switch On/Off	Logic Input	Output State
AND	0	0	0
	0	1	0
	1	0	0
	1	1	1
OR	0	0	0
	0	1	1
	1	0	1
	1	1	1
XOR	0	0	0
	0	1	1
	1	0	1
	1	1	0

Table 17

Name	Values	Description
<i>Logic gate type</i>	And Or Xor	This parameter defines the type of the logic gate.

Table 18

8.3.9 Working Hours Counter Parameters

The working hours counter determines the switch-on time of an output. The totalled working hours are added in an internal meter and stored permanently in the device. The current meter reading can be transmitted cyclically to the bus by the "Working Hour Counter – Counter Value" object or when there is a change in an interval value. An alarm telegram can be sent to the bus when the working hours count reaches a limit value in ascending counters or when it reaches 0 in descending counters.

Name	Values	Description
<i>Counting direction</i>	Decrement Increment	Decrement": the counter will be loaded with "Counter start value" at the beginning and it will count down to 0. "Increment": the counter will be loaded with 0 at the beginning and it will count up to "Counter limit value".
<i>Counter start value</i>	1... 1000 ...65535	This parameter is available if "Counting direction" parameter is set to "Decrement". It determines the value that the timer will load it at the beginning.
<i>Counter limit value</i>	1... 1000 ...65535	This parameter is available if "Counting direction" parameter is set to "Increment". It determines the value that the timer will count up to it.
<i>Counter object type</i>	4-Byte value in s(DPT 13.100) 2-Byte value in h(DPT 7.007)	This parameter defines the DPT of "Counter Value" object.
<i>Send counter value</i>	Do not send, update only When counter value is changed At specific interval Cyclically only When counter value is changed and cyclically At specific interval and cyclically	This parameter defines when the function will send the counter value to the bus. If "Do not send, update only" is selected, the user can send read request to "Counter Value" object to get the current counter value. If the counter value is set to be sent at specific interval, an additional parameter will be shown to enter the interval value. The counter value will be sent to the bus if its new value is divisible by the interval value. If the counter value is set to be sent cyclically, additional parameters will be shown to enter the cycle time.

Table 19

8.3.10 Joining Central Functions Parameters

Name	Values	Description
<i>Join central continuous off</i>	No Yes	No: The output will ignore telegrams sent to "Central Continuous Off – Start/Stop" object. Yes: The output will participate in central continuous off according to telegrams sent to "Central Continuous Off – Start/Stop" object. "Central Continuous Off" object is prior to all other objects. This means that if the "Central Continuous Off" object is set to "Start = 1" the outputs which are participated to central continuous off function are switched off regardless of all other objects (switching object, central switching object ...etc). If "Central Continuous Off" object is set to "Start = 1", the participated outputs stay continuously in off position and they can not be switched on until this object is set to "Stop = 0".

Name	Values	Description
<i>Join central continuous on</i>	No Yes	No: The output will ignore telegrams sent to “Central Continuous On – Start/Stop” object. Yes: The output will participate in central continuous on according to telegrams sent to “Central Continuous On – Start/Stop” object. “Central Continuous On” object is prior to all other objects. This means that if the “Central Continuous On” object is set to “Start = 1” the outputs which are participated to central continuous on function are switched on regardless of all other objects (switching object, central switching object ...etc). If the central continuous on object is set to “Start = 1”, the participated outputs stay continuously in on position and they can not be switched off until this object is set to “Stop = 0”.
<i>Join central switching</i>	No Yes	No: The output will ignore telegrams sent to “Central Switching – On/Off” object. Yes: The output will participate in central switching according to telegrams sent to “Central Switching – On/Off” object. In central switching, the behaviour of the outputs is identical with 'normal' activation via the "Switching On/Off" object. If “Central Switching – On/Off” object is set to “On = 1”, the outputs which are participated to central switching are switched on and if it is set to “Off = 0” the participated outputs are switched off.

Table 20

8.3.11 Switching (Lighting) Group Objects

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>Output x</i>	<i>Switching On/Off</i>	1 Bit	1.001 Switch	C		W		

Table 21

This object is used to activate a switching output ("1" = Switch on / "0" = Switch off)

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>Output x</i>	<i>Switching Feedback</i>	1 Bit	1.001 Switch	C	R		T	

Table 22

This object is available if “Feedback” parameter is set to “Enabled”. It’s used to give feedback on the switching state of an independent switching output ("1" = Switched on / "0" = Switched off).

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>Output x</i>	<i>Enable Function</i>	1 Bit	1.003 Enable	C	R	W		

Table 23

This object is available if “Enable/Disable function with object” parameter is set to “Yes” in time delay, flashing or staircase functions’ pages. It’s used to enable/disable the function manually. When the function is disabled the output will act as a normal switch on/off function. By default, the function is enabled after ETS download operation and it restores its previous status after bus voltage return.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>Output x</i>	<i>Working Hours Counter – Counter Value (Seconds)</i>	4 Bytes	13.100 Time lag (s)					
	<i>Working Hours Counter – Counter Value (Hours)</i>	2 Bytes	7.007 Time (h)	C	R		T	

Table 24

This object is available if “Working hours counter” parameter is set to “Yes”. Its value represents the reached counter value and its DPT is specified by “Counter object type” parameter.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>Output x</i>	<i>Working Hours Counter – Reset Counter</i>	1 Bit	1.015 Reset	C		W		

Table 25

This object is available if “Working hours counter” parameter is set to “Yes”. It’s used to reload the counter with its start value if “Counting direction” is “Decrement” or with 0 value if “Counting direction” is “Increment” when it receives a “Reset command = 1” telegram.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>Output x</i>	<i>Working Hours Counter - Alarm</i>	1 Bit	1.005 Alarm	C	R		T	

Table 26

This object is available if “Working hours counter” parameter is set to “Yes. It’s used to send alarm when counter value reaches 0 if “Counting direction” is “Decrement” or when the counter value reaches “Counter limit value” if “Counting direction” is “Increment”.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>Output x</i>	<i>Logic Input</i>	1 Bit	1.001 Switch	C		W		

Table 27

This object is available if “Logic input” parameter is set to “Yes. It represents the second input of the logical operation (The first input is “Switching On/Off” object).

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>Output x</i>	<i>Scene Input</i>	1 Byte	18.001 Scene Control	C		W		

Table 28

This object is available if “Scenes” parameter is set to “Yes”. It’s used to recall (activate) or save (learn) a scene.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>Output x</i>	<i>Reset Stored Scenes</i>	1 Bit	1.015 Reset	C		W		

Table 29

This object is available if “Scenes” parameter is set to “Yes”. It’s used to reload the stored states of scenes with its original parameter values.

8.4 Switching (Heating) Parameters and Group Objects

The switching heating functionality in KNX I/O Modules is used for heating systems such as underfloor heating, water based heating and electrical heating.

8.4.1 Priorities for Actuating Values in Switching (Heating) Outputs

The Switching (Heating) actuator distinguishes between various functions that can have an effect on the output. In order to prevent conflicting states, each available function has a certain priority. The function with the higher priority overrides the one with the lower priority.

Taking into account all possible functions, the following priorities are defined:

1. Manual control
2. Forced mode
3. Valve protection
4. Summer mode
5. Monitoring failure
6. Actuating values from behavior functions or from “Actuating Value” object.

8.4.2 Heating Settings Parameters

Name	Values	Description
<i>Output name</i>		The user can give an output an optional name that describes its functionality or the connected device. This parameter value has no effect on the channel work.
<i>Use template parameters</i>	No Yes	If yes is selected the parameter values in “Template -> Switching (Heating)” page will be used for the configured output and the parameters of this output will be hidden.
<i>Valve state when output’s contact are closed</i>	Open Closed	This parameter is used to determine the operation mode of the controlled valve. Open: The valve is open when it’s energized.

Name	Values	Description
		Closed: The valve is closed when it's energized.
<i>Type of control</i>	Switching (1-bit) Continuous PWM (1-byte)	<p>The heating output receives 1-bit or 1-byte command value telegrams transmitted, for example, by KNX room temperature controllers. Usually, the room temperature controller determines the room temperature and generates the command value telegrams using a control algorithm. The device controls its valve outputs either in switching form or with a PWM signal.</p> <p>Switching (1-bit): the telegram received via "Actuating Value" object is used directly in controlling the output. If on telegram is received the valve is opened, and if off telegram is received the valve is closed.</p> <p>Continuous PWM (1-byte): the telegram received via "Actuating Value" object is used to generate pulse-width-modulated switch signal at the valve output according to the set parameters in page "Continuous PWM Control Settings".</p>
<i>Feedback</i>	Disabled Enabled	This parameter is used to disable or enable the feedback function. When the function is enabled the relevant parameter will be available.
<i>Winter / Summer modes</i>	Disabled Enabled	<p>This parameter is used to disable or enable summer/winter modes. When the function is enabled the relevant parameter will be available.</p> <p>In summer mode, the valve is closed and the values received from "Actuating Value" object are ignored. When winter / summer mode is enabled the user can set different actuating values for summer and winter seasons in forced mode settings.</p>
<i>Forced mode</i>	Disabled Enabled	<p>This parameter is used to disable or enable the forced mode. When the function is enabled the relevant parameter will be available.</p> <p>Forced mode is used to block any telegram from the KNX bus line from changing the position of the output.</p>
<i>Valve protection</i>	Disabled Enabled	<p>This parameter is used to disable or enable valve protection function. When the function is enabled the relevant parameter will be available.</p> <p>This function prevents the valve from seizing and is executed if the valve is closed for a long time. When this function is executed, the valve is open for a short period.</p>
<i>Monitoring</i>	Disabled Enabled	<p>This parameter is used to disable or enable monitoring function. When the function is enabled the relevant parameter will be available.</p> <p>If monitoring is enabled, the heating output must receive an actuating value telegram regularly. If no new actuating value is received within a configured monitoring time, failure of the room thermostat (actuating value sender) is assumed and a configurable fixed actuating value is used.</p>
<i>Working hours counter</i>	Disabled Enabled	This parameter is used to disable or enable the working hours counter function. When the function is enabled the relevant parameter will be available.

Name	Values	Description
<i>Behavior</i>	Disabled Enabled	This parameter is used to disable or enable the behavior function. When the function is enabled the relevant parameter will be available.
<i>Joining heating pump control</i>	Disabled Enabled	<p>KNX I/O Module allows switching activation of a circulation pump of the heating circuit via a 1-bit KNX telegram. The pump is only switched on by the device via "Central Heating Pump Control" object, when at least one valve of the participated outputs is open. The pump is switched off when all participated outputs' valves are closed.</p> <p>Disabled: The related output state will not be included in the pump control function.</p> <p>Enabled: The related output state will be included in the pump control function.</p>

Table 30

8.4.3 Continuous PWM Control Settings Parameters

Name	Values	Description
<i>PWM period</i>	1...15...60 min	This parameter specifies the switching frequency of the pulse-width-modulated output signal of a valve output.
<i>Actuating value limitation</i>	Disabled Enabled	This parameter is used to enable or disable a limitation on the value received from "Actuating Value" object.
<i>Minimum actuating value</i>	0...100	Lowest permissible actuating value.
<i>Maximum actuating value</i>	0...100	Highest permissible actuating value.
<i>When received actuating value violates min/max values</i>	Use min / max values If < min use 0% / if > max use 100% If 0% use 0% else use min / max values	<p>Use min / max values: Restrict values to the set maximum and minimum actuating value.</p> <p>If < min use 0% / if > max use 100%: Actuate channel with 0% when the received value is lower than the minimum actuating value, actuate channel with 100% when the received value is higher than the maximum actuating value.</p> <p>If 0% use 0% else use min / max values: If the received actuating value is 0%, accept this value and close the valve. Other values are restricted according to the configured minimum and maximum actuating values.</p>

Table 31

8.4.4 Feedback Parameters

Name	Values	Description
<i>Send feedback telegrams</i>	Do not send, update only Send on change	“Don’t send, update only”: “Feedback” object value is updated when the used actuating value is changed but not sent to the bus. The user can read the object value to get the used actuating value. On change: The used actuating value is sent to the bus when it changes.
<i>Send feedback cyclically</i>	No Yes	This parameter enables sending the used actuating value cyclically to the bus.
<i>Feedback cycle time</i>	00:00:01 ... 00:01:00 ... 09:06:07	This parameter determines the cycle time between the repeated feedback telegrams.
<i>Limit cyclically sending count</i>	No Yes	“No”: the feedback telegrams will be sent to the bus cyclically forever. “Yes”: the feedback telegrams will be sent to the bus cyclically a certain number of times.
<i>Feedback Cycle count</i>	1... 10 ...65535	This parameter determines how many times a feedback telegram will be sent cyclically.

Table 32

8.4.5 Winter / Summer Modes Parameters

Name	Values	Description
<i>Winter / Summer polarity</i>	Winter = 0, Summer = 1 Winter = 1, Summer = 0	This parameter sets the telegram polarity of the "Winter / Summer" object.
<i>Season after bus return</i>	Winter Summer Read from bus As before bus failure	This parameter determines the selected season after bus voltage return. If “Read from bus” is selected, the device will send a read request for “Winter / Summer” object, if no response is received winter season will be selected.

Table 33

8.4.6 Forced Mode Parameters

Name	Values	Description
<i>Activate forced mode with value</i>	0 1	This parameter defines the telegram value that will enable forced mode when it received on “Forced Mode” object.

Name	Values	Description
<i>Forced mode valve state</i>	Do not change Valve is open Valve is closed	This parameter is available if "Type of control" parameter is set to "Switching (1-bit)" and "Winter / Summer Modes" parameter is set to "Disabled". It defines the valve state when forced mode is enabled.
<i>Forced mode valve state in winter</i>	Do not change Valve is open Valve is closed	This parameter is available if "Type of control" parameter is set to "Switching (1-bit)" and "Winter / Summer Modes" parameter is set to "Enabled". It defines the valve state when forced mode is enabled in winter.
<i>Forced mode valve state in summer</i>	Do not change Valve is open Valve is closed	This parameter is available if "Type of control" parameter is set to "Switching (1-bit)" and "Winter / Summer Modes" parameter is set to "Enabled". It defines the valve state when forced mode is enabled in summer.
<i>Forced mode actuating value</i>	Do not change Fixed value	This parameter is available if "Type of control" parameter is set to "Continuous PWM (1-byte)" and "Winter / Summer Modes" parameter is set to "Disabled". It defines the actuating value that will be used when forced mode is enabled. If "Fixed values" is selected another parameter will be shown to enter the actuating value.
<i>Forced mode actuating value in winter</i>	Do not change Fixed value	This parameter is available if "Type of control" parameter is set to "Continuous PWM (1-byte)" and "Winter / Summer Modes" parameter is set to "Enabled". It defines the actuating value that will be used when forced mode is enabled in winter. If "Fixed values" is selected another parameter will be shown to enter the actuating value.
<i>Forced mode actuating value in summer</i>	Do not change Fixed value	This parameter is available if "Type of control" parameter is set to "Continuous PWM (1-byte)" and "Winter / Summer Modes" parameter is set to "Enabled". It defines the actuating value that will be used when forced mode is enabled in summer. If "Fixed values" is selected another parameter will be shown to enter the actuating value.

Table 34

8.4.7 Valve Protection Parameters

Name	Values	Description
<i>Valve protection period</i>	1...7...255 day	If the valve is not opened at least once during this period, then the device will execute valve protection function and open the valve for specific time.
<i>In valve protection, valve is open for</i>	1..60 min	This parameter defines how long the valve remains open during the valve protection procedure.

Table 35

8.4.8 Monitoring Parameters

Name	Values	Description
<i>Monitoring time</i>	1...30...255 min	A monitoring failure will be detected if no new actuating value is received on "Actuating Value" object within this period. The working principle of monitoring actuating valve is shown in Figure 10.
<i>Monitoring failure value</i>	Monitoring failure = 0 Monitoring failure = 1	This parameter is used to select the polarity of monitoring failure. When monitoring failure is detected a telegram with the specified value will be sent on "Monitoring Failure" object.
<i>Valve state in case of monitoring failure</i>	Valve is closed Valve is open	This parameter is available if "Type of control" parameter is set to "Switching (1-bit)". This parameter specifies the valve state when a monitoring failure is detected.
<i>Actuating value in case of monitoring failure</i>	0...100 %	This parameter is available if "Type of control" parameter is set to "Continuous PWM (1-byte)". This parameter specifies the used actuating value when a monitoring failure is detected.

Table 36

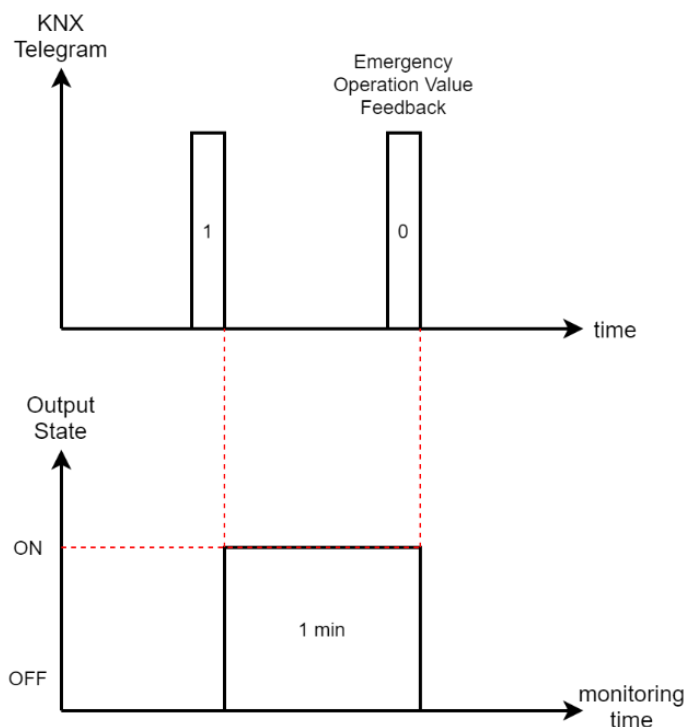


Figure 11 Working Principle of Monitoring Failure

8.4.9 Working Hours Counter Parameters

The working hours counter determines the switch-on time of an output / a valve. The totalled working hours are added in an internal meter and stored permanently in the device. The current meter reading can be transmitted cyclically to the bus by the "Working Hour Counter – Counter Value" object or when there is a

change in an interval value. An alarm telegram can be sent to the bus when the working hours count reaches a limit value in ascending counters or when it reaches 0 in descending counters.

Name	Values	Description
<i>Counting direction</i>	Decrement Increment	Decrement": the counter will be loaded with "Counter start value" at the beginning and it will count down to 0. "Increment": the counter will be loaded with 0 at the beginning and it will count up to "Counter limit value".
<i>Counter start value</i>	1... 1000 ...65535	This parameter is available if "Counting direction" parameter is set to "Decrement". It determines the value that the timer will load it at the beginning.
<i>Counter limit value</i>	1... 1000 ...65535	This parameter is available if "Counting direction" parameter is set to "Increment". It determines the value that the timer will count up to it.
<i>Counter object type</i>	4-Byte value in s(DPT 13.100) 2-Byte value in h(DPT 7.007)	This parameter defines the DPT of "Counter Value" object.
<i>Send counter value</i>	Do not send, update only When counter value is changed At specific interval Cyclically only When counter value is changed and cyclically At specific interval and cyclically	This parameter defines when the function will send the counter value to the bus. If "Do not send, update only" is selected, the user can send read request to "Counter Value" object to get the current counter value. If the counter value is set to be sent at specific interval, an additional parameter will be shown to enter the interval value. The counter value will be sent to the bus if its new value is divisible by the interval value. If the counter value is set to be sent cyclically, additional parameters will be shown to enter the cycle time.

Table 37

8.4.10 Behaviour Parameters

Name	Values	Description
<i>Valve state after ETS programming</i>	Do not change Valve is closed Valve is opened	This parameter is available if "Type of control" parameter is set to "Switching (1-bit)". Do not change: After ETS programming operation, the related valve state will be as before starting the programming operation. Off: After ETS programming operation, the related valve will be closed. On: After ETS programming operation, the related output will be open.

Name	Values	Description
<i>Actuating value after ETS programming</i>	Do not change Fixed Value	This parameter is available if “Type of control” parameter is set to “Continuous PWM (1-byte)”. Do not change: After ETS programming operation, the related valve actuating value will be as before starting the programming operation. Fixed value: After ETS programming operation, the related valve actuating value will be as specified in the next “Actuating value” parameter.
<i>Response to bus failure</i>	Do not change Valve is closed Valve is opened	Do not change: The related valve state doesn’t change after bus voltage failures. Valve is closed: After bus voltage failures, the related valve will be closed. Valve is opened: After bus voltage failures, the related valve will be open.
<i>Valve state after bus return</i>	As before bus failure Valve is closed Valve is open	This parameter is available if “Type of control” parameter is set to “Switching (1-bit)”. As before bus failure: The related valve state will be as same as the latest state before bus voltage failure. Valve is closed: After bus voltage returns, the related valve will be closed. Valve is open: After bus voltage returns, the related valve will be open.
<i>Actuating value after bus return</i>	As before bus failure Fixed value	This parameter is available if “Type of control” parameter is set to “Continuous PWM (1-byte)”. As before bus failure: The related valve actuating value will be as same as the actuating value state before bus voltage failure. Fixed value: After bus voltage returns, the related valve actuating value will be as specified in the next “Actuating value” parameter.

Table 38

8.4.11 Switching (Heating) Group Objects

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>Output x</i>	<i>Actuating Value</i>	1 Bit 1 Byte	1.001 Switch 5.001 Percentage	C		W		

Table 39

The actuating value receives data from the room thermostat for the corresponding valve. It can either be continuous (0-100%) or switching (ON/OFF) depending “Type of control” parameter value.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>Output x</i>	<i>Actuating Value Feedback</i>	1 Bit 1 Byte	1.001 Switch 5.001 Percentage	C	R		T	

Table 40

This object is available if “Feedback” parameter is set to “Enabled”. It’s used to report the current used actuating value.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>Output x</i>	<i>Winter / Summer</i>	1 Bit	1.001 Switch	C	R	W	T	U

Table 41

This object is available if “Winter / Summer modes” parameter is set to “Enabled”. It’s used to switchover between summer and winter modes. In summer mode, the valve is closed and the values received from “Actuating Value” object are ignored.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>Output x</i>	<i>Forced Mode</i>	1 Bit	1.001 Switch	C		W		

Table 42

This object is available if “Forced mode” parameter is set to “Enabled”. It’s used to enable forced mode when it receives a value as specified in “Activate forced mode with value” parameter.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>Output x</i>	<i>Monitoring Failure</i>	1 Bit	1.001 Switch	C	R		T	

Table 43

This object is available if “Monitoring” parameter is set to “Enabled”. It’s used to report the monitoring failure state. When monitoring failure is detected a telegram with value specified in “Monitoring failure value” parameter will be sent on this object.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>Output x</i>	<i>Working Hours Counter – Counter Value (Seconds)</i>	4 Bytes	13.100 Time lag (s)	C	R		T	
	<i>Working Hours Counter – Counter Value (Hours)</i>	2 Bytes	7.007 Time (h)					

Table 44

This object is available if “Working hours counter” parameter is set to “Yes”. Its value represents the reached counter value and its DPT is specified by “Counter object type” parameter.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>Output x</i>	<i>Working Hours Counter – Reset Counter</i>	1 Bit	1.015 Reset	C		W		

Table 45

This object is available if “Working hours counter” parameter is set to “Yes”. It’s used to reload the counter with its start value if “Counting direction” is “Decrement” or with 0 value if “Counting direction” is “Increment” when it receives a “Reset command = 1” telegram.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>Output x</i>	<i>Working Hours Counter - Alarm</i>	1 Bit	1.005 Alarm	C	R		T	

Table 46

This object is available if “Working hours counter” parameter is set to “Yes. It’s used to send alarm when counter value reaches 0 if “Counting direction” is “Decrement” or when the counter value reaches “Counter limit value” if “Counting direction” is “Increment”.

8.5 Shutter/Blind Parameters and Group Objects

There are two basic blind mechanisms.

- Shutter (No slats)
- Blind (With slats)

A blind (or venetian blind) has horizontal slats, one above another. They are suspended by strips of cloth called tapes, or by cords, by which all slats in unison can be rotated through nearly 180 degrees. In this drive mode, the slats are directly adjusted by way of mechanical linkage when the height of the blind is changed. The device assumes that the slats are completely closed when the blind moves downwards and similarly, the device assumes that the slats are completely open when the blind moves upwards, or vice versa. This is dependent of the blind driving type mechanism.

“*Movement duration*” parameter specifies how long the blind travels from 0% to 100%. Depending on “*Movement durations to up and down*” parameter, if it is selected as “Same” upper end position to lower end position movement and lower end position to upper end position movement are same. But if it is selected as “Different” there will be two different parameters for defining movement duration. “*Movement duration to down*” parameter is defining duration from upper end position to lower end position. “*Movement duration to down*” parameter is defining the duration from lower end position to upper end position. You can find Upper movement duration and Lower movement duration at Figure 11 and Figure 12. And slat position information at Figure 13

If the up/down object is set to “Up = 0” the blind travels upward, and if it is set to “Down = 1” the blind travels downward. While travelling, if the “Step / Stop” object is updated (“1” or “0”) the blind stops travelling.

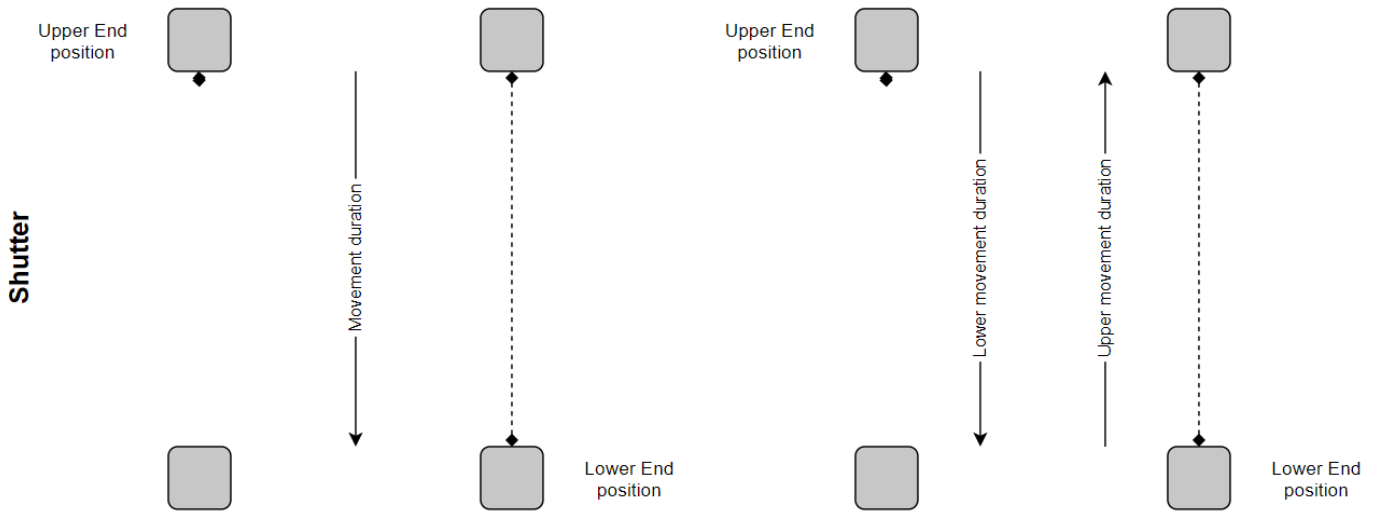


Figure 12 Shutter / Blind - Shutter Movement Duration and Position

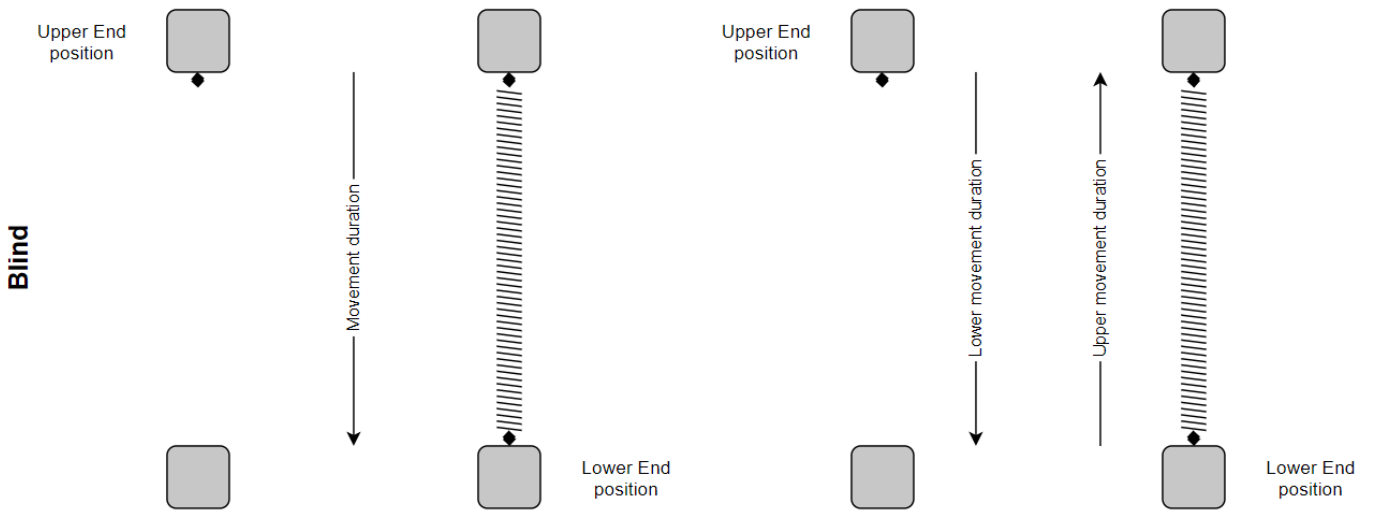


Figure 13 Shutter / Blind - Blind Movement Duration and Position

The default slat positions after up and down movements are shown in Figure 20, however these positions can be inverted with “Slat position value” parameter.

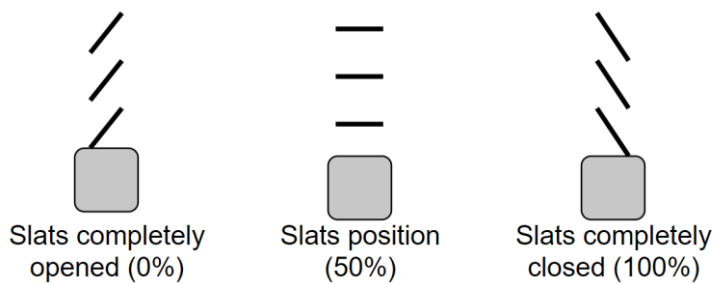


Figure 14 Shutter / Blind – Default Slat Positions

KNX I/O Module can control 230V AC Shutter/Blind and 12...48VDC Shutter/Blind.

12...48VDC Shutter/Blind uses 4 consecutive outputs and 230VAC Shutter/Blind uses 2 consecutive outputs. In this connection diagram Output1, Output2, Output3 and Output4 are used for 12...48VDC Shutter/Blind connection. Output7 and Output8 are used for 230 VAC Shutter/Blind connection.

Position control function is used for adjusting the blind height level for a percent value. For this aim “Shutter / Blind Position” object is used. A value between 0% and 100% can be sent to this object. When a percent value is sent to this object, the blind height level that the blind must reach is calculated according to the complete runtime. The percent adjustment example has been shown below (The blind is at the lower end position):

- Movement duration = 10 seconds
- The value that has been sent to “Shutter / Blind Position” object is %50
- The time that the blind must travels is 5 seconds (10 seconds / 2)

The blind or shutter updown controlling can be realized with central up/down function. The important point here is every blind or shutter outputs must be participated in central up/down function by “Join central up down” parameter. “Central Up / Down” object is used for up/down control of blind/shutter.

The blind actuator can report back via a separate 1-bit communication object per output whether the connected drive is moving. The feedback object has a value of "1" when current is flowing from the output to the drive. Likewise, a "0" is written into the object if the output concerned remains in a stop position.

8.5.1 Shutter / Blind Settings Parameters

Name	Values	Description
<i>Output name</i>		The user can give an output an optional name that describes its functionality or the connected device. This parameter value has no effect on the channel work.
<i>Use template parameters</i>	No Yes	If yes is selected the parameter values in “Template -> Shutter / Blind” page will be used for the configured output and the parameters of this output will be hidden.
<i>Operation mode</i>	Shutter (Without slats) Blind (With slats)	The device can control various drive systems. This parameter defines which type of curtain is connected to the output.
<i>Feedback</i>	Disabled Enabled	This parameter can be used to disable or enable the feedback function. When the function is enabled the relevant parameter will be available.
<i>Behaviour</i>	Disabled Enabled	This parameter can be used to disable or enable the behavior function. When the function is enabled the relevant parameter will be available.
<i>Scenes</i>	Disabled Enabled	This parameter can be used to disable or enable the scene function. When the function is enabled the relevant parameter will be available.

Name	Values	Description
<i>Joining central functions</i>	Disabled Enabled	This parameter can be used to disable or enable the central functions. When the function is enabled the relevant parameter will be available.

Table 47

8.5.2 Driving Shutter / Blind Parameters

Name	Values	Description
<i>Movement duration to up and down</i>	Same Different	Same: Upper movement duration and lower movement duration are same. Only one parameter will be shown to enter both up and down movement durations. Different: Upper movement duration and lower movement duration are different. Two parameters will be shown to enter different movement durations for each up and down movement durations.
<i>Movement duration</i>	5... 50 ...600 s	This parameter is only visible when "Movement duration to up and down" parameter is set to "Same". It defines the complete movement duration from position 0% to position 100%.
<i>Movement duration to up</i>	5... 60 ...600 s	This parameter is only visible when "Movement duration to up and down" parameter is set to "Different". It defines the complete movement duration from position 100% to position 0%.
<i>Movement duration to down</i>	5... 50 ...600 s	This parameter is only visible when "Movement duration to up and down" parameter is set to "Different". It defines the complete movement duration from position 0% to position 100%.
<i>Step time</i>	3... 20 ...200 x 100 ms	This parameter defines the duration of step (short-time) operation. Shutter actuator performs a step when it receives a step telegram while it's not moving. Blind actuator performs a height step when it receives a step telegram while it's not moving and the slat is on end position (0% or 100%).
<i>While going up, overrun output with ratio</i>	Do not overrun 2% 10% 20% 30%	To ensure that the shutter / blind has definitely reached its end position at the end of up movement, the device can extend all the up movements into the opened position using the overrun ratio configured here.
<i>While going down, overrun output with ratio</i>	Do not overrun 2% 10% 20% 30%	To ensure that the shutter / blind has definitely reached its end position at the end of down movement, the device can extend all the down movements into the opened position using the overrun ratio configured here.
<i>Time delay at change of direction</i>	Disabled Enabled	This parameter enables a delay between changes of direction.
<i>Delay before changing the direction</i>	250... 500 ...2000 ms	This parameter specifies the break time in a travel direction change.
<i>Position limitation</i>	Disabled Enabled	This parameter enables position limitation feature.

Name	Values	Description
		Note: This features only works with received telegrams on "Shutter / Blind Position" object.
<i>Lower limit</i>	0...100 %	This parameter is available if "Position limitation" parameter is set to "Enabled". The output ignores all received telegrams on "Shutter / Blind Position" object below this value.
<i>Upper limit</i>	0...100 %	This parameter is available if "Position limitation" parameter is set to "Enabled". The output ignores all received telegrams on "Shutter / Blind Position" object higher than this value.

Table 48

8.5.3 Driving Slats Parameters

Driving Slats page is visible if the "Operation mode" parameter is set to "Blind (with slats)".

Name	Values	Description
<i>Slat adjustment time</i>	3...20...200 x 100ms	The measured total duration for slat turning from 0% position to 100% position is entered here. The time must be determined as precisely as possible to achieve the best possible result for slat position.
<i>Slat step number</i>	2...12	This parameter defines the number of slat adjustments which are required to tilt the slats from fully closed to fully open. The appropriate duration for a slat adjustment is calculated from the duration of a complete slat turn and the desired number of slat adjustments.
<i>Slat position value</i>	Upper position = 0%, lower position = 100% Upper position = 100%, lower position = 0%	This parameter defines the values that will be used for slat position after up and down movements.
<i>Restore slat position after up and down movements</i>	No Yes	No: After up movement the slat will stay at the upper position and after down movement the slat will stay at the lower position. Yes: After up and down movements, the slat will return to its old position before up and down movements.

Table 49

8.5.4 Feedback Parameters

Name	Values	Description
<i>Enable "Moving Status" object</i>	No Yes	This parameter is used to enable "Moving Status" object that is used to report whether the connected drive is moving, i.e. whether the output is supplying current for any travel direction.
<i>Send feedback telegrams</i>	Do not send, update only Send on change	"Don't send, update only": feedback objects values are updated when the moving status or positions are changed but not sent to the

Name	Values	Description
		bus. The user can read the object values to get the moving status or current position. On change: The new moving status and positions are sent to the bus when they change.
<i>Send position feedbacks cyclically</i>	No Yes	This parameter enables sending the positions cyclically to the bus.
<i>Feedback cycle time</i>	00:00:01 ... 00:01:00 ... 09:06:07	This parameter determines the cycle time between the repeated feedback telegrams.
<i>Limit cyclically sending count</i>	No Yes	“No”: the feedback telegrams will be sent to the bus cyclically forever. “Yes”: the feedback telegrams will be sent to the bus cyclically a certain number of times.
<i>Feedback Cycle count</i>	1... 10 ...65535	This parameter determines how many times a feedback telegram will be sent cyclically.

Table 50

8.5.5 Behaviour Parameters

Name	Values	Description
<i>Behaviour after ETS programming</i>	No action Drive to top Drive to bottom Stop Change shutter / blind position Change slat position Change blind and slat position	This parameter defines the action that will be performed after ETS programming operation. If one of change position actions is selected more parameters will be available to enter the desired position value. Note: Change slat position options are only available if “Operation mode” parameter is set to “Blind (with slats)”.
<i>Response to bus failure</i>	No action Drive to top Drive to bottom Stop	This parameter defines the action that will be performed in case of bus voltage failure.
<i>Load old position values after bus return</i>	No Yes	This parameter is available only if “Response to bus failure” parameter is set to “Stop”. No: Before the device can approach new positions after bus voltage return, the positioning system must at first be calibrated. A position calibration is possible by executing a reference movement which is a complete movement to their upper or lower position. Yes: Since the response to bus failure action is selected “Stop”, in case of bus voltage failure the device will stop driving the shutter / blind if it’s moving and save the reached positions. After bus return the device will load the saved reached position values and no reference movement will be required.

Name	Values	Description
<i>Behavior after bus voltage return</i>	Drive to top Drive to bottom Stop Change shutter / blind position Change slat position Change blind and slat position Go to before bus failure position	This parameter defines the action that will be performed after bus voltage return. If one of change position actions is selected more parameters will be available to enter the desired position value. Note: Change slat position options are only available if "Operation mode" parameter is set to "Blind (with slats)".

Table 51

8.5.6 Weather Alarms Parameters

To protect the blind/shutter against wind, storms, rains and frost, the device can receive alarm telegrams (1 bit). If an alarm occurs, then the blind/shutter can perform a parameterized action and cannot be operated until the occurred alarm is deactivated again.

Priorities of weather alarms:

- 1- Rain alarm
- 2- Wind alarm
- 3- Frost alarm

Name	Values	Description
<i>Behavior when frost alarm starts</i>	No action Drive to top Drive to bottom Stop Change shutter / blind position Change slat position Change blind and slat position	This parameter defines the action that will be performed when frost alarm starts. The specified action is performed only when there is no other active higher priority alarm. If one of change position actions is selected more parameters will be available to enter the desired position value. Note: Change slat position options are only available if "Operation mode" parameter is set to "Blind (with slats)".
<i>Behavior when frost alarm stops</i>	No action Drive to top Drive to bottom Stop Change shutter / blind position Change slat position Change blind and slat position	This parameter defines the action that will be performed when frost alarm stops. The specified action is performed only when there is no other active higher priority alarm. If one of change position actions is selected more parameters will be available to enter the desired position value. Note: Change slat position options are only available if "Operation mode" parameter is set to "Blind (with slats)".
<i>Behavior when wind alarm starts</i>	No action Drive to top Drive to bottom Stop Change shutter / blind position Change slat position Change blind and slat position	This parameter defines the action that will be performed when wind alarm starts. The specified action is performed only when there is no other active higher priority alarm. If one of change position actions is selected more parameters will be available to enter the desired position value. Note: Change slat position options are only available if "Operation mode" parameter is set to "Blind (with slats)".

Name	Values	Description
<i>Behavior when wind alarm stops</i>	No action Drive to top Drive to bottom Stop Change shutter / blind position Change slat position Change blind and slat position	This parameter defines the action that will be performed when wind alarm stops. The specified action is performed only when there is no other active higher priority alarm. If one of change position actions is selected more parameters will be available to enter the desired position value. Note: Change slat position options are only available if "Operation mode" parameter is set to "Blind (with slats)".
<i>Behavior when rain alarm starts</i>	No action Drive to top Drive to bottom Stop Change shutter / blind position Change slat position Change blind and slat position	This parameter defines the action that will be performed when rain alarm starts. If one of change position actions is selected more parameters will be available to enter the desired position value. Note: Change slat position options are only available if "Operation mode" parameter is set to "Blind (with slats)".
<i>Behavior when rain alarm stops</i>	No action Drive to top Drive to bottom Stop Change shutter / blind position Change slat position Change blind and slat position	This parameter defines the action that will be performed when rain alarm stops. The specified action is performed only when there is no other alarm active. If one of change position actions is selected more parameters will be available to enter the desired position value. Note: Change slat position options are only available if "Operation mode" parameter is set to "Blind (with slats)".

Table 52

8.5.7 Scenes Parameters

Name	Values	Description
<i>Scene x is assigned to</i>	Not assigned Scene number 1..64	This parameter defines the scene number that will trigger the scene function to perform the specified action.
<i>Action</i>	No action Drive to top Drive to bottom Stop Change shutter / blind position Change slat position Change blind and slat position	This parameter defines the action that will be performed when the specified scene number is recalled. If one of change position actions is selected more parameters will be available to enter the desired position value. Note: Change slat position options are only available if "Operation mode" parameter is set to "Blind (with slats)".
<i>Storage function</i>	Disabled Enabled	This parameter is only available if "Action" parameter is set to change shutter, blind, slat or both blind and slat positions. By storing a scene (sending learn telegram to "Scene Input" object), the user has the opportunity to change the parameterized positions stored in ETS.

Name	Values	Description
<i>Delay</i>	0...255 s	This parameter is used for setting the duration of the scene delay time. If its value is between 1...255, the received recall scene commands will be delayed before execution.

Table 53

8.5.8 Joining Central Functions Parameters

Name	Values	Description
<i>Join central up down</i>	No Yes	No: The output will ignore telegrams sent to "Central Up / Down – Up / Down" object. Yes: The output will participate in central up down according to telegrams sent to "Central Up / Down – Up / Down" object. In central up down, the behaviour of the outputs is identical with 'normal' activation via the "Up / Down" object. If "Central Up / Down – Up / Down" object is set to "Up = 0", the outputs which are participated to central up down goes up and if it is set to "Down = 0" the participated outputs goes down.
<i>Join central position</i>	No Yes	Yes: The output will participate in central up down according to telegrams sent to "Central Position – Shutter / Blind Position" object. In central position, the behaviour of the outputs is identical with 'normal' activation via the "Central Position – Shutter / Blind Position" object. When "Central Position – Shutter / Blind Position" object receives a position value, the outputs which are participated to central position goes to that position.

Table 54

8.5.9 Shutter / Blind Group Objects

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>Output x</i>	<i>Up / Down</i>	1 Bit	1.001 Switch	C		W		

Table 55

If a telegram with the value (Up = 0) is received at this object, the blind/shutter is moved upwards to the upper end position. If a telegram with the value (Down = 1) is received, the blind/shutter is moved downwards.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>Output x</i>	<i>Step / Stop</i>	1 Bit	1.001 Switch	C		W		

Table 56

When a telegram is received at this object the device acts as below:

- If the shutter/ blind is moving, it stops.

- If the shutter / blind is not moving:
 - 1- If the operation mode is set to “Shutter (without slats)”, it goes for one shutter / blind step to the direction specified with the received telegram (Up = 0, Down = 1)
 - 2- If the operation mode is set to “Blind (with slats)” and the slats are not at the end positions (0% or 100%), it performs a slat movement to the nearest slat step with the direction specified with the received telegram (Up = 0, Down = 1).
 - 3- If the operation mode is set to “Blind (with slats)” and the slats are at the end positions (0% or 100%), it goes for one shutter / blind step to the direction specified with the received telegram (Up = 0, Down = 1)

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>Output x</i>	<i>Shutter / Blind Position</i>	1 Byte	5.001 Percentage	C		W		

Table 57

This object is used to raise/lower the shutter/blind to a certain position (height). The received values are expressed in %. 0% = upper end position and 100% = lower end position.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>Output x</i>	<i>Shutter / Blind Position Feedback</i>	1 Byte	5.001 Percentage	C	R		T	

Table 58

This object is available if “Feedback” parameter is set to “Enabled”. It’s used to send the current positioned height of the blind/shutter to the bus. The current position is sent after completion of a movement.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>Output x</i>	<i>Slat Position</i>	1 Byte	5.001 Percentage	C		W		

Table 59

This object is available if “Operating mode” parameter is set to “Blind (with slats)”. This object is used to change the slat position to a certain position (height). The received values are expressed in %.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>Output x</i>	<i>Slat Position Feedback</i>	1 Byte	5.001 Percentage	C	R		T	

Table 60

This object is available if “Operating mode” parameter is set to “Blind (with slats)” and “Feedback” parameter is set to “Enabled”. It’s used to send the current positioned slat of the blind to the bus. The current position is sent after completion of a movement.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>Output x</i>	<i>Moving Status</i>	1 Bit	1.010 Start / Stop	C	R		T	

Table 61

This object is available if “Enable “Moving Status” object” parameter is set to “Yes”. It’s used to report that the connected drive is active, i.e. the output is supplying power to the drive for a travel direction.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>Output x</i>	<i>Frost Alarm</i> <i>Wind Alarm</i> <i>Rain Alarm</i>	1 Bit	1.005 Alarm	C		W		U

Table 62

These objects are available if “Weather Alarms” parameter is set to “Enabled”. They are used to activate or deactivate a weather alarm.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>Output x</i>	<i>Scene Input</i>	1 Byte	18.001 Scene Control	C		W		

Table 63

This object is available if “Scenes” parameter is set to “Yes”. It’s used to recall (activate) or save (learn) a scene.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>Output x</i>	<i>Reset Stored Scenes</i>	1 Bit	1.015 Reset	C		W		

Table 64

This object is available if “Scenes” parameter is set to “Yes”. It’s used to reload the stored positions of scenes with its original parameter values.

8.6 Fan Coil Parameters and Group Objects

Fan coil system refers to the water distribution system serving the in a building. There are two types fan coil systems. The 2 pipes system consists of a single water source connected to two pipes as supply and return, and valve that can function as cold water (CW) or hot water(HW) depending on the mode of the system. This type of fan coil cannot work in cooling and heating mode at the same time. The operation of 2 pipes system is demonstrated in Figure 14.

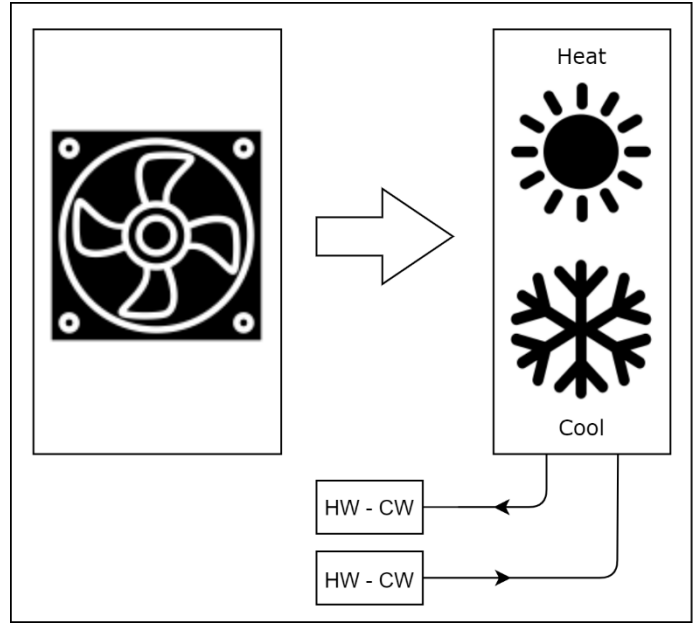


Figure 15 2 Pipes Fan Coil System

The 4 pipe system consists of two separate cold water (CW) and hot water (HW) sources. Each source has its own set of pipes and valves for supply and return. The operation of 4 pipes system is demonstrated in **Hata! Başvuru kaynağı bulunamadı..**

In both systems, low-noise fans are used to support air circulation and to move the air of the room through the heat exchangers. The fan speed is controllable up to 6 levels.

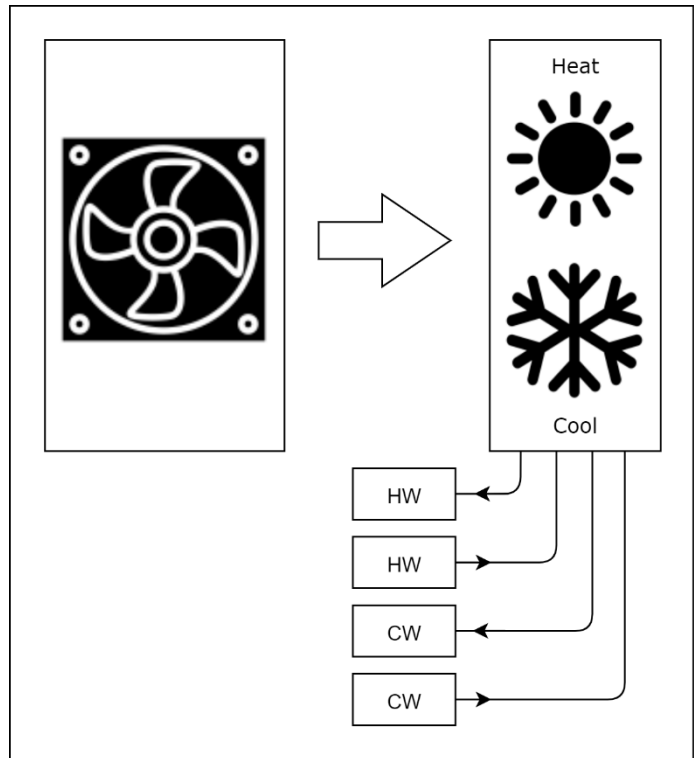


Figure 16 4 Pipes Fan Coil System

8.6.1 Priorities for Actuating Values in Fan Coil Outputs

The fan coil actuator distinguishes between various functions that can have an effect on the output. In order to prevent conflicting states, each available function has a certain priority. The function with the higher priority overrides the one with the lower priority.

Taking into account all possible functions, the following priorities are defined:

1. Manual control
2. Forced mode
3. Valve protection
4. Monitoring failure
5. Actuating values from behavior functions or from “Actuating Value” objects.

8.6.2 Priorities for Fan Level in Fan Coil Outputs

For fan level, the following priorities are defined:

1. Manual control
2. Forced mode
3. Fan protection
4. Manual fan control
5. Monitoring failure
6. Fan level from behavior functions or from “Actuating Value” objects.

8.6.3 Fan Coil Settings Parameters

Name	Values	Description
<i>Output name</i>		The user can give an output an optional name that describes its functionality or the connected device. This parameter value has no effect on the channel work.
<i>Use template parameters</i>	No Yes	This parameter is available if the number of pipes and fan levels of the fan coil template are equal to the number of pipes and fan levels of the output. If yes is selected the parameter values in “Template -> Fan Coil” page will be used for the configured output and the parameters of this output will be hidden.
<i>Supported fan coil system</i>	Cooling Heating Cooling and Heating	This parameter determines in what modes of operation (heating or cooling) the output works. Note: If output type is “Fan coil (4-pipe)”, “Cooling and Heating” is selected by default.
<i>Manual fan control</i>	Disabled Enabled	This parameter can be used to disable or enable the manual fan control function. When the function is enabled the relevant page will be available.

Name	Values	Description
<i>Feedback</i>	Disabled Enabled	This parameter can be used to disable or enable the feedback function. When the function is enabled the relevant page will be available.
<i>Forced mode</i>	Disabled Enabled	This parameter can be used to disable or enable the forced mode. When the function is enabled the relevant page will be available.
<i>Protection</i>	Disabled Enabled	This parameter can be used to disable or enable the protection function. When the function is enabled the relevant page will be available.
<i>Monitoring</i>	Disabled Enabled	This parameter can be used to disable or enable the monitoring function. When the function is enabled the relevant page will be available.
<i>Behaviour</i>	Disabled Enabled	This parameter can be used to disable or enable the behavior function. When the function is enabled the relevant parameter will be available.

Table 65

8.6.4 Valve Settings Parameters

Name	Values	Description
<i>Valve state when output's contact are closed</i>	Open Closed	This parameter is used to determine the operation mode of the controlled valve. Open: The valve is open when it's energized. Closed: The valve is closed when it's energized.
<i>Type of control</i>	Switching (1-byte) Continuous PWM (1-byte)	The heating output receives 1-byte command value telegrams transmitted, for example, by KNX room temperature controllers. Usually, the room temperature controller determines the room temperature and generates the command value telegrams using a control algorithm. The device controls its valve outputs either in switching form or with a PWM signal. Switching (1-byte): the telegram received via "Actuating Value" object is used directly in controlling the output. If a telegram with value greater than 0% is received the valve is opened, and if 0% telegram is received the valve is closed. Continuous PWM (1-byte): the telegram received via "Actuating Value" object is used to generate pulse-width-modulated switch signal at the valve output according to the following set parameters.
<i>PWM period</i>	1... 15 ...60 min	This parameter specifies the switching frequency of the pulse-width-modulated output signal of a valve output.
<i>Actuating value limitation</i>	Disabled Enabled	This parameter is used to enable or disable a limitation on the value received from "Actuating Value" object.
<i>Minimum actuating value</i>	0...100	Lowest permissible actuating value.
<i>Maximum actuating value</i>	0... 100	Highest permissible actuating value.

Name	Values	Description
<i>When received actuating value violates min/max values</i>	Use min / max values If < min use 0% / if > max use 100% If 0% use 0% else use min / max values	Use min / max values: Restrict values to the set maximum and minimum actuating value. If < min use 0% / if > max use 100%: Actuate channel with 0% when the received value is lower than the minimum actuating value, actuate channel with 100% when the received value is higher than the maximum actuating value. If 0% use 0% else use min / max values: If the received actuating value is 0%, accept this value and close the valve. Other values are restricted according to the configured minimum and maximum actuating values.
<i>Time for closing the valve</i>	00:00...15:00 mm:ss	This parameter is available if "Supported fan coil system" parameter is set to "Cooling and heating". In addition to the "Delay between heating and cooling" time, the output will wait this amount of time before switching to another mode.
<i>Delay between heating and cooling</i>	00:00...30:00 mm:ss	Delay when changing from heating to cooling or from cooling to heating after the valve of the current mode is completely closed. The valve of the new mode can only be opened after this time has elapsed.

Table 66

8.6.5 Fan Settings Parameters

Name	Values	Description
<i>Number of fan levels</i>	1 level 2 levels 3 levels 4 levels 5 levels 6 levels	This parameter shows the set parameter in "Enable Outputs" page that specifies the number of levels (steps) of the controlled fan in the fan coil system.
<i>Fan control type</i>	Individually Hierarchically	In standard commercially available fan coil units, there are two ways to control the fan levels. Individually: only one level output can be switched on, all other levels must switch off. Hierarchically: the fan level outputs switch one after another, lower levels remain switched on, higher levels switched off. The operation of these ways are shown in Table 68 and Table 69.
<i>Fan level 1 threshold</i>	1...100 %	This parameter sets the lower limit of fan level 1.
<i>Fan level 2 threshold</i>	1...20...100 %	This parameter is only available if the number of fan levels of the fan coil output is set to "2 levels" or higher. This parameter sets the lower limit of fan level 2.

Name	Values	Description
<i>Fan level 3 threshold</i>	1... 40 ...100 %	This parameter is only available if the number of fan levels of the fan coil output is set to "3 levels" or higher. This parameter sets the lower limit of fan level 3.
<i>Fan level 4 threshold</i>	1... 60 ...100 %	This parameter is only available if the number of fan levels of the fan coil output is set to "4 levels" or higher. This parameter sets the lower limit of fan level 4.
<i>Fan level 5 threshold</i>	1... 80 ...100 %	This parameter is only available if the number of fan levels of the fan coil output is set to "5 levels" or higher. This parameter sets the lower limit of fan level 5.
<i>Fan level 6 threshold</i>	1... 95 ...100 %	This parameter is only available if the number of fan levels of the fan coil output is set to "6 levels". This parameter sets the lower limit of fan level 6.
<i>Hysteresis</i>	0 ...30 %	A fan level is only deactivated when the active actuating value reaches or falls below the threshold of the level less the hysteresis. In the same way, a fan level is only activated when the active actuating value reaches or passes the threshold of the fan level plus the hysteresis.

Table 67

Active Fan Level	Fan 1 Output	Fan 2 Output	Fan 3 Output
None (switched off)	OFF	OFF	OFF
Fan Level 1	ON	OFF	OFF
Fan Level 2	OFF	ON	OFF
Fan Level 3	OFF	OFF	ON

Table 68

Active Fan Level	Fan 1 Output	Fan 2 Output	Fan 3 Output
None (switched off)	OFF	OFF	OFF
Fan Level 1	ON	OFF	OFF
Fan Level 2	ON	ON	OFF
Fan Level 3	ON	ON	ON

Table 69

8.6.6 Fan Behavior Parameters

Name	Values	Description
<i>Minimum time to stay within a fan step</i>	00:00 ...15:00 mm:ss	This parameter specifies how short the time intervals for switching the fan levels can be, i.e. the limit to how quickly the fan speed can be varied.

Name	Values	Description
<i>Pause time</i>	0...30 x100 ms	This parameter determines how long the fan will remain in off state before a fan level is switched on during the fan level changing process.
<i>Fan switch on delay</i>	00:00...15:00 mm:ss	When the fan is switched off and a new actuating value higher than level 1 threshold is received, the fan will switch on only after this time. This can be used to prevent blowing unheated or uncooled air to the room.
<i>Fan switch off delay</i>	00:00...15:00 mm:ss	When the fan is switched on and a new actuating value lower than level 1 threshold is received, the fan will switch off only after this time. This can be used to prevent the freezing of the cooling register at the end of a cooling process, or overheating the heating register at the end of a heating process.

Table 70

8.6.7 Manual Fan Control Page

Name	Values	Description
<i>Fan auto-manual object value</i>	On = auto, off = manual Off = auto, on = manual	This parameter determines the values that will active auto and manual modes when it received on "Fan Auto-Manual Switchover".
<i>Fan level change over in manual control via</i>	1-bit objects 1-byte object (0-255) 1-byte object (0%-100%)	This parameter determines the datapoint type of the manual fan level object(s) used to switch between fan levels in manual mode.

Table 71

8.6.8 Feedback Page

Name	Values	Description
<i>Fan coil feedback object indicates</i>	Operating mode is active / inactive Valve is open / closed	Operating mode is active / inactive: mode feedback object indicates if its mode is the current mode and the operated actuating value is higher than 0%. Valve is open / closed: valve feedback object indicates if its valve is closed or open (Closed = 0, Open = 1).
<i>Fan level feedback via</i>	1-bit objects 1-byte object (0-255) 1-byte object (0%-100%)	This parameter determines the datapoint type of the fan level feedback object(s) used to report the current fan level.
<i>Send feedback telegrams</i>	Do not send, update only Send on change	"Don't send, update only": feedback objects values are updated when fan level and mode/valve state are changed but not sent to the

Name	Values	Description
		bus. The user can read the object values to get the current fan level or mode/valve state. On change: The new fan level and mode/valve state are sent to the bus when they change.
<i>Send fan feedbacks cyclically</i>	No Yes	This parameter enables sending the fan level cyclically to the bus.
<i>Feedback cycle time</i>	00:00:01 ... 00:01:00 ... 09:06:07	This parameter determines the cycle time between the repeated feedback telegrams.
<i>Limit cyclically sending count</i>	No Yes	“No”: the feedback telegrams will be sent to the bus cyclically forever. “Yes”: the feedback telegrams will be sent to the bus cyclically a certain number of times.
<i>Feedback Cycle count</i>	1... 10 ...65535	This parameter determines how many times a feedback telegram will be sent cyclically.

Table 72

8.6.9 Forced Mode

Name	Values	Description
<i>Activate forced mode with value</i>	0 1	This parameter defines the telegram value that will enable forced mode when it received on “Forced Mode” object.
<i>Reaction at the beginning of the forced mode</i>	No reaction Close all valves and switch off the fan Specific state	No reaction: The current valve position and fan level at the beginning of forced mode is adopted with no changes. Close all valves and switch off the fan: All outputs are switched off. Fan switch on and off delay times remain valid. Specific state: At the beginning of forced mode the outputs will be operated as specified in the following parameters.
<i>Operating mode</i>	Do not change Cooling Heating	This parameter is available if “Supported fan coil system” parameter is set to “Cooling and heating”. It specifies the operating mode in forced mode.

Name	Values	Description
<i>Actuating value</i>	Do not change Close the valve Open the valve Operate with fixed actuating value	<p>Do not change: The used actuating value before enabling the forced mode will be used after enabling it.</p> <p>Close the valve: If valve control type is switching (1-byte), the valve is closed in forced mode. If valve control type is continuous PWM (1-byte) the valve is actuated with 0% value.</p> <p>Open the valve: If valve control type is switching (1-byte), the valve is opened in forced mode. If valve control type is continuous PWM (1-byte) the valve is actuated with 100% value.</p> <p>Operate with fixed actuating value: This parameter should be selected only when "Type of valve control" parameter is set to "continuous PWM (1-byte)". If selected, the valve will be operated with actuating value specified in a following parameter.</p>
<i>Fan level</i>	Do not change Fan is switched off Level 1 Level 2 Level 3 Level 4 Level 5 Level 6	<p>If "Do not change" is selected, the used fan level before enabling the forced mode will be used after enabling it, else the fan will be operated with the specified level.</p> <p>Note: Selection of fan level is limited by the configured number of fan numbers.</p>

Table 73

8.6.10 Protection Parameters

Name	Values	Description
<i>Valve protection</i>	Disabled Enabled	This parameter is used to enabled valve protection function.
<i>Valve protection period</i>	1...7...255 day	If a valve is not opened at least once during this period, then the device will execute valve protection function and open the valve for specific time.
<i>In valve protection, valve is open for</i>	1..60 min	This parameter defines how long the valve remains open during the valve protection procedure.
<i>Fan protection</i>	Disabled Enabled	This parameter is used to enabled fan protection function.
<i>Fan protection period</i>	1...7...255 day	If the fan is not switched on at least once during this period, then the device will execute fan protection function and switch on the fan at the highest level for specific time.
<i>In valve protection, valve is open for</i>	1..60 min	This parameter defines how long the fan remains switched on at highest level during the fan protection procedure.

Table 74

8.6.11 Monitoring Parameters

Name	Values	Description
<i>Monitoring time</i>	1...30...255 min	A monitoring failure will be detected if no new actuating value is received on actuating value object of the current mode within this period.
<i>Monitoring failure value</i>	Monitoring failure = 0 Monitoring failure = 1	This parameter is used to select the polarity of monitoring failure. When monitoring failure is detected a telegram with the specified value will be sent on "Monitoring Failure" object.
<i>Reaction at the beginning of the monitoring failure</i>	No reaction Close all valves and switch off the fan Specific state	No reaction: The current valve position and fan level at the beginning of monitoring failure is adopted with no changes. Close all valves and switch off the fan: All outputs are switched off. Fan switch on and off delay times remain valid. Specific state: At the beginning of monitoring failure the outputs will be operated as specified in the following parameters.
<i>Operating mode</i>	Do not change Cooling Heating	This parameter is available if "Supported fan coil system" parameter is set to "Cooling and heating". It specifies the operating mode in monitoring failure.
<i>Actuating value</i>	Do not change Close the valve Open the valve Operate with fixed actuating value	Do not change: The used actuating value before detecting the monitoring failure will be used after detecting it. Close the valve: If valve control type is switching (1-byte), the valve is closed during monitoring failure. If valve control type is continuous PWM (1-byte) the valve is actuated with 0% value. Open the valve: If valve control type is switching (1-byte), the valve is opened during monitoring failure. If valve control type is continuous PWM (1-byte) the valve is actuated with 100% value. Operate with fixed actuating value: This parameter should be selected only when "Type of valve control" parameter is set to "continuous PWM (1-byte)". If selected, the valve will be operated with actuating value specified in a following parameter.
<i>Fan level</i>	Do not change Fan is switched off Level 1 Level 2 Level 3 Level 4 Level 5 Level 6	If "Do not change" is selected, the used fan level before detecting the monitoring failure will be used after detecting it, else the fan will be operated with the specified level. Note: Selection of fan level is limited by the configured number of fan numbers.

Table 75

8.6.12 Behaviour Parameters

Name	Values	Description
<i>Behaviour after ETS programming</i>	Close all valves and switch off the fan	This parameter indicates that after ETS programming operation all outputs will be switched off.
<i>Response to bus failure</i>	No reaction Close all valves and switch off the fan Specific state	No reaction: The valve state and fan level will not be changed in case of bus failure. Close all valves and switch off the fan: All outputs are switched off. Fan switch on and off delay times, minimum time to stay within a fan step are not valid. Specific state: In case of bus failure the outputs state will be as specified in the following parameters.
<i>Valve state</i>	Do not change Close the valve Open the valve	This parameter determines the valve state in case of bus failure. Note: Open the valve option is only available for 2-pipe systems.
<i>Fan level</i>	Do not change Fan is switched off Level 1 Level 2 Level 3 Level 4 Level 5 Level 6	If “Do not change” is selected, the used fan level before detecting the bus failure will be used after detecting it, else the fan will be switched to the specified level. Note: Selection of fan level is limited by the configured number of fan numbers.
<i>Behaviour after bus return</i>	No reaction Close all valves and switch off the fan Specific state	No reaction: The valve state and fan level will not be changed in case of bus voltage return. Close all valves and switch off the fan: All outputs are switched off. Fan switch on and off delay times, minimum time to stay within a fan step are valid. Specific state: In case of bus voltage return the outputs will be operated as specified in the following parameters.
<i>Operating mode</i>	As before bus failure Cooling Heating	This parameter is available if “Supported fan coil system” parameter is set to “Cooling and heating”. It specifies the operating mode after bus return.
<i>Actuating value</i>	As before bus failure Close the valve Open the valve Operate with fixed actuating value	Do not change: The used actuating value before detecting the bus failure will be used after restoring it. Close the valve: If valve control type is switching (1-byte), the valve is after bus return. If valve control type is continuous PWM (1-byte) the valve is actuated with 0% value. Open the valve: If valve control type is switching (1-byte), the valve is opened after bus return. If valve control type is continuous PWM (1-byte) the valve is actuated with 100% value. Operate with fixed actuating value: This parameter should be selected only when “Type of valve control” parameter is set to “continuous PWM (1-byte)”. If selected, the valve will be operated with actuating value specified in a following parameter.

Name	Values	Description
<i>Fan level</i>	Do not change Fan is switched off Level 1 Level 2 Level 3 Level 4 Level 5 Level 6	If “Do not change” is selected, the used fan level before detecting the bus failure will be used after restoring it, else the fan will be operated with the specified level. Note: Selection of fan level is limited by the configured number of fan numbers.
<i>Send read request to switchover object at startup</i>	No Yes	If “Yes” is selected, the device will transmit a read request (ValueRead) to the group address of switchover object at startup to specify a valid mode of operation.
<i>Delay before sending read request to switchover object</i>	0...10...255 s	The device waits this time before sending read request (ValueRead) to the group address of switchover object at startup.

Table 76

8.6.13 Fan Coil Group Objects

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>Output x</i>	<i>Switchover</i>	1 Bit	1.100 Cooling / Heating	C		W	T	U

Table 77

This object is only available if “Supported system type” is set to “Cooling and heating”. It’s a 1-bit object for mode of operation switchover.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>Output x</i>	<i>Cooling Actuating Value</i> <i>Heating Actuating Value</i>	1 Byte	5.001 Percentage	C		W		

Table 78

A mode actuating value object is available if the mode is supported as specified in “Supported fan coil system” parameter. The actuating value receives data from the room thermostat for the corresponding valve.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>Output x</i>	<i>Cooling Mode Feedback Active / Inactive</i> <i>Heating Mode Feedback Active/ Inactive</i>	1 Bit	1.001 Switch	C	R		T	

Table 79

This object is available if “Feedback” parameter is set to “Enabled and “Fan coil feedback objects” parameter is set to “Operating mode is active / inactive”. It’s used to report the current used actuating value. Mode feedback object indicates if its mode is the current mode and the operated actuating value is higher than 0%.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>Output x</i>	<i>Cooling Valve Feedback Open / Close</i> <i>Heating Valve Feedback Open / Close</i> <i>Cooling and Heating Valve Feedback Open / Close</i>	1 Bit	1.001 Switch	C	R		T	

Table 80

This object is available if “Feedback” parameter is set to “Enabled” and “Fan coil feedback objects” parameter is set to “Valve is open close”. It’s used to report the state of the valve (Open = 1, Close = 0).

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>Output x</i>	<i>Fan Auto-Manual Switchover</i>	1 Bit	1.001 Switch	C		W		

Table 81

1-bit object for activating and deactivating manual fan control when it receives a telegram according to “Fan auto-manual object value” parameter.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>Output x</i>	<i>Manual Fan Level</i>	1 Byte	5.100 Fan stage	C		W		

Table 82

This object is available if “Manual fan control” parameter is set to “Enabled” and “Fan level change over in manual control via” parameter is set to “1-byte object (0-255)”.

It’s used for direct specification of the fan level in manual fan control. The maximum value is limited by the number of configured fan levels. Values greater than the maximum fan level are interpreted by the device like the maximum value.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>Output x</i>	<i>Manual Fan Level</i>	1 Byte	5.001 Percentage	C		W		

Table 83

This object is available if “Manual fan control” parameter is set to “Enabled” and “Fan level change over in manual control via” parameter is set to “1-byte object (0%-100%)”.

It’s used for direct specification of the fan level in manual fan control. A fan level is activated if this object receives a value higher than the related level threshold value that is specified in “Fan Settings” page.

Note: Hysteresis is not applicable in manual fan control.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>Output x</i>	<i>Manual Fan Level x</i>	1 Bit	1.001 Switch	C		W		

Table 84

These objects are available if “Manual fan control” parameter is set to “Enabled” and “Fan level change over in manual control via” parameter is set to “1-bit objects”.

Sending “ON” value to one of these objects while manual fan control is active activates the related fan level. Sending “OFF” value to the current active fan level object while manual fan control is active switches off the fan.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>Output x</i>	<i>Fan Level Feedback</i>	1 Byte	5.100 Fan stage	C	R		T	

Table 85

This object is available if “Feedback” parameter is set to “Enabled and “Fan level feedback via” parameter is set to “1-byte object (0-255)”.

It’s used to report the current active fan level.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>Output x</i>	<i>Fan Level Feedback</i>	1 Byte	5.100 Fan stage	C	R		T	

Table 86

This object is available if “Feedback” parameter is set to “Enabled and “Fan level feedback via” parameter is set to “1-byte object (0%-100%)”.

It’s used to report the current active fan level by sending its threshold (set in page “Fan Settings”) to the bus.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>Output x</i>	<i>Fan Level x Feedback</i>	1 Bit	1.001 Switch	C	R		T	

Table 87

These objects are available if “Feedback” parameter is set to “Enabled and “Fan level feedback via” parameter is set to “1-bit objects”.

Each object reports its level state active (ON = fan level is active, OFF = Fan level is not active). If all objects’ values are OFF then the fan is switched off.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>Output x</i>	<i>Forced Mode</i>	1 Bit	1.001 Switch	C		W		

Table 88

This object is available if “Forced mode” parameter is set to “Enabled”. It’s used to enable forced mode when it receives a value as specified in “Activate forced mode with value” parameter.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>Output x</i>	<i>Monitoring Failure</i>	1 Bit	1.001 Switch	C	R		T	

Table 89

This object is available if “Monitoring” parameter is set to “Enabled”. It’s used to report the monitoring failure state. When monitoring failure is detected a telegram with value specified in “Monitoring failure value” parameter will be sent on this object.

9 Inputs

9.1 Input Types

In KNX-IO Modules there are two types of inputs:

- Dry-contact inputs/Feedback Leds
A dry-contact input detects whether or not an input switch is open or closed. KNX-IO modules have 22 x dry-contact inputs/Feedback LED.
- 10-230V AC/DC inputs
These inputs are suitable to read 10-230V AC/DC signals. KNX-IO Module has 2 x 10-230V AC/DC inputs.

To be able to use an input, the user should enable it in ETS by checking the related checkbox in “Enable Inputs” page.

9.2 Block Diagrams

9.2.1 Block Diagram of Physical Input Signal

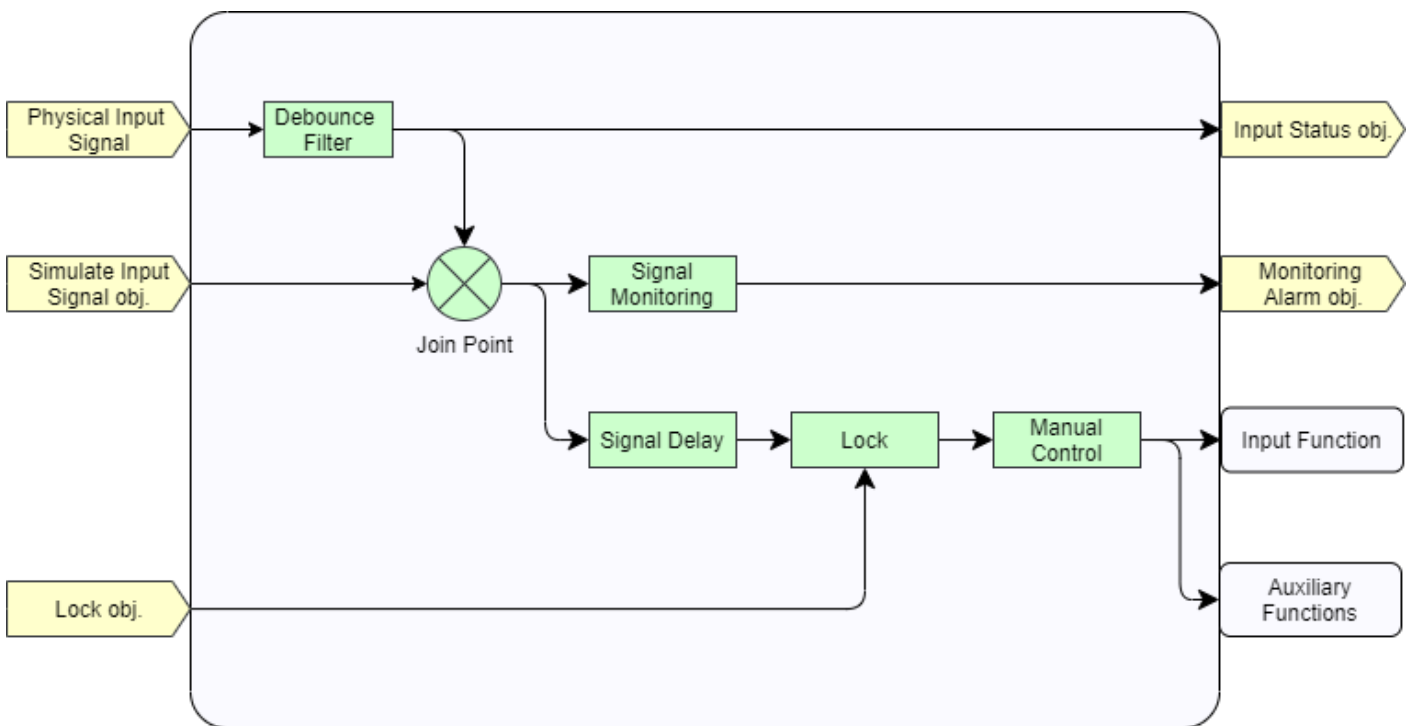


Figure 17 Block Diagram of Physical Input Signal

In the join point the last changed signal is dominant. For example, if a telegram is received from simulate input object its value is presented on the join point. Thereafter, if the physical input status is changed its signal is presented on the join point.

If a block (function) in the diagram is not enabled, the signal passes through it.

The manual control has a higher priority over the other functions. In manual control mode the input status is transmitted to input function and auxiliary functions without any delay even if the lock is enabled.

9.3 Status LEDs Behavior

By default, signal status LED turns on when the contact is closed for dry-contact inputs, and when a 10-230V signal is applied on the input terminals for 10-230V AC/DC inputs. However, this behavior can be changed with parameters.

In ETS, the user can disable an input’s LED or invert its behavior. Furthermore, with “Power saving mode for LEDs” parameter the status LEDs can be turned off automatically to save power. The user can exit power saving mode and see the status of the inputs by pressing any manual operation button.

In manual control mode, the disabled LEDs will be enabled but the inverted LEDs will stay inverted. So when the user press [SET] button to simulate the presence of a signal on an input which its LED is inverted, the LED will be turned off.

If the application program is unloaded, the status LEDs are enabled and run as described in the default behavior.

The input status signals that are used in controlling status LEDs are obtained from the output of the debounce filter (See Figure 16). Status LEDs are not affected with lock or signal delay functions.

9.4 Input General Parameters and Objects

9.4.1 Input General Parameters

Name	Values	Description
<i>Input name</i>		The user can give an input an optional name that describes its functionality or the connected device. For example, Window contact sensor, Presence sensor, Blinds upper push button. This parameter value has no effect on the channel work.
<i>Connected device type</i>	Switch / Sensor Push button Card holder Feedback LED	This parameter is used to determine the connected device to the input terminal in order to show the appropriate parameters in “Function” page.
<i>Push button operating mode</i>	Button pressed = closed contact, button released = open contact. Button pressed = open contact, button released = closed contact. <hr/> Button pressed = rising edge, button released = falling edge. Button pressed = falling edge, button released = rising edge.	This parameter is shown only for dry-contact and 10-230V AC/DC inputs if “Connected device type” parameter is set to “Push button”. With this parameter, the operating mode of the connected push button can be selected.

<i>Card holder operating mode</i>	<p>Card inserted = closed contact, card removed = open contact. Card inserted = open contact, card removed = closed contact.</p> <hr/> <p>Card inserted = rising edge, card removed = falling edge. Card inserted = falling edge, card removed = rising edge.</p>	<p>This parameter is shown only for dry-contact and 10-230V AC/DC inputs if “Connected device type” parameter is set to “Card holder”.</p> <p>With this parameter, the operating mode of the connected card holder can be selected.</p>
<i>Feedback LED operating mode</i>		This parameter is shown only for Feedback LED if “Connected device type” parameter is set to “Feedback LED”.
<i>Led Configuration</i>	<p>Always On Always Off According to object value</p>	<p>This parameter is shown only for Feedback LED.</p> <p>If “Always On” / “Always Off” is selected, the device will show / not show the Feedback LED status when INs button is activated.</p> <p>“According to object value” is used to enable “Feedback LED” object.</p>
<i>Object Polarity</i>	<p>0=Off 1=On 1=Off 0=On</p>	This parameter shows Feedback LED object polarity.
<i>Behaviour after bus voltage recovery</i>	<p>On Off As before bus failure</p>	This parameter determines the status of the Feedback LED after bus voltage recovery.
<i>Debounce time</i>	<p>20 ms 30 ms 40 ms 50 ms 75 ms 100 ms 150 ms 250 ms 500 ms 750 ms 1000 ms</p>	<p>This parameter is shown only for dry-contact and 10-230V AC/DC inputs.</p> <p>When a mechanical switch is switched it bounces between in-contact and not in-contact states for several milliseconds. Without a debounce filter the device will recognize this behavior as multiple switching events not a single one.</p> <p>With this parameter, the user can define the debounce time of the debounce filter that is used to prevent the bouncing effect. An input signal will be taken into account only if it persists on the terminal for more than the debounce time without interruption.</p>
<i>LED</i>	<p>Disabled Enabled Inverted</p>	<p>This parameter is shown only for dry-contact and 10-230V AC/DC inputs.</p> <p>If “Enabled” / “Disabled” is selected, the device will show / not show the input status with its status LED.</p> <p>If “Inverted” is selected the device will show the input status inverted on its status LED.</p>
<i>Enroll in manual control</i>	<p>No Yes</p>	<p>This parameter is shown only for dry-contact and 10-230V AC/DC inputs.</p> <p>If “No” is selected, the user will not be able to control or override the input state in manual control mode.</p> <p>If “Yes” is selected, the user will be able to control or override the input state in manual control mode.</p>
<i>Enable “Simulate Input Signal” object</i>	<p>No Yes</p>	This parameter is shown only for dry-contact and 10-230V AC/DC inputs.

		It is used to enable / disable "Simulate Input Signal" object.
Enable "Input Status" object	No Yes	This parameter is shown only for dry-contact and 10-230V AC/DC inputs. It is used to enable / disable "Input Status" object.
Send input status	Do not sent, update only On change	"Don't send, update only": "Input Status" object value is updated when the input status is changed but not sent to the bus. The user can read the object value or send a telegram to "Request Status Values" object to get the input status. On change: The new input status is sent to the bus when the input status is changed.
Enable signal delay	No Yes	If "Yes" is selected, the specified signal in "Delay at" parameter will be sent to the input function after a delay time. If an input reverts back to its previous state before the delay expires, nothing will be sent to the input function. For example, this function can be used with presence sensors to send off telegrams only when they have not detected motion in the room for a certain period of time. If a sensor detects a motion before the period expires, off telegram will not be sent. Also, this function can be used with card holders to send off telegrams not after removing the card immediately but after a specific time. If the card is inserted again before the period expires, off telegram will not be sent.
Delay at	Open contact signal Closed contact signal Both signals <hr/> Falling edge signal Rising edge signal Both signals <hr/> Off signal On signal Both signals <hr/> Button released signal Button pressed signal Both signals <hr/> Card removed signal Card inserted signal Both signals	This parameter determines which signals will be delayed. Different options will be available according to the input type and the selected "Connected device type".
<u>Open contact signal delay unit</u> <u>Falling edge signal delay unit</u> <u>Off signal delay unit</u> <u>Button released signal delay unit</u> <u>Card removed signal delay unit</u>	Second Minute Hour Day	This parameter determines the unit of the delay time for the specified signal.
<u>Open contact signal delay value</u> <u>Falling edge signal delay value</u> <u>Off signal delay value</u> <u>Button released signal delay value</u> <u>Card removed signal delay value</u>	1... 30 ...255	This parameter determines the value of the delay time for the specified signal.

<u>Closed contact signal delay unit</u> <u>Rising edge signal delay unit</u> <u>On signal delay unit</u> <u>Button pressed signal delay unit</u> <u>Card inserted signal delay unit</u>	Second Minute Hour Day	This parameter determines the unit of the delay time for the specified signal.
<u>Closed contact signal delay value</u> <u>Rising edge signal delay value</u> <u>On signal delay value</u> <u>Button pressed signal delay value</u> <u>Card inserted signal delay value</u>	1...5...255	This parameter determines the value of the delay time for the specified signal.
<i>Enable signal monitoring</i>	No Yes	<p>This parameter enables the monitoring function and shows “Monitoring Alarm” object of the input.</p> <p>Monitoring function monitors the input signal and sends alarm telegram when it does not detect a new signal similar to the one specified in “Reset monitoring timer at” parameter within the monitoring time.</p> <p>When monitoring function detects a new signal similar to the one specified in “Reset monitoring timer at” parameter, it resets the monitoring timer and sends no alarm telegram if an alarm telegram was sent before.</p> <p>In case of bus voltage return, the function continues monitoring the signal with the elapsed time and alarm state of the function before the bus failure.</p>
<i>Reset monitoring time at</i>	Open contact signal Closed contact signal Both signals <hr/> Falling edge signal Rising edge signal Both signals <hr/> Off signal On signal Both signals <hr/> Button released signal Button pressed signal Both signals <hr/> Card removed signal Card inserted signal Both signals	<p>This parameter determines the signal that will reset the monitoring timer when it’s newly detected by the monitoring function.</p> <p>Different options will be available according to the input type and the selected “Connected device type”.</p>
<i>Monitoring time unit</i>	Second Minute Hour Day	This parameter determines the unit of the timer of the monitoring function.
<i>Monitoring time value</i>	1...255	This parameter determines the value of the timer of the monitoring function.
<i>Enable lock</i>	No Yes	This function enables “Lock” object that is used to lock the input signal.
<i>Lock status after bus return</i>	Disabled Enabled Read from bus As before bus failure	This parameter determines the status of the input’s lock function after bus voltage return.

		If “Read from bus” is selected, the device will send a read request for the lock object of the input, if no response is received the input signal will be unlocked.
--	--	---

Table 90

9.4.2 Input General Group Objects

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>Input Number (Type)</i>	<i>Simulate Input Signal</i>	1 Bit	1.001 Switch	C		W		

Table 91

This object is available if “Enable Simulate Input Signal object” parameter is set to “Yes”.

It is used to simulate the same signals that can be caused with the physical connected input devices such as contact open/closed signals, falling/rising edge signals etc.

According to the input type and the connected device type, the received on/off telegrams are translated to signals as below:

Input type	Connected device type	Off telegram is translated to	On telegram is translated to
Dry-contact	Switch / Sensor	Open contact signal	Closed contact signal
10-230V AC/DC	Switch / Sensor	Falling edge signal	Rising edge signal
X	Push button	Button released signal	Button pressed signal
X	Card holder	Card removed signal	Card inserted signal
X	Feedback LED		

Table 92

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>Input Number (Type)</i>	<i>Status</i>	1 Bit	1.001 Switch	C	R		T	

Table 93

This object is available for dry-contact and 10-230V AC/DC inputs only if “Enable input status object” parameter is set to “Yes”.

This object indicates the status of the input signals. The input signals are translated to on/off telegrams as below:

Input type	Connected device type	Off telegrams indicate	On telegrams indicate
Dry-contact	Switch / Sensor	Open contact signals	Closed contact signals
10-230V AC/DC	Switch / Sensor	Falling edge signals	Rising edge signals

X	Push button	Button released signals	Button pressed signals
X	Card holder	Card removed signals	Card inserted signals
X	Feedback LED		

Table 94

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>Input Number (Type)</i>	<i>Monitoring Alarm</i>	1 Bit	1.005 Alarm	C	R		T	

Table 95

This object is available if “Enable signal monitoring” parameter is set to “Yes”. It’s used to send the status of the monitoring function’s alarm.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>Input Number (Type)</i>	<i>Lock</i>	1 Bit	1.001 Switch	C	R	W	T	U

Table 96

This object is available if “Enable lock” parameter is set to “Yes”.

If “Enable” telegram is received the input signal will be locked to the current signal and no new signals will be transmitted to the input function and the auxiliary functions.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>Feedback LED Number</i>	<i>Feedback LED</i>	1 Bit	1.001 Switch	C		W		

Table 97

This object is available if “Led Configuration” parameter is set to “According to object value”. It’s used to send the status of the Feedback LED.

9.5 Input Function Parameters and Objects

9.5.1 Function Parameters of Switches Sensors and Card Holders

The input function has 3 objects. The DPT of each object can be selected from 17 types. Also, each object can be configured to send or not send telegrams when a new signal is detected.

Name	Values	Description
<i>Block input function at start-up for specific time</i>	No Yes	If “Yes” is selected, the input function will start evaluating the input signals after specific time from the start-up. If “No” is selected, the input function will evaluate the input signal immediately after the start-up.

<i>Blocking time unit</i>	Second Minute Hour Day	This parameter the unit of the blocking time.
<i>Blocking time value</i>	1... 3 ...255	This parameter the value of the blocking time.
<i>Scan input after unlock or bus return</i>	No Yes	<p>If “Yes” is selected, the input signal will be scanned when the lock is disabled or when the bus voltage returns. Then according to the scanned signal and the value of the other parameters, the function objects will send proper telegrams.</p> <p>If “No” is selected, the function objects will not send telegrams when the lock is disabled or when the bus voltage returns.</p>
<i>Enable sending telegrams cyclically</i>	No Yes	If “Yes” is selected, the user will be able to set some telegrams to be sent cyclically to the bus.
<i>Cycle time unit</i>	Second Minute Hour Day	This parameter defines the unit of the time period between the repeated KNX telegrams
<i>Cycle time value</i>	1...255	This parameter defines the value of the time period between the repeated KNX telegrams
Object x		
<i>Object type</i>	Not used 1-bit switch 1-bit up/down 1-bit step 1-bit trigger 2-bit priority 4-bit dimming control Scene number 1-byte percentage 1-byte unsigned value 1-byte signed value HVAC mode 2-byte unsigned value 2-byte signed value 2-byte float 4-byte unsigned value 4-byte signed value 4-byte float	This parameter determines the DPT of object x.
<i>When Y event occurs Send telegram</i>	No Yes	<p>This parameter determines whether a telegram will be sent when the mentioned event is occurred.</p> <p>If “Yes” is selected, one or two parameters will be displayed to enter the telegram value that will be sent.</p> <p>Notes: When “Toggle”, “Up – Down” or “Decrease – Increase / Step up – Step down” is selected as telegram value, the object value will be inverted and sent to the bus. For example, an off telegram will be sent if the object value is on when Y event occurs.</p> <p>When “Decrease – Increase” is selected as the dimming direction of a 4-bit dimming control object, the dimming direction of the object will be inverted and sent to the bus.</p>

<i>Send cyclically</i>	No Yes	This parameter is available if “Enable sending telegrams cyclically” parameter is set to “Yes”. It determines if the telegram will be sent cyclically to the bus with cycle time periods when Y event occurs.
------------------------	------------------	--

Table 98

9.5.2 Function Parameters of Push Buttons

Name	Values	Description
<i>Block input function at start-up for specific time</i>	No Yes	If “Yes” is selected, the input function will start evaluating the input signals after specific time from the start-up. If “No” is selected, the input function will evaluate the input signal immediately after the start-up.
<i>Blocking time unit</i>	Second Minute Hour Day	This parameter the unit of the blocking time.
<i>Blocking time value</i>	1... 3 ...255	This parameter the value of the blocking time.
<i>Push button function</i>	Switching control Dimming control Blind up/down control Scene Send value	This parameter determines the task of the button. For example, if the button is intended to be used to switch lights on/off , “Switching control” should be selected.
<i>Configuration type</i>	Simple Advanced	If “Simple” is selected, simple parameters will be shown to configure the push button function. If “Advanced” is selected, the user will be able to select push button events, use up to 3 objects and determine telegram values at each event.
Switching Control Simple Parameters		
<i>When button is pressed</i>	Do not send telegram Send off Send on Toggle	This parameter determines what the function should send to “Object 1 – Switch” when the connected button is pressed. If “Toggle” is selected the object value is inverted and sent.
<i>When button is released</i>	Do not send telegram Send off Send on Toggle	This parameter determines what the function should send to “Object 1 – Switch” when the connected button is released. If “Toggle” is selected the object value is inverted and sent.
Dimming Control Simple Parameters		
<i>Reaction to short / long keystroke</i>	On / Brighter Toggle / Brighter Off / Darker Toggle / Darker Toggle / Brighter - Darker	This parameter determines the telegram values for “Object 1 – Switch” that will be sent when the button is short pressed, and the telegram values for “Object 2 – Dimming Control” that will be sent when the long press starts. When the long press ends, a break telegram will be sent to stop the dimming operation for all options.

		<p>“Toggle / Brighter – Darker” should be selected when the dimmer will be controlled with single push button. With each long press, the push button will dim the lights brighter and darker alternatively.</p> <p>The other options can be selected if the dimmer will be controlled with two push buttons (two inputs). One button will dim the lights brighter and another one will dim them darker.</p>
<i>Long press time</i>	300 ms 400 ms 500 ms 600 ms 700 ms 800 ms 900 ms 1 s 2 s 3 s 4 s 5 s 6 s 7 s 8 s 9 s 10 s	A button will be considered long pressed if it is pressed for more than the specified time. If it is pressed less than the specified period, it will be considered short pressed.
Blind Up / Down Control Simple parameters		
<i>Movement direction</i>	Up Down Up - Down	<p>This parameter determines the telegram values for “Object 1 – Up/Down” that will be sent when the button is long pressed, and the telegram values for “Object 2 – Step/Stop” that will be sent when the button is short pressed.</p> <p>“Up - Down” should be selected when the blinds will be controlled with single push button. With each long press, the push button will change the movement direction up and down alternatively. If the button is short pressed, a step with a direction opposite to the last sent up down telegram will be sent.</p> <p>The other options can be selected if the blinds will be controlled with two push buttons (two inputs). One button will move the blinds up and another one will move them down. With each long press, the specified direction will be sent to “Object 1 – Up/Down”. With each short press, a step with the specified direction will be sent to “Object 2 – Step/Stop”.</p>
<i>Stop movement with</i>	Release the button Short keystroke	<p>“Release the button”: The blinds will stop moving when the button is released after a long press.</p> <p>“Short keystroke”: The blinds will not stop moving when the button is released after a long press, but it will stop with a following short press.</p>
<i>Long press time</i>	300 ms 400 ms 500 ms 600 ms 700 ms 800 ms 900 ms 1 s 2 s	A button will be considered long pressed if it is pressed for more than the specified time. If it is pressed less than the specified period, it will be considered short pressed.

	3 s 4 s 5 s 6 s 7 s 8 s 9 s 10 s	
Scene Simple Parameters		
<i>Scene number</i>	1...64	This parameter determines which scene number will be sent to "Object 1 – Scene" when the button is pressed.
<i>Save scene after long press</i>	No Yes	If "Yes" is selected, A learn scene telegram will be sent to the bus when the button is long pressed.
<i>Long press time</i>	300 ms 400 ms 500 ms 600 ms 700 ms 800 ms 900 ms 1 s 2 s 3 s 4 s 5 s 6 s 7 s 8 s 9 s 10 s	A button will be considered long pressed if it is pressed for more than the specified time. If it is pressed less than the specified period, it will be considered short pressed.
Send Value Simple Parameters		
<i>Send value with</i>	Button pressed, button released Short press, long press	<p>This parameter determines which push button events will be used to send telegram values to "Object 1". The DPT of "Object 1" can be selected with "Object type" parameter. For each event, the user can select whether a telegram will be sent or not and determine its value.</p> <p>If "Button pressed, button released" is selected, the user can send telegrams at the next events: "When button is pressed" and "When button is released".</p> <p>If "Short press, Long press" is selected, the user can send telegrams at the next events: "When button is short pressed", "When long press is started" and "When button is released after long press".</p> <p>In both cases, the used can send specific telegram value when the lock is enabled if "Enable lock" parameter is set to "Yes".</p>
<i>Long press time</i>	300 ms 400 ms 500 ms 600 ms 700 ms 800 ms 900 ms 1 s 2 s	<p>This parameter is visible if "Send value with" parameter is set to "Short press, long press".</p> <p>A button will be considered long pressed if it is pressed for more than the specified time. If it is pressed less than the specified period, it will be considered short pressed.</p>

	<p>3 s 4 s 5 s 6 s 7 s 8 s 9 s 10 s</p>	
<p>Push Button Advanced Configuration</p> <p>In advanced configurations, the user is able to select push button events, use up to 3 objects and determine telegram values at each event. Furthermore, the user can send some telegrams cyclically.</p> <p>Also, in advanced configuration, the DPT of some objects are pre-configured according to the selected push button function as below:</p> <ul style="list-style-type: none"> • Switching control: Object 1 type = 1-bit switch. • Dimming control: Object 1 type = 1-bit switch, Object 2 type = 4-bit dimming control. • Blind up/down control: Object 1 type = 1-bit up/down, Object 2 type = 1-bit step. • Scene: Object 1 type = Scene number. • Send value: No object DPT is pre-configured. 		
<p><i>Push button events</i></p>	<p>Button pressed – released Short – long press Single – double press Single – double – triple press Single – double – triple – quadruple press</p>	<p>This parameter determines which push button events will be used to send telegram values to “Object 1”, “Object 2” and “Object 3”.</p> <p>If “Button pressed - button released” is selected, the user can send telegrams at the next events: “When button is pressed” and “When button is released”.</p> <p>If “Short - long press” is selected, the user can send telegrams at the next events: “When button is short pressed”, “When long press is started” and “When button is released after long press”.</p> <p>If “Single – double press” is selected, the user can send telegrams at the next events: “When button is single pressed”, “When double press is started” and “When button is released after double press”.</p> <p>If “Single – double – triple press” is selected, the user can send telegrams at the next events: “When button is single pressed”, “When button is double pressed”, “When triple press is started” and “When button is released after triple press”.</p> <p>If “Single – double – triple – quadruple press” is selected, the user can send telegrams at the next events: “When button is single pressed”, “When button is double pressed”, “When button is triple pressed” and “When button is quadruple pressed”.</p> <p>In all cases, the user can send specific telegram value when the lock is enabled if “Enable lock” parameter is set to “Yes”.</p>
<p><i>Long press time</i></p>	<p>300 ms 400 ms 500 ms 600 ms 700 ms 800 ms 900 ms 1 s 2 s 3 s 4 s 5 s 6 s</p>	<p>This parameter is available if “Push button events” parameter is set to “Short – long press”.</p> <p>A button will be considered long pressed if it is pressed for more than the specified time. If it is pressed less than the specified period, it will be considered short pressed.</p>

	7 s 8 s 9 s 10 s	
<i>Maximum time between two press</i>	300 ms 400 ms 500 ms 600 ms 700 ms 800 ms 900 ms 1 s 2 s 3 s 4 s 5 s 6 s 7 s 8 s 9 s 10 s	<p>This parameter is available if “Push button events” parameter is set to “Single – double press”, “Single – double – triple press” or “Single – double – triple – quadruple press”.</p> <p>It determines the time between sequential presses to consider the button is multiple pressed.</p> <p>For example, if this parameter is set to “500 ms” and the elapsed time between two presses is equal or less than 500 ms they are considered a double press, else they are considered as two single presses.</p>
<i>Enable sending telegrams cyclically</i>	No Yes	If “Yes” is selected, the user will be able to set some telegrams to be sent cyclically to the bus.
<i>Cycle time unit</i>	Second Minute Hour Day	This parameter defines the unit of the time period between the repeated KNX telegrams
<i>Cycle time value</i>	1...255	This parameter defines the value of the time period between the repeated KNX telegrams
Object x		
<i>Object type</i>	Not used 1-bit switch 1-bit up/down 1-bit step 1-bit trigger 2-bit priority 4-bit dimming control Scene number 1-byte percentage 1-byte unsigned value 1-byte signed value HVAC mode 2-byte unsigned value 2-byte signed value 2-byte float 4-byte unsigned value 4-byte signed value 4-byte float	This parameter determines the DPT of object x.
<i>When Y event occurs Send telegram</i>	No Yes	<p>This parameter determines whether a telegram will be sent when the mentioned event is occurred.</p> <p>If “Yes” is selected, one or two parameters will be displayed to enter the telegram value that will be sent.</p> <p>Notes:</p>

		<p>When “Toggle”, “Up – Down” or “Decrease – Increase / Step up – Step down” is selected as telegram value, the object value will be inverted and sent to the bus. For example, an off telegram will be sent if the object value is on when Y event occurs.</p> <p>When “Decrease – Increase” is selected as the dimming direction of a 4-bit dimming control object, the dimming direction of the object will be inverted and sent to the bus.</p>
<i>Send cyclically</i>	No Yes	<p>This parameter is available if “Enable sending telegrams cyclically” parameter is set to “Yes”.</p> <p>This parameter determines if the telegram will be sent cyclically to the bus with cycle time periods when Y event occurs.</p>

Table 99

9.5.3 Function Group Objects

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>Input Number (Type)</i>	<i>Object x – Switch</i>	1 Bit	1.001 Switch	C	R	W	T	
	<i>Object x – Up/Down</i>	1 Bit	1.008 Up / Down	C	R	W	T	
	<i>Object x – Step/Stop</i>	1 Bit	1.007 Step	C	R	W	T	
	<i>Object x – Trigger</i>	1 Bit	1.017 Trigger	C	R	W	T	
	<i>Object x – Priority</i>	2 Bits	2.001 Switch Control	C	R		T	
	<i>Object x – Dimming Control</i>	4 Bits	3.007 Dimming Control	C	R	W	T	
	<i>Object x – Scene</i>	1 Byte	18.001 Scene Control	C	R		T	
	<i>Object x – Percentage</i>	1 Byte	5.001 Percentage	C	R		T	
	<i>Object x – 1-Byte Unsigned Value</i>	1 Byte	5.010 Counter pulses	C	R		T	
	<i>Object x – 1-Byte Signed Value</i>	1 Byte	6.010 Counter pulses	C	R		T	
	<i>Object x – HVAC Mode</i>	1 Byte	20.102 HVAC mode	C	R		T	
	<i>Object x – 2-Byte Unsigned Value</i>	2 Bytes	7.001 Pulses	C	R		T	
	<i>Object x – 2-Byte Signed Value</i>	2 Bytes	8.001 Pulses Difference	C	R		T	
	<i>Object x – 2-Byte Float Value</i>	2 Bytes	9.001 Temperature	C	R		T	
	<i>Object x – 4-Byte Unsigned Value</i>	4 Bytes	12.001 Counter Pulses (Unsigned)	C	R		T	
	<i>Object x – 4-Byte Signed Value</i>	4 Bytes	13.001 Counter Pulses (Signed)	C	R		T	
<i>Object x – 4-Byte Float Value</i>	4 Bytes	14.000 Acceleration	C	R		T		

Table 100

Input function can have up to 3 objects. The DPT of these objects is determined with “Object type” parameters or “Push button function” parameter.

In advanced configuration of push button parameters, the DPT of some objects are pre-configured according to the selected push button function as below:

- Switching control: Object 1 type = 1-bit switch.
- Dimming control: Object 1 type = 1-bit switch, Object 2 type = 4-bit dimming control.
- Blind up/down control: Object 1 type = 1-bit up/down, Object 2 type = 1-bit step.
- Scene: Object 1 type = Scene number.
- Send value: No object DPT is pre-configured.

10 Auxiliary Functions

KNX I/O Module have 24 independent auxiliary functions. The user can choose their types from “Auxiliary Functions (v2.0)” page. Many complex configurations and creative scenarios can be done with these functions

There are 14 types of auxiliary functions:

1. Converter
2. Filter
3. General counter
4. Logic gate
5. Max/Min/Average value calculator
6. Monitor
7. Presence detector controller
8. Scene actuator
9. Send after delay
10. Send after reset
11. Send cyclically
12. Sequencer
13. Staircase controller
14. Working time counter

Each type has its own objects and parameters and all types have lock feature.

10.1 Converter

The converter function is used to convert data point types and/or telegram values.

There are 11 converter types:

User customized: The user specifies the input and the output object types, the comparison statement (greater than, equal to, between, etc...) for the input value, and the output values for the comparison result.

8 x 1-bit => 1 x 1-byte: Combines 8 1-bit objects into one 1-byte object

1 x 1-byte => 8 x 1-bit: separates a 1-byte object to 8 1-bit objects

2 x 1-byte => 1 x 2-byte: Combines 2 1-byte objects into one 2-byte object

1 x 2-byte => 2 x 1-byte: separates a 2-byte object to 2 1-byte objects

4 x 1-byte => 1 x 4-byte: Combines 4 1-byte objects into one 4-byte object

1 x 4-byte => 4 x 1-byte: separates a 4-byte object to 4 1-byte objects

2 x 2-byte => 1 x 4-byte: Combines 2 2-byte objects into one 4-byte object

1 x 4-byte => 2 x 2-byte: separates a 4-byte object to 2 2-byte objects

1 x 2-byte float => 1 x 4-byte float: Converts DPT9 float values to IEEE 754 float values.

1 x 4-byte float => 1 x 2-byte float: Converts IEEE 754 float values to DPT9 float values.

For all converter types, the converter can be bidirectional (converts the telegrams in two directions).

Warning: because of the 2-byte float values encoding method, converting 4-byte float values to 2-byte float values becomes less accurate with large values (larger than 100.0).

10.1.1 Converter Parameters

Name	Values	Description
<i>Auxiliary function name</i>		<p>The user can give the auxiliary function a name for documentation purposes.</p> <p>This parameter value has no effect on the function work.</p>
<i>Converter type</i>	<p>User customized 8 x 1-bit => 1 x 1-byte 1 x 1-byte => 8 x 1-bit 2 x 1-byte => 1 x 2-byte 1 x 2-byte => 2 x 1-byte 4 x 1-byte => 1 x 4-byte 1 x 4-byte => 4 x 1-byte 2 x 2-byte => 1 x 4-byte 1 x 4-byte => 2 x 2-byte 1 x 2-byte float => 1 x 4-byte float 1 x 4-byte float => 1 x 2-byte float</p>	<p>This parameter defines the type of the converter.</p> <p>In user customized converters, the DPT of the input and the output objects, the converting conditions and the output values can be specified by the user. This type is used to convert KNX telegrams to another types and values.</p> <p>The other converter types are used to convert telegrams to another types only. Its values are not changed.</p>
<i>Bidirectional</i>	<p>No Yes</p>	<p>The bidirectional converter converts the telegrams in two directions. From X terminal object\s to Y terminal object\s and from Y terminal object\s to X terminal object\s.</p> <p>If “Yes” is selected, “Send output value after delay” and “Send output value cyclically” parameters cannot be used.</p>
<i>User customized converter parameters</i>		
<i>X/Y terminal object type</i>	<p>1-bit switch 1-bit up/down 1-bit step 1-bit trigger 2-bit priority 4-bit dimming control Scene number 1-byte percentage 1-byte unsigned value 1-byte signed value HVAC mode 2-byte unsigned value 2-byte signed value 2-byte float 4-byte unsigned value 4-byte signed value 4-byte float</p>	<p>This parameter defines the DPT of the terminal object.</p> <p>If the converter is not bidirectional, X terminal is the input and Y terminal is the output, else both terminals can be operated as input and output.</p>
<i>If received X/Y terminal object value is</i>	<p>Equal to Unequal to Lower than Equal or lower than Greater than Equal or greater than</p>	<p>This parameter defines the condition of the converter. one or two additional parameters will be visible to enter the test values of the condition.</p>

	Between Not between Above or below threshold	If the terminal object type is "1-bit", "2-bit", "4-bit", "Scene number" or "HVAC mode", only two conditions can be chosen, "Equal to" and "Unequal to".
<i>Then send to Y/X terminal</i>		This parameter defines the telegram value to be sent when the condition is met.
<i>Else</i>	Don't send telegram Send telegram	This parameter defines the behavior of the converter when the condition is not met. If "Send telegram" is selected, a parameter will be visible to define the telegram value to be sent when the condition is not met.
<i>Send telegram when</i>	New telegram is received Terminal object value changes	If "New telegram is received" is selected, the converter sends telegrams to a terminal every time it receives new telegrams from the other terminal. If "Terminal object value changes" is selected, the converter sends telegrams to a terminal only when its object value is changed.
<i>Send output value after delay</i>	No Yes	This parameter enables a delay before sending the output value.
<i>Delay time unit</i>	Second Minute Hour Day	This parameter defines the unit of the delay time before the output value is sent.
<i>Delay time value</i>	1...255	This parameter defines the value of the delay time before the output value is sent.
<i>Send output cyclically</i>	No Yes	This parameter enables sending the output value cyclically to the bus.
<i>Cycle time unit</i>	Second Minute Hour Day	This parameter defines the unit of the time period between the repeated output telegrams.
<i>Cycle time value</i>	1...255	This parameter defines the value of the time period between the repeated output telegrams.
<i>Converter behavior after bus return</i>	Wait for new telegrams Read X terminal objects Read Y terminal objects	This parameter defines the converter behavior after bus voltage return. If "Wait for new telegrams" is selected, no action will be taken. If "Read X/Y terminal objects" is selected, the converter will send read request for the terminal objects to the bus after bus return. Note: To be able to read terminal objects from the bus, the terminal should be an input terminal.
<i>Enable lock</i>	No Yes	This function enables "Lock" object that is used to lock the auxiliary function.
<i>Lock status after bus return</i>	Unlocked Locked Read from bus As before bus failure	This parameter determines the status of the function's lock after bus voltage return. If "Read from bus" is selected, the device will send a read request for the lock object of the function, if no response is received the function will be unlocked.

Table 101

10.1.2 Converter Group Objects

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
AF n	<i>Converter - X Terminal - Input</i> <i>Converter - X Terminal – Input / Output</i>	1 Bit	1.001 Switch					
		1 Bit	1.008 Up / Down					
		1 Bit	1.007 Step					
		1 Bit	1.017 Trigger					
		2 Bits	2.001 Switch Control					
		4 Bits	3.007 Dimming Control					
		1 Byte	18.001 Scene Control					
		1 Byte	5.001 Percentage					
		1 Byte	5.010 Counter pulses	C		W	T	U
		1 Byte	6.010 Counter pulses	C	R	W	T	U
		1 Byte	20.102 HVAC mode					
		2 Bytes	7.001 Pulses					
		2 Bytes	8.001 Pulses Difference					
		2 Bytes	9.001 Temperature					
		4 Bytes	12.001 Counter Pulses (Unsigned)					
4 Bytes	13.001 Counter Pulses (Signed)							
4 Bytes	14.000 Acceleration							

Table 102

This object is available if the converter type is “User customized”.

If the converter is bidirectional X terminal is used as an input and an output for the converter, else it is used as an input only.

This object DPT is determined by “X terminal object type” parameter.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
AF n	<i>Converter - X Terminal – 1-Byte (LSB) - Input</i>	1 Byte	5.010 Counter pulses	C		W	T	U
	<i>Converter - X Terminal – 1-Byte (LSB) - Output</i>			C	R	W	T	U
	<i>Converter - X Terminal – 1-Byte (LSB) – Input / Output</i>			C	R	W	T	U
	<i>Converter - X Terminal – 1-Byte (MSB) – Input</i>			C		W	T	U
	<i>Converter - X Terminal – 1-Byte (MSB) - Output</i>			C	R	W	T	U
	<i>Converter - X Terminal – 1-Byte (MSB) – Input / Output</i>			C	R	W	T	U
	<i>Converter - X Terminal – 1-Byte (Byte i) – Input</i>			C		W	T	U
	<i>Converter - X Terminal – 1-Byte (Byte i) - Output</i>			C	R	W	T	U
	<i>Converter - X Terminal – 1-Byte (Byte i) – Input / Output</i>			C	R	W	T	U

Table 103

These objects are available if the converter type is “2 x 1-byte => 1 x 2-byte”, “1 x 2-byte => 2 x 1-byte”, “4 x 1-byte => 1 x 4-byte” or “1 x 4-byte => 4 x 1-byte”.

LSB objects represents the least significant byte of the terminal. MSB objects represents the most significant byte of the terminal.

If the converter type is 2 x 1-byte => 1 x 2-byte” or “4 x 1-byte => 1 x 4-byte”, X terminal is used as an input terminal.

If the converter type is “1 x 2-byte => 2 x 1-byte” or “1 x 4-byte => 4 x 1-byte”, X terminal is used as an output terminal.

If the converter is bidirectional, X terminal is used as an input and output terminal.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
AF n	Converter - X Terminal - 2-Byte (LSB) - Input	2 Byte	7.001 Pulses	C		W	T	U
	Converter - X Terminal - 2-Byte (LSB) - Output			C	R	W	T	U
	Converter - X Terminal - 2-Byte (LSB) - Input / Output			C	R	W	T	U
	Converter - X Terminal - 2-Byte (MSB) - Input			C		W	T	U
	Converter - X Terminal - 2-Byte (MSB) - Output			C	R	W	T	U
	Converter - X Terminal - 2-Byte (MSB) - Input / Output			C	R	W	T	U

Table 104

These objects are available if the converter type is “2 x 2-byte => 1 x 4-byte” or “1 x 4-byte => 2 x 2-byte”. LSB objects represents the least significant bytes of the terminal. MSB objects represents the most significant bytes of the terminal.

If the converter type is “2 x 2-byte => 1 x 4-byte”, X terminal is used as an input terminal.

If the converter type is “1 x 4-byte => 2 x 2-byte”, X terminal is used as an output terminal.

If the converter is bidirectional, X terminal is used as an input and output terminal.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
AF n	Converter - X Terminal - 2-Byte (Float) - Input	2 Byte	9.001 Temperature	C		W	T	U
	Converter - X Terminal - 2-Byte (Float) - Output			C	R	W	T	U
	Converter - X Terminal - 2-Byte (Float) - Input / Output			C	R	W	T	U

Table 105

These objects are available if the converter type is “1 x 2-byte float=> 1 x 4-byte float” or “1 x 4-byte float=> 1 x 2-byte float”.

If the converter type is “2 x 2-byte float=> 1 x 4-byte float”, X terminal is used as an input terminal.

If the converter type is “1 x 4-byte float=> 1 x 2-byte float”, X terminal is used as an output terminal.

If the converter is bidirectional, X terminal is used as an input and output terminal.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
AF n	Converter - X Terminal - Bit i - Input	1 Bit	1.001 Switch	C		W	T	U
	Converter - X Terminal - Bit i - Output			C	R	W	T	U
	Converter - X Terminal - Bit i - Input / Output			C	R	W	T	U

Table 106

These objects are available if the converter type is “8 x 1-bit => 1 x 1-byte” or “1 x 1-byte => 8 x 1-bit”.

Each object represents the i-th bit of the terminal.

If the converter type is “8 x 1-bit => 1 x 1-byte”, X terminal is used as an input terminal.

If the converter type is “1 x 1-byte => 8 x 1-bit”, X terminal is used as an output terminal.

If the converter is bidirectional, X terminal is used as an input and output terminal.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
AF n	Converter - Y Terminal - Output Converter - Y Terminal - Input / Output	1 Bit	1.001 Switch	C	R	W	T	U
		1 Bit	1.008 Up / Down					
		1 Bit	1.007 Step					
		1 Bit	1.017 Trigger					
		2 Bits	2.001 Switch Control					
		4 Bits	3.007 Dimming Control					

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
		1 Byte	18.001 Scene Control					
		1 Byte	5.001 Percentage					
		1 Byte	5.010 Counter pulses					
		1 Byte	6.010 Counter pulses					
		1 Byte	20.102 HVAC mode					
		2 Bytes	7.001 Pulses					
		2 Bytes	8.001 Pulses Difference					
		2 Bytes	9.001 Temperature					
		4 Bytes	12.001 Counter Pulses (Unsigned)					
		4 Bytes	13.001 Counter Pulses (Signed)					
		4 Bytes	14.000 Acceleration					

Table 107

This object is available if the converter type is “User customized”.

If the converter is bidirectional Y terminal is used as an input and an output for the converter, else it is used as an output only.

This object DPT is determined by “Y terminal object type” parameter.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
AF n	Converter - Y Terminal – 1-Byte - Input	1 Byte	5.010 Counter pulses	C		W	T	U
	Converter - Y Terminal – 1-Byte - Output			C	R	W	T	U
	Converter - Y Terminal – 1-Byte – Input / Output			C	R	W	T	U

Table 108

This object is available if the converter type is “8 x 1-bit => 1 x 1-byte” or “1 x 1-byte => 8 x 1-bit”.

It represents the byte object of the converter.

If the converter type is “8 x 1-bit => 1 x 1-byte”, Y terminal is used as an output terminal.

If the converter type is “1 x 1-byte => 8 x 1-bit”, Y terminal is used as an input terminal.

If the converter is bidirectional, Y terminal is used as an input and output terminal.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
AF n	Converter - Y Terminal – 2-Byte - Input	2 Bytes	7.001 Pulses	C		W	T	U
	Converter - Y Terminal – 2-Byte - Output			C	R	W	T	U
	Converter - Y Terminal – 2-Byte – Input / Output			C	R	W	T	U

Table 109

This object is available if the converter type is “2 x 1-byte => 1 x 2-byte” or “1 x 2-byte => 2 x 1-byte”.

It represents the 2-byte object of the converter.

If the converter type is “2 x 1-byte => 1 x 2-byte”, Y terminal is used as an output terminal.

If the converter type is “1 x 2-byte => 2 x 1-byte”, Y terminal is used as an input terminal.

If the converter is bidirectional, Y terminal is used as an input and output terminal.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
AF n	Converter - Y Terminal – 4-Byte - Input	4 Bytes	12.001 Counter Pulses (Unsigned)	C		W	T	U
	Converter - Y Terminal – 4-Byte - Output			C	R	W	T	U
	Converter - Y Terminal – 4-Byte – Input / Output			C	R	W	T	U

Table 110

This object is available if the converter type is “4 x 1-byte => 1 x 4-byte”, “1 x 4-byte => 4 x 1-byte”, “2 x 2-byte => 1 x 4-byte” or “1 x 4-byte => 2 x 2-byte”.

It represents the 4-byte object of the converter.

If the converter type is “4 x 1-byte => 1 x 4-byte” or “2 x 2-byte => 1 x 4-byte”, Y terminal is used as an output terminal.

If the converter type is “1 x 4-byte => 4 x 1-byte” or “1 x 4-byte => 2 x 2-byte”, Y terminal is used as an input terminal.

If the converter is bidirectional, Y terminal is used as an input and output terminal.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
AF n	Converter - Y Terminal - 4-Byte Float- Input	4 Bytes	14.000 Acceleration	C		W	T	U
	Converter - Y Terminal - 4-Byte Float - Output			C	R	W	T	
	Converter - Y Terminal - 4-Byte Float - Input / Output			C	R	W	T	U

Table 111

This object is available if the converter type is “1 x 2-byte float=> 1 x 4-byte float” or “1 x 4-byte float=> 1 x 2-byte float”.

It represents the 4-byte object of the terminal.

If the converter type is “2 x 2-byte float=> 1 x 4-byte float”, Y terminal is used as an output terminal.

If the converter type is “1 x 4-byte float=> 1 x 2-byte float”, Y terminal is used as an input terminal.

If the converter is bidirectional, Y terminal is used as an input and output terminal.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
AF n	Converter - Lock	1 Bit	1.003 Enable	C	R	W	T	U

Table 112

This object is available if “Enable lock” parameter is set to “Yes”. It is used to lock/unlock the auxiliary function.

10.2 Filter

Filter function controls which telegrams will be transmitted to the output when the input receives one according to the telegram value and a pre-set condition or according to the filter status (Enabled / Disabled).

10.2.1 Filter Parameters

Name	Values	Description
<i>Auxiliary function name</i>		The user can give the auxiliary function a name for documentation purposes. This parameter value has no effect on the function work.
<i>Filter objects type</i>	1-bit switch 1-bit up/down 1-bit step 1-bit trigger	This parameter defines the DPT of the filter's terminals objects.

	2-bit priority 4-bit dimming control Scene number 1-byte percentage 1-byte unsigned value 1-byte signed value HVAC mode 2-byte unsigned value 2-byte signed value 2-byte float 4-byte unsigned value 4-byte signed value 4-byte float	If the converter is not bidirectional, X terminal is the input and Y terminal is the output, else both terminals can be operated as input and output.
<i>Is filter bidirectional</i>	No Yes	The bidirectional filter filters the telegrams in two directions. From X terminal object to Y terminal object and from Y terminal object to X terminal object. If “Yes” is selected, “Send passed values after delay” and “Send passed values cyclically” parameters cannot be used.
<i>Enable “Filter – Enable / Disable” object</i>	No Yes	“No”: the filter is enabled always and passes telegrams from its input to its output according to a condition. “Yes”: the filter can be enabled or disabled with an object and its behavior in both cases can be determined with parameters.
<i>Filter status after bus return</i>	Disabled Enabled Read from bus As before bus failure	This parameter determines the status of the filter after bus voltage return. If “Read from bus” is selected, the device will send a read request for “Filter – Enable / Disable” object of the function, if no response is received the filter will be enabled.
<i>Behavior when filter is disabled</i>	Block all telegrams Pass all telegrams	This parameter is available if “Enable “Filter – Enable / Disable” object” parameter is set to “Yes”. This parameter determines the behavior of the filter when its disabled with “Filter – Enable / Disable” object.
<i>Behavior when filter is enabled</i>	Block all telegrams Pass all telegrams Pass according to condition	This parameter is available if “Enable “Filter – Enable / Disable” object” parameter is set to “Yes”. This parameter determines the behavior of the filter when its enabled with “Filter – Enable / Disable” object.
<i>Pass telegram if its value is</i>	Equal to Unequal to Lower than Equal or lower than Greater than Equal or greater than Between Not between	This parameter is available if “Enable “Filter – Enable / Disable” object” is set to “No” or if “Behavior when filter is enabled” is set to “Pass according to condition”. This parameter defines the condition of the filter. One or two additional parameters will be visible to enter the test values of the condition. If the filter receives a telegram that meet the condition, it will pass it to the output. If the terminal object type is “1-bit”, “2-bit” “4-bit” “Scene number” or “HVAC mode”, only two conditions can be chosen, “Equal to” and “Unequal to”.
<i>Send passed telegrams after delay</i>	No Yes	This parameter enables a delay before sending the passed telegrams.

<i>Delay time unit</i>	Second Minute Hour Day	This parameter defines the unit of the delay time before the passed <i>telegrams</i> is sent.
<i>Delay time value</i>	1...255	This parameter defines the value of the delay time before the <i>telegrams</i> value is sent.
<i>Send passed telegrams cyclically</i>	No Yes	This parameter enables sending the passed <i>telegrams</i> cyclically to the bus.
<i>Cycle time unit</i>	Second Minute Hour Day	This parameter defines the unit of the time period between the repeated telegrams.
<i>Cycle time value</i>	1...255	This parameter defines the value of the time period between the repeated telegrams.
<i>Enable lock</i>	No Yes	This function enables “Lock” object that is used to lock the auxiliary function.
<i>Lock status after bus return</i>	Unlocked Locked Read from bus As before bus failure	This parameter determines the status of the function’s lock after bus voltage return. If “Read from bus” is selected, the device will send a read request for the lock object of the function, if no response is received the function will be unlocked.

Table 113

10.2.2 Filter Group Objects

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>AF n</i>	<i>Filter - X Terminal - Input</i> <i>Filter - X Terminal – Input / Output</i>	1 Bit	1.001 Switch					
		1 Bit	1.008 Up / Down					
		1 Bit	1.007 Step					
		1 Bit	1.017 Trigger					
		2 Bits	2.001 Switch Control					
		4 Bits	3.007 Dimming Control					
		1 Byte	18.001 Scene Control					
		1 Byte	5.001 Percentage			W		
		1 Byte	5.010 Counter pulses			R	W	T
		1 Byte	6.010 Counter pulses					
		1 Byte	20.102 HVAC mode					
		2 Bytes	7.001 Pulses					
		2 Bytes	8.001 Pulses Difference					
		2 Bytes	9.001 Temperature					
4 Bytes	12.001 Counter Pulses (Unsigned)							
4 Bytes	13.001 Counter Pulses (Signed)							
4 Bytes	14.000 Acceleration							

Table 114

If the filter is bidirectional X terminal is used as an input and an output for the filter, else it is used as an input only.

This object DPT is determined by “Filter objects type” parameter.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>AF n</i>	<i>Filter - Y Terminal - Output</i> <i>Filter - Y Terminal – Input / Output</i>	1 Bit	1.001 Switch					
		1 Bit	1.008 Up / Down					
		1 Bit	1.007 Step					
		1 Bit	1.017 Trigger					
		2 Bits	2.001 Switch Control					
		4 Bits	3.007 Dimming Control					
		1 Byte	18.001 Scene Control					
		1 Byte	5.001 Percentage	C	R		T	
		1 Byte	5.010 Counter pulses	C	R	W	T	
		1 Byte	6.010 Counter pulses					
		1 Byte	20.102 HVAC mode					
		2 Bytes	7.001 Pulses					
		2 Bytes	8.001 Pulses Difference					
		2 Bytes	9.001 Temperature					
4 Bytes	12.001 Counter Pulses (Unsigned)							
4 Bytes	13.001 Counter Pulses (Signed)							
4 Bytes	14.000 Acceleration							

Table 115

If the filter is bidirectional Y terminal is used as an input and an output for the converter, else it is used as an output only.

This object DPT is determined by “Filter objects type” parameter.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>AF n</i>	<i>Filter - Enable / Disable</i>	1 Bit	1.003 Enable	C	R	W	T	U

Table 116

This object is available if the “Enable “Filter – Enable / Disable” object “is set to “Yes”.

It is used to enable or disable the filter. When the filter is enabled or disabled it will work as it set in “Behavior when filter is enabled” and “Behavior when filter is disabled” parameters.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>AF n</i>	<i>Filter - Lock</i>	1 Bit	1.003 Enable	C	R	W	T	U

Table 117

This object is available if “Enable lock” parameter is set to “Yes”. It is used to lock/unlock the auxiliary function.

10.3 General Counter

The counter function increases/decreases the output value when it receives a valid telegram from its input object.

The input and output objects types can be selected from many different types. Counter start, limit and step values are configurable.

10.3.1 General Counter Parameters

Name	Values	Description
<i>Auxiliary function name</i>		<p>The user can give the auxiliary function a name for documentation purposes.</p> <p>This parameter value has no effect on the function work.</p>
<i>Counting type</i>	Cyclic Up-Down Two directions One direction – up One direction – down One direction – direction changeable via object	<p>This parameter defines the function behavior.</p> <p>Cyclic: The counter goes up (adds the step value to current counter value) at the beginning and when it reaches its limit it returns to the start value. Counting direction can be changed with “Counting Direction” object. For example, in a counter with start value 0, limit value 3 and step value 1, the counter value goes as below: 0-1-2-3-0-1-2...</p> <p>Up-Down: The counter goes up (adds the step value to current counter value) at the beginning and then it changes the direction every time it reaches its limit or start values. Counting direction can be changed with “Counting Direction” object too. For example, in a counter with start value 0, limit value 3 and step value 1, the counter value goes as below: 0-1-2-3-2-1-0-1-2- ...</p> <p>Two directions: the user selects when the function will go up (add the step value to current counter value), and when the function will go down (subtract the step value from the current counter value). For example, on telegrams for up, off telegrams for down.</p> <p>One direction – up: The counter goes up (adds the step value to current counter value) always and when it reaches its limit it stops counting. For example, in a counter with start value 0, limit value 3 and step value 1, the counter value goes as below: 0-1-2-3-3-3...</p> <p>One direction – down: The counter goes down (subtract the step value from current counter value) always and when it reaches its limit it stops counting. For example, in a counter with start value 3, limit value 0 and step value 1, the counter value goes as below: 3-2-1-0-0-0...</p> <p>One direction – direction changeable via object: The counter goes up or down according to “Counting Direction” object. It stops counting when it reaches its start or limit values.</p>
<i>Use counting direction object</i>	No Yes	<p>This parameter is available if “Counting type” parameter is set to “Cyclic” or “Up – Down”.</p> <p>It enables “Counting Direction” object</p>
<i>Input object type</i>	1-bit Scene number 1-byte unsigned value	This parameter defines the DPT of the input object.
<i>Counter value object type</i>	1-byte percentage	This parameter defines the DPT of the counter’s output object.

	1-byte unsigned value 1-byte signed value 2-byte unsigned value 2-byte signed value 2-byte float 4-byte unsigned value 4-byte signed value	
<i>Counter value object is overwritable</i>	No Yes	If “Yes” is selected, sending a value to “Counter Value” object will overwrite the current counter value.
<i>Start value</i>	0%...100% 0...255 -128... 0 ...127 0...65535 -32768... 0 ...32767 -670760... 18 ...670760 0 ...2147483647 -2147483648... 0 ...2147483647	This parameter defines the counter start value.
<i>Limit value</i>	0%...100% 0...255 -128... 127 0...65535 -32768... 32767 -670760... 30 ...670760 0...2147483647 -2147483648... 2147483647	This parameter defines the counter limit value.
<i>Step value</i>	0%...1%...100% 0...1...255 -128... 1 ...127 0...1...65535 -32768... 1 ... 32767 -670760... 1 ...670760 0...1 ...2147483647 -2147483648... 1 ...2147483647	This parameter defines the counter step amount.
<i>Number of input pulses for one counter step</i>	1...100000	This parameter determines how many trigger is needed to count a step. For example, if this parameter value is 10 and the input type is object, the counter will move a step each time it receives 10 proper telegram value from its input object.
<i>Send counter value</i>	Do not send, update only When counter value is changed At specific interval Cyclically only When counter value is changed and cyclically At specific interval and cyclically	This parameter defines when the function will send the counter value to the bus. If “Do not send, update only” is selected, the user can send read request to “Counter Value” object to get the current counter value. If the counter value is set to be sent at specific interval, an additional parameter will be shown to enter the interval value. The counter value will be sent to the bus if its new value is divisible by the interval value. If the counter value is set to be sent cyclically, additional parameters will be shown to enter the cycle time.
<i>Send counter value after bus return</i>	No Yes	This parameter is available if “Send counter value” parameter is not set to “Do not send, update only”.

		If "Yes" is selected, the function will send the loaded counter value at the start-up to the bus.
<i>Enable "Reset Counter" object</i>	No Yes	This parameter is used to enable "Reset counter" object that is used to reload the counter with its start value.
<i>Reset when received telegram is</i>	Off On Off or on	This parameter defines which value will reset the counter when it is received on "Reset Counter" object.
<i>Enable "Alarm" object</i>	No Yes	This parameter is used to enable "Alarm" object that is used to send alarm when counter value reaches a specific value.
<i>Alarm is on when</i>	Limit value is reached Specific value is reached	This parameter defines which value will trigger the alarm when the counter reaches it. If "Specific value is reached" is selected, an additional parameter will be shown to enter the alarm value.
<i>After bus return</i>	Load start value Load the reached value before bus failure	This parameter defines the behavior of the function after bus voltage return.
<i>Overwrite counter value after download</i>	No Yes	This parameter is available if "After bus return" parameter is set to "Load the reached value before bus failure". If "No" is selected, the reached counter value before the application download operation will be loaded after the download operation. If "Yes" is selected, the counter start value will be loaded after the download operation.
<i>Enable lock</i>	No Yes	This function enables "Lock" object that is used to lock the auxiliary function.
<i>Lock status after bus return</i>	Unlocked Locked Read from bus As before bus failure	This parameter determines the status of the function's lock after bus voltage return. If "Read from bus" is selected, the device will send a read request for the lock object of the function, if no response is received the function will be unlocked.

Table 118

10.3.2 General Counter Group Objects

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>AF n</i>	<i>General Counter - Next Step Input</i>	1 Bit	1.001 Switch					
	<i>General Counter - Previous Step Input</i>	1 Byte	17.001 Scene Number	C		W		
		1 Byte	5.010 Counter Pulses					

Table 119

Previous Step Input object is available only if "Counting type" parameter is set to "Two directions".

The DPT of these objects can be specified with "Object type" parameters.

These objects are used to trigger the counter to count when it receives a proper telegram according to "Next step at" and "Previous step at" parameters.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>AF n</i>	<i>General Counter - Counting Direction</i>	1 Bit	1.008 Up / Down	C		W		

Table 120

This object is available if “Counting type” parameter is set to “One direction – changeable via object” or when it is set to “Cyclic” or “Up – down” and “Use “Counting Direction” object” is set to “Yes”.

It’s used to change the counting direction.

When the direction is up, the counter adds the step value to the current counter value when it’s triggered.

When the direction is down, the counter subtracts the step value from the current counter value when it’s triggered.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>AF n</i>	<i>General Counter - Counter value</i>	1 Byte	5.001 Percentage					
		1 Byte	5.010 Counter pulses					
		1 Byte	6.010 Counter pulses					
		2 Bytes	7.001 Pulses	C	R	W	T	
		2 Bytes	8.001 Pulses Difference					
		2 Bytes	9.001 Temperature					
		4 Bytes	12.001 Counter Pulses (Unsigned)					
4 Bytes	13.001 Counter Pulses (Signed)							

Table 121

The value of this object represents the reached counter value. Its DPT is specified by “Counter value object type” parameter.

If “Counter value object is overwriteable” parameter is set to “Yes”, writing a value to this object will overwrite the current counter value. If the written value isn’t between the start and the limit values, the counter will use the start or the limit value.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>AF n</i>	<i>General Counter - Reset Counter</i>	1 Bit	1.001 Switch	C		W		

Table 122

This object is available if “Enable “Reset Counter” object” parameter is set to “Yes”.

It’s used to reload the counter with its start value when it receives a telegram as specified in “Reset when received telegram is” parameter.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>AF n</i>	<i>General Counter - Alarm</i>	1 Bit	1.005 Switch	C	R		T	

Table 123

This object is available if “Enable “Alarm” object” parameter is set to “Yes”.

It’s used to send alarm when counter value reaches a specific value.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>AF n</i>	<i>General Counter - Lock</i>	1 Bit	1.003 Enable	C	R	W	T	U

Table 124

This object is available if “Enable lock” parameter is set to “Yes”. It is used to lock/unlock the auxiliary function.

10.4 Logic Gate

This function acts as a logic gate with maximum 8 x 1-bit input objects, and one output object.

The output object type can be selected from 14 types.

10.4.1 Logic Gate Parameters

Name	Values	Description
<i>Auxiliary function name</i>		<p>The user can give the auxiliary function a name for documentation purposes.</p> <p>This parameter value has no effect on the function work.</p>
<i>Logic gate type</i>	AND OR XOR NAND NOR XNOR One hot NOT	<p>AND: gives a true output only if all its inputs are 1.</p> <p>OR: gives a true output if one or more of its inputs are 1.</p> <p>XOR: gives a true output when the number of 1 inputs is odd.</p> <p>NAND: Its output is true if any of the inputs are 0.</p> <p>NOR: produces an output which is false only if all its inputs are 1.</p> <p>XNOR: gives a true output when the number of 1 inputs is even.</p> <p>One hot: gives a true output if there is only one input is 1. For example: The gate gives true with these input values: 0-1-0-0-0-0 or 0-0-0-0-0-1 or 1-0-0-0-0-0 The gate gives false with these input values: 0-0-0-0-0-0 or 0-1-1-0-0-0 or 1-1-1-1-1-1</p> <p>NOT: produces an inverted version of the input at its output. It is also known as an inverter.</p>
<i>Number of used inputs</i>	2 ... 8	This parameter is shown if the logic gate type is not "NOT" gate. It defines how many inputs the logic gate will have.
<i>Number of used NOT gates</i>	1 ... 4	This parameter is shown if the logic gate type is "NOT" gate. It defines how many NOT gate the auxiliary function will have.
<i>Input X polarity</i>	Normal Inverted	This parameter is shown if the logic gate type is not "NOT" gate. It is used to invert the input object value.
<i>Input X value after mains voltage recovery</i>	0 1 As before bus failure Read from bus Block output until new telegram is received	<p>This parameter is shown if the logic gate type is not "NOT" gate.</p> <p>If "Read from bus" is selected, the function will send read request for the input object. If no response is received, the input value will be 0.</p> <p>If "Block output until new telegram is received" is selected, the output value will not be sent to the bus until the logic gate receives a telegram from this input.</p>
<i>Output object type</i>	1-bit switch 1-bit up/down 1-bit step	This parameter is shown if the logic gate type is not "NOT" gate.

	1-bit trigger 2-bit priority 4-bit dimming control Scene number 1-byte percentage 1-byte unsigned value 1-byte signed value HVAC mode 2-byte unsigned value 2-byte signed value 2-byte float 4-byte unsigned value 4-byte signed value 4-byte float	This parameter defines the DPT of the output object of the logic gate, and according to its value two parameters will be shown to specify the output values for true and false.
<i>Send output telegram when</i>	Input is updated Output changes	If “Input is updated” is selected, the gate will send an output telegram every time a telegram is sent to an input object even if the output state didn’t change. If “Output changes” is selected, the gate will send an output telegram only when its output state changes from true to false or from false to true.
<i>Send output value after delay</i>	No Yes	This parameter is shown if the logic gate type is not “NOT” gate. It enables a delay before sending the output value.
<i>Delay time unit</i>	Second Minute Hour Day	This parameter defines the unit of the delay time before the output value is sent.
<i>Delay time value</i>	1...255	This parameter defines the value of the delay time before the output value is sent.
<i>Send output cyclically</i>	No Yes	This parameter is shown if the logic gate type is not “NOT” gate. It enables sending the output value cyclically to the bus.
<i>Cycle time unit</i>	Second Minute Hour Day	This parameter defines the unit of the time period between the repeated output telegrams.
<i>Cycle time value</i>	1...255	This parameter defines the value of the time period between the repeated output telegrams.
<i>Enable lock</i>	No Yes	This function enables “Lock” object that is used to lock the auxiliary function.
<i>Lock status after bus return</i>	Unlocked Locked Read from bus As before bus failure	This parameter determines the status of the function’s lock after bus voltage return. If “Read from bus” is selected, the device will send a read request for the lock object of the function, if no response is received the function will be unlocked.

Table 125

10.4.2 Logic Gate Group Objects

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>AF n</i>	<i>Logic Gate - Input x</i>	1 Bit	1.002 Boolean					
<i>AF n</i>	<i>NOT Gate x - Input</i>			C		W	T	U

Table 126

The input objects of the logic gate.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>AF n</i>	<i>Logic Gate - Output</i>	1 Bit	1.001 Switch					
<i>AF n</i>	<i>Logic Gate - Output</i>	1 Bit	1.008 Up / Down					
<i>AF n</i>	<i>Logic Gate - Output</i>	1 Bit	1.007 Step					
<i>AF n</i>	<i>Logic Gate - Output</i>	1 Bit	1.017 Trigger					
<i>AF n</i>	<i>Logic Gate - Output</i>	2 Bits	2.001 Switch Control					
<i>AF n</i>	<i>Logic Gate - Output</i>	4 Bits	3.007 Dimming Control					
<i>AF n</i>	<i>Logic Gate - Output</i>	1 Byte	18.001 Scene Control					
<i>AF n</i>	<i>Logic Gate - Output</i>	1 Byte	5.001 Percentage					
<i>AF n</i>	<i>Logic Gate - Output</i>	1 Byte	5.010 Counter pulses	C	R		T	
<i>AF n</i>	<i>Logic Gate - Output</i>	1 Byte	6.010 Counter pulses					
<i>AF n</i>	<i>Logic Gate - Output</i>	1 Byte	20.102 HVAC mode					
<i>AF n</i>	<i>Logic Gate - Output</i>	2 Bytes	7.001 Pulses					
<i>AF n</i>	<i>Logic Gate - Output</i>	2 Bytes	8.001 Pulses Difference					
<i>AF n</i>	<i>Logic Gate - Output</i>	2 Bytes	9.001 Temperature					
<i>AF n</i>	<i>Logic Gate - Output</i>	4 Bytes	12.001 Counter Pulses (Unsigned)					
<i>AF n</i>	<i>Logic Gate - Output</i>	4 Bytes	13.001 Counter Pulses (Signed)					
<i>AF n</i>	<i>Logic Gate - Output</i>	4 Bytes	14.000 Acceleration					
<i>AF n</i>	<i>NOT Gate x- Output</i>	1 Bit	1.002 Boolean					

Table 127

The output object of the logic gate. Its DPT is specified by “Output object type” parameter.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>AF n</i>	<i>Logic Gate - Lock</i>	1 Bit	1.003 Enable	C	R	W	T	U

Table 128

This object is available if “Enable lock” parameter is set to “Yes”. It is used to lock/unlock the auxiliary function.

10.5 Min/Max/Average Value Calculator

The value calculator calculates the minimum, the maximum or the average value of many input object values.

10.5.1 Min/Max/Average Value Calculator Parameters

Name	Values	Description
<i>Auxiliary function name</i>		<p>The user can give the auxiliary function a name for documentation purposes.</p> <p>This parameter value has no effect on the function work.</p>
<i>Objects type</i>	1-byte percentage 1-byte unsigned value 1-byte signed value 2-byte unsigned value 2-byte signed value 2-byte float 4-byte unsigned value 4-byte signed value 4-byte float	This parameter determines the DPT of the input objects and the output object of the calculator.
<i>Inputs number</i>	2 ... 8	This parameter defines how many inputs the function will have.
<i>Output value is</i>	The largest value of the inputs The smallest value of the inputs The average value of the inputs	<p>This parameter determines the type of the calculator.</p> <p>Note: When “the average value of the inputs” is selected, the sum of the input values must be less than 2147483648 and bigger than -2147483648. If the sum of the input values exceeds 2147483648 the calculator may give wrong output values.</p>
<i>Send output when</i>	Input is updated Output value is changed	<p>If “Input is updated” is selected, the calculator will send an output telegram every time a telegram is sent to an input object even if the output value didn’t change.</p> <p>If “Output changes” is selected, the calculator will send an output telegram only when output value changes.</p>
<i>Function behavior after bus return</i>	Use only received inputs values Block output until all inputs are updated Send read request for all input objects	<p>This parameter defines the behavior of the calculator after bus return.</p> <p>If “Block output until all inputs are updated” is selected, the calculator will send output values only if all input objects had received one telegram at least.</p> <p>If “Send read request for all input object” is selected, the calculator will send read request for all input objects, then it will use the received values only.</p>
<i>Send output value after delay</i>	No Yes	This parameter enables a delay before sending the output value.
<i>Delay time unit</i>	Second Minute	This parameter defines the unit of the delay time before the output value is sent.

	Hour Day	
<i>Delay time value</i>	1...255	This parameter defines the value of the delay time before the output value is sent.
<i>Send output cyclically</i>	No Yes	This enables sending the output value cyclically to the bus.
<i>Cycle time unit</i>	Second Minute Hour Day	This parameter defines the unit of the time period between the repeated output telegrams.
<i>Cycle time value</i>	1...255	This parameter defines the value of the time period between the repeated output telegrams.
<i>Enable lock</i>	No Yes	This function enables "Lock" object that is used to lock the auxiliary function.
<i>Lock status after bus return</i>	Unlocked Locked Read from bus As before bus failure	This parameter determines the status of the function's lock after bus voltage return. If "Read from bus" is selected, the device will send a read request for the lock object of the function, if no response is received the function will be unlocked.

Table 129

10.5.2 Min/Max/Average Value Calculator Group Objects

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>AF n</i>	<i>Value Calculator - Input x</i>	1 Byte	5.001 Percentage					
		1 Byte	5.010 Counter pulses					
		1 Byte	6.010 Counter pulses					
		2 Bytes	7.001 Pulses					
		2 Bytes	8.001 Pulses Difference	C	R	W	T	U
		2 Bytes	9.001 Temperature					
		4 Bytes	12.001 Counter Pulses (Unsigned)					
		4 Bytes	13.001 Counter Pulses (Signed)					
		4 Bytes	14.000 Acceleration					

Table 130

The input objects of the calculator. The number of input objects is determined with "Inputs number" parameter. Its DPT is specified with "Objects type" parameter.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>AF n</i>	<i>Value Calculator - Output</i>	1 Byte	5.001 Percentage					
		1 Byte	5.010 Counter pulses					
		1 Byte	6.010 Counter pulses					
		2 Bytes	7.001 Pulses					
		2 Bytes	8.001 Pulses Difference	C	R		T	
		2 Bytes	9.001 Temperature					
		4 Bytes	12.001 Counter Pulses (Unsigned)					

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
		4 Bytes 4 Bytes	13.001 Counter Pulses (Signed) 14.000 Acceleration					

Table 131

The output object of the calculator. Its DPT is specified with “Objects type” parameter.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>AF n</i>	<i>Value Calculator - Lock</i>	1 Bit	1.003 Enable	C	R	W	T	U

Table 132

This object is available if “Enable lock” parameter is set to “Yes”. It is used to lock/unlock the auxiliary function.

10.6 Monitor

The monitor observes the status of received telegrams of an object. It sends an alarm telegram if the input object is not updated with value specified in the parameters within a certain period of time.

10.6.1 Monitor Parameters

Name	Values	Description
<i>Auxiliary function name</i>		The user can give the auxiliary function a name for documentation purposes. This parameter value has no effect on the function work.
<i>Monitor time unit</i>	Second Minute Hour Day	This parameter defines the unit of the monitoring time.
<i>Monitor time value</i>	1...255	This parameter defines the value of the monitoring time.
<i>Input object type</i>	1-bit switch 1-bit up/down 1-bit step 1-bit trigger 2-bit priority 4-bit dimming control Scene number 1-byte percentage 1-byte unsigned value 1-byte signed value HVAC mode 2-byte unsigned value 2-byte signed value 2-byte float 4-byte unsigned value	This parameter determines the DPT of the input object.

	4-byte signed value 4-byte float	
<i>Reset monitor timer at</i>	Any telegram value Specific telegram value	This parameter determines that telegram value that will reset the monitoring timer when it's received. If "Specific telegram value" is selected, a parameter will be available to enter the telegram value that will reset the monitor.
<i>Send monitor alarm telegram</i>	Do not sent, update only On change	"Don't send, update only": "Monitor Alarm" object value is updated when the alarm status is changed but not sent to the bus. The user can read the object value manually. "On change": The alarm status is sent to the bus when it is changed.
<i>Send monitor alarm cyclically</i>	No Only when alarm is off Only when alarm is on Always	This parameter determines when to send the alarm status cyclically.
<i>Cycle time unit</i>	Second Minute Hour Day	This parameter defines the unit of the time period between the repeated alarm status telegrams.
<i>Cycle time value</i>	1...255	This parameter defines the value of the time period between the repeated alarm status telegrams.
<i>Enable "Additional Alarm" object</i>	No Yes	An additional alarm object with configurable DPT can be used to send specific telegrams when the alarm status is changed. If "Yes" is selected, many parameters will be available to let the user specify the DPT of "Additional Alarm" object and the telegram values to send when the alarm becomes on or off.
<i>Enable lock</i>	No Yes	This function enables "Lock" object that is used to lock the auxiliary function.
<i>Lock status after bus return</i>	Unlocked Locked Read from bus As before bus failure	This parameter determines the status of the function's lock after bus voltage return. If "Read from bus" is selected, the device will send a read request for the lock object of the function, if no response is received the function will be unlocked.

Table 133

10.6.2 Monitor Group Objects

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
AF n	Monitor - Input	1 Bit	1.001 Switch					
		1 Bit	1.008 Up / Down					
		1 Bit	1.007 Step					
		1 Bit	1.017 Trigger					
		2 Bits	2.001 Switch Control	C		W		
		4 Bits	3.007 Dimming Control					
		1 Byte	18.001 Scene Control					
		1 Byte	5.001 Percentage					

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
		1 Byte	5.010 Counter pulses					
		1 Byte	6.010 Counter pulses					
		1 Byte	20.102 HVAC mode					
		2 Bytes	7.001 Pulses					
		2 Bytes	8.001 Pulses Difference					
		2 Bytes	9.001 Temperature					
		4 Bytes	12.001 Counter Pulses (Unsigned)					
		4 Bytes	13.001 Counter Pulses (Signed)					
		4 Bytes	14.000 Acceleration					

Table 134

The input object of the monitor. Its DPT is specified with “Input object type” parameter.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>AF n</i>	<i>Monitor - Alarm</i>	1 Bit	1.005 Switch	C	R		T	

Table 135

This object value represents the alarm status of the function.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>AF n</i>	<i>Monitor - Additional Alarm</i>	1 Bit	1.001 Switch					
		1 Bit	1.008 Up / Down					
		1 Bit	1.007 Step					
		1 Bit	1.017 Trigger					
		2 Bits	2.001 Switch Control					
		4 Bits	3.007 Dimming Control					
		1 Byte	18.001 Scene Control					
		1 Byte	5.001 Percentage					
		1 Byte	5.010 Counter pulses	C	R		T	
		1 Byte	6.010 Counter pulses					
		1 Byte	20.102 HVAC mode					
		2 Bytes	7.001 Pulses					
		2 Bytes	8.001 Pulses Difference					
		2 Bytes	9.001 Temperature					
		4 Bytes	12.001 Counter Pulses (Unsigned)					
4 Bytes	13.001 Counter Pulses (Signed)							
4 Bytes	14.000 Acceleration							

Table 136

This object is available if “Enable “Additional Alarm” object” parameter is set to “Yes”. It is used to send specific telegrams when the alarm status is changed.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>AF n</i>	<i>Monitor - Lock</i>	1 Bit	1.003 Enable	C	R	W	T	U

Table 137

This object is available if “Enable lock” parameter is set to “Yes”. It is used to lock/unlock the auxiliary function.

10.7 Presence Detector Controller

Presence detector controller function is used to control the lights according to presence information that is supplied from a presence detector. The received-on telegrams from the input object indicate a motion is started, and the received off telegrams indicate the motion is stopped. When the detector detects a motion the lights are switched on immediately, when it stops detecting motion for a specific time the lights are switched off. The delay between the last motion detection and switching the lights off is configurable with a parameter and an object.

10.7.1 Presence Detector Controller Parameters

Name	Values	Description
<i>Auxiliary function name</i>		The user can give the auxiliary function a name for documentation purposes. This parameter value has no effect on the function work.
<i>Output object type</i>	1-bit switch 1-byte percentage	This parameter determines the DPT of the output object. If “1-bit switch” is selected, on telegrams will be sent to switch the lights on and off telegrams to switch them off. If “1-byte percentage” is selected, the user can specify the telegram values for switching the lights on and off with additional two parameters.
<i>Delay before switching off</i>	00:00:00... 00:01:00 ...09:06:07	When the detection of a presence is finished, the controller sets a delay timer, and when its time is elapsed the controller switches the lights off. If a motion is detected while the timer is running, then the timer is restarted.
<i>Enable “Set Delay Time” object</i>	No Yes	This function is used to enable “Set Delay Time” object that is used to change the switching off delay time from an object.
<i>Overwrite delay time value with download</i>	No Yes	“No”: the delay time that is used before the application download operation will be used after the download operation. “Yes”: the delay time in “Delay before switching off” parameter will be used after the download operation.
<i>Enable lock</i>	No Yes	This function enables “Lock” object that is used to lock the auxiliary function.
<i>Lock status after bus return</i>	Unlocked Locked Read from bus As before bus failure	This parameter determines the status of the function’s lock after bus voltage return. If “Read from bus” is selected, the device will send a read request for the lock object of the function, if no response is received the function will be unlocked.

Table 138

10.7.2 Presence Detector Controller Group Objects

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>AF n</i>	<i>Presence Detector Controller - Input</i>	1 Bit	1.001 Switch	C		W		

Table 139

The received-on telegrams from this object indicate a motion is started, and the received off telegrams indicate the motion is stopped.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>AF n</i>	<i>Presence Detector Controller – Output</i>	1 Bit 1 Byte	1.001 Switch 5.001 Percentage	C	R		T	

Table 140

This object DPT is specified with “Output object type” parameter. It is used to switch the lights on and off.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>AF n</i>	<i>Presence Detector Controller – Set Delay Time</i>	2 Bytes	7.005 time (s)	C		W		

Table 141

This object is available if “Enable “Set Delay Time” object” parameter is set to “Yes”. It is used to change the switching off delay time. Maximum acceptable value is 32,767 seconds (equals to 09:06:07). The received values are saved to use them after bus voltage failures too.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>AF n</i>	<i>Presence Detector Controller - Lock</i>	1 Bit	1.003 Enable	C	R	W	T	U

Table 142

This object is available if “Enable lock” parameter is set to “Yes”. It is used to lock/unlock the auxiliary function.

10.8 Scene Actuator

Scene actuator function has one scene input and 8 outputs. It sends the configured output values when it receives the set scene number from its input object. The output values can be from different types.

Scene actuator values can be overridden with save feature.

A delay time can be set before sending the telegram of the first output, and another delay time between the outputs’ telegrams.

10.8.1 Scene Actuator Parameters

Name	Values	Description
<i>Auxiliary function name</i>		<p>The user can give the auxiliary function a name for documentation purposes.</p> <p>This parameter value has no effect on the function work.</p>
<i>Scene number for actuating</i>	1...64	This parameter defines the scene number that will trigger the function to send its output telegrams.
<i>Save output values with learn telegrams</i>	No Yes	<p>If “Yes” is selected, the output values can be overwritten with the last sent values to the output objects when a learn scene telegram is received.</p> <p>Note: Output values “Toggle”, “Up – Down”, “Decrease – Increase / Step up - Step down” for 1-bit objects and “Decrease – Increase” for 4-bit dimming control objects cannot be overwritten.</p>
<i>Stop sending telegrams if a scene with different number is called</i>	No Yes	<p>Due to the configurable time delays parameters of the scene actuator function, actuating a scene may take a long time and may not be executed immediately.</p> <p>If “Yes” is selected, the scene actuator will stop sending its output telegrams when it receives a different scene number than its scene number.</p> <p>For example: “Yes” should be selected when “Good bye” scene number is wanted to cancel “Welcome” scene number because they have opposite operations.</p>
<i>Overwrite output values at download</i>	No Yes	<p>If “No” is selected, the previously downloaded or learned output values will persist after the ETS download operation, and the new downloaded output values will be ignored.</p> <p>If “Yes” is selected, the downloaded output values will overwrite the previously downloaded or learned ones.</p> <p>Note: If “No” will be selected, the output types shouldn’t be changed else the output values are undefined.</p>
<i>Enable actuating startup delay</i>	No Yes	<p>This parameter enables a delay before sending the first output value to the bus.</p> <p>If “Yes” is selected, two parameters will be shown to enter the unit and the value of the delay time.</p>
<i>Enable delay between output telegrams</i>	No Yes	<p>This parameter enables a delay between the output telegrams.</p> <p>If “Yes” is selected, two parameters will be shown to enter the unit and the value of the delay time.</p>
<i>Output x type</i>	Not used 1-bit switch 1-bit up/down 1-bit step 1-bit trigger 2-bit priority 4-bit dimming control Scene number	<p>This parameter defines the DPT of the x-th output object and according to its value additional parameter/s will be shown to specify the output values.</p> <p>If “Not used” is selected no telegram is sent for this output.</p>

	1-byte percentage 1-byte unsigned value 1-byte signed value HVAC mode 2-byte unsigned value 2-byte signed value 2-byte float 4-byte unsigned value 4-byte signed value 4-byte float	
<i>Enable lock</i>	No Yes	This function enables “Lock” object that is used to lock the auxiliary function.
<i>Lock status after bus return</i>	Unlocked Locked Read from bus As before bus failure	This parameter determines the status of the function’s lock after bus voltage return. If “Read from bus” is selected, the device will send a read request for the lock object of the function, if no response is received the function will be unlocked.

Table 143

10.8.2 Scene Actuator Group Objects

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>AF n</i>	<i>Scene Actuator - Scene Number Input</i>	1 Byte	18.001 Scene Control	C			T	

Table 144

Sending a scene number that matches the value of “Scene number for actuating” parameter to this object, triggers the scene actuator to start sending its output values.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>AF n</i>	<i>Scene Actuator - Output x</i>	1 Bit	1.001 Switch					
		1 Bit	1.008 Up / Down					
		1 Bit	1.007 Step					
		1 Bit	1.017 Trigger					
		2 Bits	2.001 Switch Control					
		4 Bits	3.007 Dimming Control					
		1 Byte	18.001 Scene Control					
		1 Byte	5.001 Percentage					
		1 Byte	5.010 Counter pulses			C		
		1 Byte	6.010 Counter pulses					
		1 Byte	20.102 HVAC mode					
		2 Bytes	7.001 Pulses					
		2 Bytes	8.001 Pulses Difference					
		2 Bytes	9.001 Temperature					
4 Bytes	12.001 Counter Pulses (Unsigned)							
4 Bytes	13.001 Counter Pulses (Signed)							
4 Bytes	14.000 Acceleration							

Table 145

This object is available if the “Output x type” parameter is not set to “Not used”.

Its DPT is specified with “Output x type” parameter.
It sends the x-th output value when the scene actuator is triggered.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>AF n</i>	<i>Scene actuator - Lock</i>	1 Bit	1.003 Enable	C	R	W	T	U

Table 146

This object is available if “Enable lock” parameter is set to “Yes”. It’s used to lock/unlock the auxiliary function.

10.9 Send After Delay

Send after delay function has one input and one output objects. It sends the received telegrams from its input object to its output object after a specific delay time. If a telegram is received before the delay time of a previous received telegram elapses, the previous telegram is ignored and the new telegram is sent to the output after the delay time.

10.9.1 Send After Delay Parameters

Name	Values	Description
<i>Auxiliary function name</i>		The user can give the auxiliary function a name for documentation purposes. This parameter value has no effect on the function work.
<i>Object type</i>	1-bit switch 1-bit up/down 1-bit step 1-bit trigger 2-bit priority 4-bit dimming control Scene number 1-byte percentage 1-byte unsigned value 1-byte signed value HVAC mode 2-byte unsigned value 2-byte signed value 2-byte float 4-byte unsigned value 4-byte signed value 4-byte float	This parameter determines the DPT of the input and the output objects.
<i>Delay time</i>	00:00:00... 00:01:00 ...09:06:07	This parameter determines the delay time before resending the received telegram from the input to the output.
<i>Delay time is applied for</i>	All values Specific value All values except specific value	This parameter determines which telegram values will be delayed. If “specific value” or “All values except specific value” is selected, an additional parameter will be available to enter the specific value.

		When the delay time is not applied for a telegram, it is redirected immediately to the output when it is received.
<i>Enable "Set Delay Time" object</i>	No Yes	This function is used to enable "Set Delay Time" object that is used to change the delay time from an object.
<i>Overwrite delay time value with download</i>	No Yes	"No": the delay time that is used before the application download operation will be used after the download operation. "Yes": the delay time in "Delay time" parameter will be used after the download operation.
<i>Enable lock</i>	No Yes	This function enables "Lock" object that is used to lock the auxiliary function.
<i>Lock status after bus return</i>	Unlocked Locked Read from bus As before bus failure	This parameter determines the status of the function's lock after bus voltage return. If "Read from bus" is selected, the device will send a read request for the lock object of the function, if no response is received the function will be unlocked.

Table 147

10.9.2 Presence Detector Controller Group Objects

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>AF n</i>	<i>Send After Delay - Input</i>	1 Bit	1.001 Switch					
		1 Bit	1.008 Up / Down					
		1 Bit	1.007 Step					
		1 Bit	1.017 Trigger					
		2 Bits	2.001 Switch Control					
		4 Bits	3.007 Dimming Control					
		1 Byte	18.001 Scene Control					
		1 Byte	5.001 Percentage					
		1 Byte	5.010 Counter pulses			C		W
		1 Byte	6.010 Counter pulses					
		1 Byte	20.102 HVAC mode					
		2 Bytes	7.001 Pulses					
		2 Bytes	8.001 Pulses Difference					
		2 Bytes	9.001 Temperature					
4 Bytes	12.001 Counter Pulses (Unsigned)							
4 Bytes	13.001 Counter Pulses (Signed)							
4 Bytes	14.000 Acceleration							

Table 148

The input object of the function. Its DPT is specified with "Object type" parameter.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>AF n</i>	<i>Send After Delay – Output</i>	1 Bit	1.001 Switch					
		1 Bit	1.008 Up / Down					
		1 Bit	1.007 Step					T
		1 Bit	1.017 Trigger					

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
		2 Bits	2.001 Switch Control					
		4 Bits	3.007 Dimming Control					
		1 Byte	18.001 Scene Control					
		1 Byte	5.001 Percentage					
		1 Byte	5.010 Counter pulses					
		1 Byte	6.010 Counter pulses					
		1 Byte	20.102 HVAC mode					
		2 Bytes	7.001 Pulses					
		2 Bytes	8.001 Pulses Difference					
		2 Bytes	9.001 Temperature					
		4 Bytes	12.001 Counter Pulses (Unsigned)					
		4 Bytes	13.001 Counter Pulses (Signed)					
		4 Bytes	14.000 Acceleration					

Table 149

The output object of the function. Its DPT is specified with “Object type” parameter.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>AF n</i>	<i>Send After Delay– Set Delay Time</i>	2 Bytes	7.005 time (s)	C		W		

Table 150

This object is available if “Enable “Set Delay Time” object” parameter is set to “Yes”. It is used to change the delay time. Maximum acceptable value is 32,767 seconds (equals to 09:06:07). The received values are saved to use them after bus voltage failures too.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>AF n</i>	<i>Send After Delay - Lock</i>	1 Bit	1.003 Enable	C	R	W	T	U

Table 151

This object is available if “Enable lock” parameter is set to “Yes”. It is used to lock/unlock the auxiliary function.

10.10 Send After Reset

Send after reset function can be used to:

- 1- Send a telegram with specific value or a read request when the device starts up.
- 2- Save the last sent value before an electric cut off and resend it when the bus voltage returns.
- 3- Send a read request or a telegram cyclically to the bus.

10.10.1 Send After Reset Parameters

Name	Values	Description
------	--------	-------------

<i>Auxiliary function name</i>		<p>The user can give the auxiliary function a name for documentation purposes.</p> <p>This parameter value has no effect on the function work.</p>
<i>After reset send</i>	Value telegram Read request	This parameter defines what to send after reset.
<i>Output object type</i>	1-bit switch 1-bit up/down 1-bit step 1-bit trigger 2-bit priority 4-bit dimming control Scene number 1-byte percentage 1-byte unsigned value 1-byte signed value HVAC mode 2-byte unsigned value 2-byte signed value 2-byte float 4-byte unsigned value 4-byte signed value 4-byte float	This parameter defines the DPT of the output object of this function.
<i>Output value</i>	Parameter values are shown according to the selected object type.	<p>This parameter is available if “After reset send” parameter is set to “Value telegram”.</p> <p>It defines the telegram value that will be sent after reset.</p>
<i>Overwrite output value when a telegram is received</i>	No Yes	<p>This parameter is available if “After reset send” parameter is set to “Value telegram”.</p> <p>If “Yes” is selected, receiving a telegram from the output object overwrites the output value.</p> <p>This feature can be used to save the last sent value before an electric cut off and resend it when the bus voltage returns.</p>
<i>Send output after delay</i>	No Yes	This parameter enables a delay before sending the output value at startup.
<i>Delay time unit</i>	Second Minute Hour Day	This parameter defines the unit of the delay time before the output value is sent.
<i>Delay time value</i>	1...255	This parameter defines the value of the delay time before the output value is sent.
<i>Send output cyclically</i>	No Yes	This parameter enables sending the output value cyclically to the bus.
<i>Cycle time unit</i>	Second Minute Hour Day	This parameter defines the unit of the time period between the repeated output telegrams.
<i>Cycle time value</i>	1...255	This parameter defines the value of the time period between the repeated output telegrams.

<i>Enable lock</i>	No Yes	This function enables “Lock” object that is used to lock the auxiliary function.
<i>Lock status after bus return</i>	Unlocked Locked Read from bus As before bus failure	This parameter determines the status of the function’s lock after bus voltage return. If “Read from bus” is selected, the device will send a read request for the lock object of the function, if no response is received the function will be unlocked.

Table 152

10.10.2 Send After Reset Group Objects

Object Name	Function	Size	Datapoint Type	Flags						
				C	R	W	T	U		
<i>AF n</i>	<i>Send After Reset - Output</i>	1 Bit	1.001 Switch							
		1 Bit	1.008 Up / Down							
		1 Bit	1.007 Step							
		1 Bit	1.017 Trigger							
		2 Bits	2.001 Switch Control							
		4 Bits	3.007 Dimming Control							
		1 Byte	18.001 Scene Control							
		1 Byte	5.001 Percentage							
		1 Byte	5.010 Counter pulses			C	R	W	T	U
		1 Byte	6.010 Counter pulses							
		1 Byte	20.102 HVAC mode							
		2 Bytes	7.001 Pulses							
		2 Bytes	8.001 Pulses Difference							
		2 Bytes	9.001 Temperature							
4 Bytes	12.001 Counter Pulses (Unsigned)									
4 Bytes	13.001 Counter Pulses (Signed)									
4 Bytes	14.000 Acceleration									

Table 153

This object DPT is specified with “Output object type” parameter. It sends the output value or read request after the device starts up according to the set parameters. If “Overwrite output value when a telegram is received” parameter is set to “Yes”, receiving a telegram from this object overwrites the output value.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>AF n</i>	<i>Send After Reset - Lock</i>	1 Bit	1.003 Enable	C	R	W	T	U

Table 154

This object is available if “Enable lock” parameter is set to “Yes”. It is used to lock/unlock the auxiliary function.

10.11 Send Cyclically

Send cyclically function has one input and one output objects. It sends the received telegrams from its input object to its output object immediately then cyclically. If a telegram is received before the cycle time of a previous received telegram elapses, the previous telegram is ignored and the new telegram is sent to the output immediately then cyclically.

10.11.1 Send Cyclically Parameters

Name	Values	Description
<i>Auxiliary function name</i>		<p>The user can give the auxiliary function a name for documentation purposes.</p> <p>This parameter value has no effect on the function work.</p>
<i>Object type</i>	1-bit switch 1-bit up/down 1-bit step 1-bit trigger 2-bit priority 4-bit dimming control Scene number 1-byte percentage 1-byte unsigned value 1-byte signed value HVAC mode 2-byte unsigned value 2-byte signed value 2-byte float 4-byte unsigned value 4-byte signed value 4-byte float	This parameter determines the DPT of the input and the output objects.
<i>Cycle time</i>	00:00:00...00:01:00...09:06:07	This parameter determines the cycle time between the repeated sent telegrams.
<i>Cycle time is applied for</i>	All values Specific value All values except specific value	<p>This parameter determines the telegram values that will be sent cyclically.</p> <p>If “specific value” or “All values except specific value” is selected, an additional parameter will be available to enter the specific value.</p> <p>When the cycle time is not applied for a telegram, it is redirected immediately to the output when it is received and not sent cyclically.</p>
<i>Enable “Set Cycle Time” object</i>	No Yes	This function is used to enable “Set Cycle Time” object that is used to change the cycle time from an object.
<i>Overwrite cycle time value with download</i>	No Yes	<p>“No”: the cycle time that is used before the application download operation will be used after the download operation.</p> <p>“Yes”: the cycle time in “Cycle time” parameter will be used after the download operation.</p>
<i>Limit cyclically sending count</i>	No Yes	<p>“No”: the received telegrams from the input will be sent to the output cyclically forever.</p> <p>“Yes”: the received telegrams from the input will be sent to the output cyclically a certain number of times.</p>
<i>Cycling count</i>	1...10...65535	This parameter determines how many times a telegram will be sent cyclically.
<i>Enable lock</i>	No Yes	This function enables “Lock” object that is used to lock the auxiliary function.

<i>Lock status after bus return</i>	Unlocked Locked Read from bus As before bus failure	This parameter determines the status of the function’s lock after bus voltage return. If “Read from bus” is selected, the device will send a read request for the lock object of the function, if no response is received the function will be unlocked.
-------------------------------------	---	---

Table 155

10.11.2 Send Cyclically Group Objects

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>AF n</i>	<i>Send Cyclically - Input</i>	1 Bit	1.001 Switch					
		1 Bit	1.008 Up / Down					
		1 Bit	1.007 Step					
		1 Bit	1.017 Trigger					
		2 Bits	2.001 Switch Control					
		4 Bits	3.007 Dimming Control					
		1 Byte	18.001 Scene Control					
		1 Byte	5.001 Percentage					
		1 Byte	5.010 Counter pulses			C		W
		1 Byte	6.010 Counter pulses					
		1 Byte	20.102 HVAC mode					
		2 Bytes	7.001 Pulses					
		2 Bytes	8.001 Pulses Difference					
		2 Bytes	9.001 Temperature					
4 Bytes	12.001 Counter Pulses (Unsigned)							
4 Bytes	13.001 Counter Pulses (Signed)							
4 Bytes	14.000 Acceleration							

Table 156

The input object of the function. Its DPT is specified with “Object type” parameter.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>AF n</i>	<i>Send Cyclically – Output</i>	1 Bit	1.001 Switch					
		1 Bit	1.008 Up / Down					
		1 Bit	1.007 Step					
		1 Bit	1.017 Trigger					
		2 Bits	2.001 Switch Control					
		4 Bits	3.007 Dimming Control					
		1 Byte	18.001 Scene Control					
		1 Byte	5.001 Percentage					
		1 Byte	5.010 Counter pulses			C		T
		1 Byte	6.010 Counter pulses					
		1 Byte	20.102 HVAC mode					
		2 Bytes	7.001 Pulses					
		2 Bytes	8.001 Pulses Difference					
		2 Bytes	9.001 Temperature					
4 Bytes	12.001 Counter Pulses (Unsigned)							
4 Bytes	13.001 Counter Pulses (Signed)							
4 Bytes	14.000 Acceleration							

Table 157

The output object of the function. Its DPT is specified with “Object type” parameter.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>AF n</i>	<i>Send Cyclically – Set Cycle Time</i>	2 Bytes	7.005 time (s)	C		W		

Table 158

This object is available if “Enable “Set Cycle Time” object” parameter is set to “Yes”. It is used to change the cycle time. Maximum acceptable value is 32,767 seconds (equals to 09:06:07). The received values are saved to use them after bus voltage failures too.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>AF n</i>	<i>Send Cyclically - Lock</i>	1 Bit	1.003 Enable	C	R	W	T	U

Table 159

This object is available if “Enable lock” parameter is set to “Yes”. It is used to lock/unlock the auxiliary function.

10.12 Sequencer

The sequencer function sends the next/previous step value when it receives a valid telegram from its input object.

The number of steps is configurable. An additional 1-bit telegram can be sent with specific value for each step along side with output telegram. The output object type can be different for each step, or the same for all steps.

10.12.1 Sequencer Parameters

Name	Values	Description
<i>Auxiliary function name</i>		<p>The user can give the auxiliary function a name for documentation purposes.</p> <p>This parameter value has no effect on the function work.</p>
<i>Sequencing type</i>	<p>Cyclic Up-Down Two directions</p>	<p>This parameter defines the function behavior.</p> <p>Cyclic: The function goes up always and when it reaches its last step it returns to the first step. For example, in a sequencer with 3 steps the sequence goes as below: Step 1 – Step 2 – Step 3 – Step1 – Step 2...</p> <p>Up-Down: The function goes up at the beginning and then it changes the direction every time it reaches its limits. For example, in a sequencer with 3 steps the sequence goes as below: Step 1 – Step 2 – Step 3 – Step2 – Step 1 – Step 2 – Step 3 ...</p> <p>Two directions: the user selects when the sequencer will go up, and when it will go down. For example, on telegrams for up and off telegrams for down.</p>
<i>Input object type</i>	<p>1-bit Scene number 1-byte unsigned value</p>	This parameter defines the DPT of the input object.
<i>Number of steps</i>	2...5	This parameter defines how many step will be used in the sequencer function.
<i>Number of output objects</i>	<p>One output object for all steps One output object for each step</p>	<p>This parameter defines how many object will be used for the steps.</p> <p>If “One output object for each step” is selected, each step can have an independent object with a different DPT.</p>
<i>Use additional 1-bit output object</i>	<p>No Yes</p>	<p>This parameter enables an additional 1-bit object that can be used to send a 1-bit telegram with a specific value for each step along side with the step output telegram.</p> <p>If it is enabled, further parameters will be shown to enable the user to enter the additional 1-bit object value for each step.</p>
<i>Output object type</i>	<p>1-bit switch 1-bit up/down</p>	This parameter is available if “Number of output objects” parameter is set to “One output object for all steps”.

	1-bit step 1-bit trigger 2-bit priority 4-bit dimming control Scene number 1-byte percentage 1-byte unsigned value 1-byte signed value HVAC mode 2-byte unsigned value 2-byte signed value 2-byte float 4-byte unsigned value 4-byte signed value 4-byte float	It defines the DPT of the sequencer's output object.
<i>Step x output object type</i>	1-bit switch 1-bit up/down 1-bit step 1-bit trigger 2-bit priority 4-bit dimming control Scene number 1-byte percentage 1-byte unsigned value 1-byte signed value HVAC mode 2-byte unsigned value 2-byte signed value 2-byte float 4-byte unsigned value 4-byte signed value 4-byte float	This parameter is available if "Number of output objects" parameter is set to "One output object for each step". It defines the DPT of a step output object.
<i>Step x output value</i>	Parameter values are shown according to the selected object type.	This parameter defines the telegram value that will be sent through the step/s object when the step is reached.
<i>Step x additional 1-bit object value</i>	Off On	This parameter is available if "Use additional 1-bit output object" parameter is set to "Yes". This parameter defines the telegram value that will be sent through the additional 1-bit object when the step is reached.
<i>After bus return start from</i>	Step 1 Last sent step before bus failure	This parameter defines the behavior of the function after bus voltage return.
<i>Send output value after delay</i>	No Yes	This parameter enables a delay before sending the output value.
<i>Delay time unit</i>	Second Minute Hour Day	This parameter defines the unit of the delay time before the output value is sent.
<i>Delay time value</i>	1...255	This parameter defines the value of the delay time before the output value is sent.
<i>Send output cyclically</i>	No Yes	This parameter enables sending the output value cyclically to the bus.

<i>Cycle time unit</i>	Second Minute Hour Day	This parameter defines the unit of the time period between the repeated output telegrams.
<i>Cycle time value</i>	1...255	This parameter defines the value of the time period between the repeated output telegrams.
<i>Enable lock</i>	No Yes	This function enables “Lock” object that is used to lock the auxiliary function.
<i>Lock status after bus return</i>	Unlocked Locked Read from bus As before bus failure	This parameter determines the status of the function’s lock after bus voltage return. If “Read from bus” is selected, the device will send a read request for the lock object of the function, if no response is received the function will be unlocked.

Table 160

10.12.2 Sequencer Group Objects

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>AF n</i>	<i>Sequencer - Next Step Input</i> <i>Sequencer - Previous Step Input</i>	1 Bit	1.001 Switch					
		1 Byte	17.001 Scene Number	C		W		
		1 Byte	5.010 Counter Pulses					

Table 161

Previous Step Input object is available only if “Counting type” parameter is set to “Two directions”.

The DPT of these objects can be specified with “Object type” parameters.

These objects are used to trigger the sequencer to step when it receives a proper telegram according to “Next step at” and “Previous step at” parameters.

Object Name	Function	Size	Datapoint Type	Flags					
				C	R	W	T	U	
<i>AF n</i>	<i>Sequencer - Output</i>	1 Bit	1.001 Switch						
		1 Bit	1.008 Up / Down						
		1 Bit	1.007 Step						
		1 Bit	1.017 Trigger						
		2 Bits	2.001 Switch Control						
		4 Bits	3.007 Dimming Control						
		1 Byte	18.001 Scene Control						
		1 Byte	5.001 Percentage						
		1 Byte	5.010 Counter pulses			C	R		T
		1 Byte	6.010 Counter pulses						
		1 Byte	20.102 HVAC mode						
		2 Bytes	7.001 Pulses						
		2 Bytes	8.001 Pulses Difference						
		2 Bytes	9.001 Temperature						
		4 Bytes	12.001 Counter Pulses (Unsigned)						
4 Bytes	13.001 Counter Pulses (Signed)								
4 Bytes	14.000 Acceleration								

Table 162

This object is available if “Number of output objects” parameter is set to “One output object for all steps”.

Its DPT is specified by “Output object type” parameter.

Object Name	Function	Size	Datapoint Type	Flags					
				C	R	W	T	U	
<i>AF n</i>	<i>Sequencer - Output x</i>	1 Bit	1.001 Switch						
		1 Bit	1.008 Up / Down						
		1 Bit	1.007 Step						
		1 Bit	1.017 Trigger						
		2 Bits	2.001 Switch Control						
		4 Bits	3.007 Dimming Control						
		1 Byte	18.001 Scene Control						
		1 Byte	5.001 Percentage						
		1 Byte	5.010 Counter pulses			C	R		T
		1 Byte	6.010 Counter pulses						
		1 Byte	20.102 HVAC mode						
		2 Bytes	7.001 Pulses						
		2 Bytes	8.001 Pulses Difference						
		2 Bytes	9.001 Temperature						
		4 Bytes	12.001 Counter Pulses (Unsigned)						
4 Bytes	13.001 Counter Pulses (Signed)								
4 Bytes	14.000 Acceleration								

Table 163

This object is available if “Number of output objects” parameter is set to “One output object for each step”. Its DPT is specified by “Step x output object type” parameter.

It represents the output object of one step in the sequencer function.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>AF n</i>	<i>Sequencer - Lock</i>	1 Bit	1.003 Enable	C	R	W	T	U

Table 164

This object is available if “Enable lock” parameter is set to “Yes”. It is used to lock/unlock the auxiliary function.

10.13 Staircase Controller

Staircase controller function is used to switch the lights on when it is triggered, then switch them off automatically after a specific period. The received on telegrams from the input object triggers the function to switch the lights on. The function can give the user a warning before switching the lights off.

10.13.1 Staircase Controller Parameters

Name	Values	Description
<i>Auxiliary function name</i>		The user can give the auxiliary function a name for documentation purposes. This parameter value has no effect on the function work.
<i>Manual switch off with received off telegrams</i>	No Yes	If “Yes” is selected, receiving off telegram from the input forces the function to switch off the lights immediately.

		If "No" is selected, off telegrams are ignored.
<i>Output object type</i>	1-bit switch 1-byte percentage	This parameter determines the DPT of the output object. If "1-bit switch" is selected, on telegrams will be sent to switch the lights on and off telegrams to switch them off. If "1-byte percentage" is selected, the user can specify the telegram values for switching the lights on and off with additional two parameters.
<i>Light-on time</i>	00:00:00...00:02:00...09:06:07	This parameter determines the time the lights will remain on after triggering the function.
<i>Enable "Set Light-on" object</i>	No Yes	This function is used to enable "Set Light-on Time" object that is used to change the light-on time from an object.
<i>Staircase timer is retriggerable</i>	No Yes	If "Yes" is selected, retriggering the function during the light-on time resets the timer. If "No" is selected, retriggering the function during the light-on time has no effect.
<i>Overwrite delay time value with download</i>	No Yes	"No": the light-on time that is used before the application download operation will be used after the download operation. "Yes": the light-on time in "Light-on time" parameter will be used after the download operation.
<i>Switch off prewarning</i>	Disabled Enabled	This parameter is used to warn the user that the lights will be switched off soon. Its behavior differs according to output object type. For 1-bit switch output object: Two additional times will be entered by the user "Prewarning off time" and "Prewarning on time". When light-on time is elapsed, the lights are switched off for "Prewarning off time" then switched on for "Prewarning on time" then switched off permanently. If the function is triggered during "Prewarning off time" or "Prewarning on time" the lights are switched on and the timer is reset. For 1-byte percentage output object: One additional time "Prewarning time" and one dimming value "Prewarning value" will be entered by the user. When the light-on time is elapsed, the lights are dimmed to "Prewarning value" level for "Prewarning time" then they are dimmed to "switch off value". If the function is triggered during "Prewarning time" the lights are dimmed to "switch on value" and the timer is reset.
<i>Enable lock</i>	No Yes	This function enables "Lock" object that is used to lock the auxiliary function.
<i>Lock status after bus return</i>	Unlocked Locked Read from bus As before bus failure	This parameter determines the status of the function's lock after bus voltage return. If "Read from bus" is selected, the device will send a read request for the lock object of the function, if no response is received the function will be unlocked.

Table 165

10.13.2 Staircase Controller Group Objects

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>AF n</i>	<i>Staircase Controller - Input</i>	1 Bit	1.001 Switch	C		W		

Table 166

Receiving on telegrams from this object triggers the function, and the receiving off telegrams may or may not switch the lights off according to “Manual switch off with received off telegrams”.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>AF n</i>	<i>Staircase Controller – Output</i>	1 Bit 1 Byte	1.001 Switch 5.001 Percentage	C	R		T	

Table 167

This object DPT is specified with “Output object type” parameter. It is used to switch the lights on and off.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>AF n</i>	<i>Staircase Controller – Set Light-on Time</i>	2 Bytes	7.005 time (s)	C		W		

Table 168

This object is available if “Enable “Set Light-on Time” object” parameter is set to “Yes”. It is used to change the light-on time. Maximum acceptable value is 32,767 seconds (equals to 09:06:07). The received values are saved to use them after bus voltage failures too.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>AF n</i>	<i>Staircase Controller - Lock</i>	1 Bit	1.003 Enable	C	R	W	T	U

Table 169

This object is available if “Enable lock” parameter is set to “Yes”. It is used to lock/unlock the auxiliary function.

10.14 Working Time Counter

The working time counter allows to count the time that a KNX device remains on. Also, it can give an alarm when the working time reaches a specific value.

10.14.1 Working Time Counter Parameters

Name	Values	Description
<i>Auxiliary function name</i>		The user can give the auxiliary function a name for documentation purposes. This parameter value has no effect on the function work.
<i>Input object value after bus return</i>	Off On Read from bus As before bus failure	If "Read from bus" is selected, the function will send read request for the input object. If no response is received, the input value will be off.
<i>Input polarity</i>	Normal Inverted	This parameter is used to invert the input object value. "Normal": The counter will count the time the input object value remains on. "Inverted": The counter will count the time the input object value remains off.
<i>Counting direction</i>	Decrement Increment	"Decrement": the counter will be loaded with "Counter start value" at the beginning and it will count down to 0. "Increment": the counter will be loaded with 0 at the beginning and it will count up to "Counter limit value".
<i>Counter time unit</i>	Second Minute Hour	This parameter determines the time unit of the counter.
<i>Counter start value</i>	1... 10000 ...65535	This parameter is available if "Counting direction" parameter is set to "Decrement". It determines the value that the timer will load it at the beginning.
<i>Counter limit value</i>	1... 1000 ...65535	This parameter is available if "Counting direction" parameter is set to "Increment". It determines the value that the timer will count up to it.
<i>Counter value object type</i>	2-byte unsigned value 4-byte unsigned value	This parameter defines the DPT of "Counter Value" object.
<i>Counter value object is overwritable</i>	No Yes	If "Yes" is selected, sending a value to "Counter Value" object will overwrite the current counter value.
<i>Send counter value</i>	Do not send, update only When counter value is changed At specific interval Cyclically only When counter value is changed and cyclically	This parameter defines when the function will send the counter value to the bus. If "Do not send, update only" is selected, the user can send read request to "Counter Value" object to get the current counter value.

	At specific interval and cyclically	<p>If the counter value is set to be sent at specific interval, an additional parameter will be shown to enter the interval value. The counter value will be sent to the bus if its new value is divisible by the interval value.</p> <p>If the counter value is set to be sent cyclically, additional parameters will be shown to enter the cycle time.</p>
<i>Send counter value after bus return</i>	No Yes	<p>This parameter is available if “Send counter value” parameter is not set to “Do not send, update only”.</p> <p>If “Yes” is selected, the function will send the loaded counter value at the start-up to the bus.</p>
<i>Enable “Reset Counter” object</i>	No Yes	This parameter is used to enable “Reset counter” object that is used to reload the counter with its start value when “Counting direction” is “Decrement” or with 0 value when “Counting direction” is “Increment”.
<i>Reset when received telegram is</i>	Off On Off or on	This parameter defines the value that will reset the counter when it is received on “Reset Counter” object.
<i>Enable “Alarm” object</i>	No Yes	This parameter is used to enable “Alarm” object that is used to send alarm when counter value reaches a specific value.
<i>Alarm is on when</i>	Counter time is elapsed Specific value is reached	<p>This parameter defines the value that will trigger the alarm when the counter reaches it.</p> <p>If “Specific value is reached” is selected, an additional parameter will be shown to enter the alarm value.</p>
<i>After bus return</i>	Reset Load the reached value before bus failure	This parameter defines the behavior of the function after bus voltage return.
<i>Overwrite counter value after download</i>	No Yes	<p>This parameter is available if “After bus return” parameter is set to “Load the reached value before bus failure”.</p> <p>If “No” is selected, the reached counter value before the application download operation will be loaded after the download operation.</p> <p>If “Yes” is selected, after the download operation the counter will be loaded with its start value when “Counting direction” is “Decrement” or with 0 value when “Counting direction” is “Increment”.</p>
<i>Enable lock</i>	No Yes	This function enables “Lock” object that is used to lock the auxiliary function.
<i>Lock status after bus return</i>	Unlocked Locked Read from bus As before bus failure	<p>This parameter determines the status of the function’s lock after bus voltage return.</p> <p>If “Read from bus” is selected, the device will send a read request for the lock object of the function, if no response is received the function will be unlocked.</p>

Table 170

10.14.2 Working Time Counter Group Objects

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>AF n</i>	<i>Working Time Counter - Input</i>	1 Bit	1.001 Switch	C		W		

Table 171

The input object of working time counter function.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>AF n</i>	<i>Working Time Counter - Counter value</i>	2 Bytes	7.005 Time(s)					
		2 Bytes	7.006 Time(m)					
		2 Bytes	7.007 Time(h)					
		4 Bytes	12.100 Counter Time (s)	C	R	W	T	
		4 Bytes	12.101 Counter Time (min)					
4 Bytes	12.102 Counter Time (h)							

Table 172

The value of this object represents the reached counter value. Its DPT is specified by “Counter time unit” and “Counter value object type” parameters.

If “Counter value object is overwritable” parameter is set to “Yes”, writing a value to this object will overwrite the current counter value. If the written value is larger than the start or the limit value, the counter will use the start or the limit value.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>AF n</i>	<i>Working Time Counter - Reset Counter</i>	1 Bit	1.001 Switch	C		W		

Table 173

This object is available if “Enable “Reset Counter” object” parameter is set to “Yes”.

It’s used to reload the counter with its start value if “Counting direction” is “Decrement” or with 0 value if “Counting direction” is “Increment” when it receives a telegram as specified in “Reset when received telegram is” parameter.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
<i>AF n</i>	<i>Working Time Counter - Alarm</i>	1 Bit	1.005 Switch	C	R		T	

Table 174

This object is available if “Enable “Alarm” object” parameter is set to “Yes”.

It’s used to send alarm when counter value reaches a specific value.

Object Name	Function	Size	Datapoint Type	Flags				
				C	R	W	T	U
AF n	Working Time Counter - Lock	1 Bit	1.003 Enable	C	R	W	T	U

Table 175

This object is available if “Enable lock” parameter is set to “Yes”. It is used to lock/unlock the auxiliary function.

11 Some examples of typical applications


11.1 Lighting control with KNX I/O Module

Lighting control can be done by using other devices with the KNX I/O Module device. Next example shows how lighting control can be done with multi functional switch. The light is switched on/off with two buttons of multi functional switch.

Used devices	KNX I/O Module IO200-S (WRKT4200J) KNX Multi Functional Switch - MS104-D (WRKT62145FA)
Linking	
KNX I/O Module IO200-S parameters	<ul style="list-style-type: none"> • Enable Outputs – Output 1 type: Switching (Lighting) • Output 1 Switching (Lighting) - Lighting Settings – Contact type: Normally open • Output 1 Switching (Lighting) - Lighting Settings – Function type: Switch on/off • Output 1 Switching (Lighting) - Lighting Settings – Feedback: Enabled • Output 1 Switching (Lighting) – Feedback – Feedback type: Normal • Output 1 Switching (Lighting) – Feedback – Send feedback telegrams: Send on change
KNX Multi Functional Switch - MS104-D parameters	<ul style="list-style-type: none"> • Touch buttons – Gang A: Enable • Touch buttons – Group A – Group Configuration: Rocker & Single button • Touch buttons – Group A – Rocker buttons: 1&2 • Touch buttons – Group A – Buttons – Rocker Button 1&2 – Rocker function: Switching • Touch buttons – Group A – Buttons – Rocker Button 1&2 – 1st object LEFT key action: ON • Touch buttons – Group A – Buttons – Rocker Button 1&2 – 1st object RIGHT key action: OFF • Touch buttons – Group A – Leds – Feedback led 1 – Led function: Display object value • Touch buttons – Group A – Leds – Feedback led 1 – Led behaviour: Object value 1 = Led On • Touch buttons – Group A – Leds – Feedback led 2 – Led function: Display object value • Touch buttons – Group A – Leds – Feedback led 2 – Led behaviour: Object value 0 = Led On <p>The unmentioned parameters can be the default or user defined parameters</p>

11.2 Blind control with KNX I/O Module

Shutter\Blind control can be done by using other devices with the KNX I/O Module device. In this example the operation of shutter function with multi functional switch is explained. The shutter is moved up and down in movement duration with two buttons of multi functional switch. Movement duration is the time between up and down position of shutter. The shutter takes the same time (60 s) to move between the upper position and the lower position. In addition, a previously defined shutter position can be set with another button.

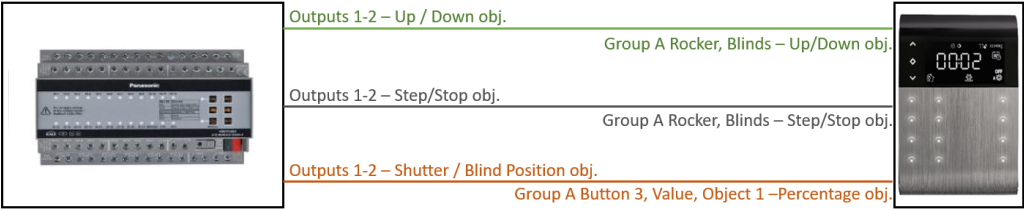Used devices	KNX I/O Module IO200-S (WRKT4200J) KNX Multi Functional Switch - MS104-D (WRKT62145FA)
Linking	
KNX I/O Module IO200-S parameters	<ul style="list-style-type: none"> • Enable Outputs – Output 1 type: Shutter/Blind (AC) • Outputs 1-2 Shutter/Blind – Shutter/Blind Settings – Operation mode: Shutter (Without slats) • Outputs 1-2 Shutter/Blind – Driving Shutter / Blind – Movement duration to up and down: Same • Outputs 1-2 Shutter/Blind – Driving Shutter / Blind – Movement Duration: 60s
KNX Multi Functional Switch - MS104-D parameters	<ul style="list-style-type: none"> • Touch buttons – Gang A: Enable • Touch buttons – Group A – Group Configuration: Rocker & Single button • Touch buttons – Group A – Rocker buttons: 1&2 • Touch buttons – Group A – Buttons – Rocker Button 1&2 – Rocker function: Blinds • Touch buttons – Group A – Buttons – Rocker Button 1&2 – Blinds key action: Left = UP, Right = DOWN • Touch buttons – Group A – Buttons – Rocker Button 1&2 – Stop driving when: Short keystroke • Touch buttons – Group A – Buttons – Button 3 – Button function: Value • Touch buttons – Group A – Buttons – Button 3 – 1st object type: Percentage (1 byte) • Touch buttons – Group A – Buttons – Button 3 – Value: 30% • Touch buttons – Group A – Leds – Feedback led 1 –Led function: Button feedback • Touch buttons – Group A – Leds – Feedback led 1 – Led behaviour: Push/Release = Led On/Off • Touch buttons – Group A – Leds – Feedback led 2 –Led function: Button feedback • Touch buttons – Group A – Leds – Feedback led 2 – Led behaviour: Push/Release = Led On/Off • Touch buttons – Group A – Leds – Feedback led 3 –Led function: Button feedback • Touch buttons – Group A – Leds – Feedback led 3 – Led behaviour: Push/Release = Led On/Off
	The unmentioned parameters can be the default or user defined parameters

11.3 Heating control with KNX I/O Module

Heating control can be done by using other devices with the KNX I/O Module device. In this example the operation of heating function with multi functional switch is explained. Channels specified as heating in the KNX I/O Module device can be switched with the control output value from the multi functional switch.

Used devices	KNX I/O Module IO200-S (WRKT4200J) KNX Multi Functional Switch - MS104-D (WRKT62145FA)
Linking	
KNX I/O Module IO200-S parameters	<ul style="list-style-type: none"> • Enable Outputs – Output 1 type: Switching (Heating) • Output 1 Switching (Heating) - Heating Settings – Type of control: Continuous PWM (1-byte)
KNX Multi Functional Switch - MS104-D parameters	<ul style="list-style-type: none"> • Thermostat – Controller General - Temperature control function: Heating • Thermostat – Controller General - Controller type: Continuous
	The unmentioned parameters can be the default or user defined parameters

11.4 2 pipes fan coil system control with KNX I/O Module

It is possible to control 2 pipes and 4 pipes fan coil system with the KNX I/O Module device. In this example 2 pipes fan coil system control that has 3 fan levels is mentioned. Heating and cooling control can be done with the KNX I/O Module’s Fan coil (2-pipe) function.

Used devices	KNX I/O Module IO200-S (WRKT4200J) KNX Multi Functional Switch - MS104-D (WRKT62145FA)
Linking	<p> Outputs 1->4 – Cooling Actuating Value obj. — Thermostat Heating Cooling Control, Control Output obj. Outputs 1->4 – Heating Actuating Value obj. Outputs 1->4 – Operating Mode Switchover obj. — Thermostat H/C Switchover, Report H/C obj. Outputs 1->4 – Fan Auto-Manual Switchover obj. — Thermostat Fan Auto Mode, Fan Auto Enable obj. Outputs 1->4 – Manual Fan Level obj. — Thermostat Fan Level, Fan Level Output obj. </p>
KNX I/O Module IO200-S parameters	<ul style="list-style-type: none"> • Enable Outputs – Output 1 type: Fan coil (2-pipe) • Enable Outputs – Number of fan levels: 3 levels • Outputs 1->4 Fan Coil – Fan Coil Settings – Supported fan coil system: Cooling and Heating • Outputs 1->4 Fan Coil – Fan Coil Settings – Manual fan control: Enabled • Outputs 1->4 Fan Coil – Fan Settings – Fan level 1 threshold: 1 • Outputs 1->4 Fan Coil – Fan Settings – Fan level 2 threshold: 30 • Outputs 1->4 Fan Coil – Fan Settings – Fan level 3 threshold: 60 • Outputs 1->4 Fan Coil – Manual Fan Control – Fan auto-manual object value: Off=auto, On = manual • Outputs 1->4 Fan Coil – Manual Fan Control – Fan level changeover via: 1-byte object (0-255)
KNX Multi Functional Switch - MS104-D parameters	<ul style="list-style-type: none"> • Thermostat – Controller General - Temperature control function: Heating and Cooling • Thermostat – Controller General - Switchover object value = Heating = 1, Cooling = 0 • Thermostat – Controller General - HVAC system type: 1 control object (2 pipes system) • Thermostat – Controller General - Controller type: Continuous • Thermostat – Heating Control – Fan control: Enable • Thermostat – Cooling Control – Fan control: Enable • Thermostat – Fan Control – Number of fan level: 3 levels • Thermostat – Fan Control – Fan object type: 1-Byte object, configurable • Thermostat – Fan Control – Fan level off custom value: 0 • Thermostat – Fan Control – Fan level 1 custom value: 1 • Thermostat – Fan Control – Fan level 2 custom value: 2 • Thermostat – Fan Control – Fan level 3 custom value: 3 • Thermostat – Fan Control – Fan level level auto custom: No • Thermostat – Fan Control – Fan switchover auto to manual: Manual enable is 1, manual disable is 0 • Thermostat – Fan Control – Fan Heating – Fan Auto: Enable • Thermostat – Fan Control – Fan Heating: Fan level 1 threshold: 1 • Thermostat – Fan Control – Fan Heating: Fan level 2 threshold: 30 • Thermostat – Fan Control – Fan Heating: Fan level 3 threshold: 60 • Thermostat – Fan Control – Fan Cooling – Fan Auto: Enable • Thermostat – Fan Control – Fan Cooling: Fan level 1 threshold: 1 • Thermostat – Fan Control – Fan Cooling: Fan level 2 threshold: 30 • Thermostat – Fan Control – Fan Cooling: Fan level 3 threshold: 60 <p>The unmentioned parameters can be the default or user defined parameters</p>

11.5 Scene control with KNX I/O Module

Scene control can be done by using other devices with the KNX I/O Module device. In the following example, scenario control in which curtain and lighting control is performed at the same time with a KNX I/O Module and 1 gang switch is mentioned. When the up button of switch is pressed, the shutter will go up and the light will be turned off. When the bottom button is pressed, the shutter will go down and the light will be turned on.

Used devices	KNX I/O Module IO200-S (WRKT4200J) KNX Modular switch 1 gang (WRKT6121)
Linking	<p>Outputs 1-2 – Scene Input obj. Output 3– Scene Input obj. Rocker 1, scene number Recall / Save light scene obj.</p>
KNX I/O Module IO200-S parameters	<ul style="list-style-type: none"> • Enable Outputs – Output 1 type: Shutter/Blind (AC) • Enable Outputs – Output 3 type: Switching (Lighting) • Outputs 1-2 Shutter/Blind – Shutter/Blind Settings – Scenes: Enabled • Outputs 1-2 Shutter/Blind – Scenes – Scene 1 is assigned to: Scene number 1 • Outputs 1-2 Shutter/Blind – Scenes – Scene 1 – Action: Drive to top • Outputs 1-2 Shutter/Blind – Scenes – Scene 2 is assigned to: Scene number 2 • Outputs 1-2 Shutter/Blind – Scenes – Scene 2 – Action: Drive to bottom • Output 1 Switching (Lighting) - Lighting Settings – Scenes: Enabled • Output 1 Switching (Lighting) – Scenes – Scene 1 is assigned to: Scene number 1 • Output 1 Switching (Lighting) – Scenes – Scene 1 – State: Off • Output 1 Switching (Lighting) – Scenes – Scene 2 is assigned to: Scene number 2 • Output 1 Switching (Lighting) – Scenes – Scene 2 – State: On
KNX Modular switch parameters	<ul style="list-style-type: none"> • General – Function of Rocker 1: Scene • Rocker 1 – Scene number for Upper side: 1 • Rocker 1 – Scene number for Lower side: 2
	The unmentioned parameters can be the default or user defined parameters